



**PowerQ and PowerQ Plus**  
**MI 2492 and MI 2392**  
**Instruction manual**

*Version 1.0, HW5, Code No. 20 752 106*

*Distributor:*

*Manufacturer:*

METREL d.d.  
Ljubljanska cesta 77  
1354 Horjul  
Slovenia

web site: <http://www.metrel.si>  
e-mail: [metrel@metrel.si](mailto:metrel@metrel.si)



Mark on your equipment certifies that this equipment meets the requirements of the EU (European Union) concerning safety and interference causing equipment regulations

© 2013 METREL

No part of this publication may be reproduced or utilized in any form or by any means without permission in writing from METREL.

<b>1</b>	<b>Introduction.....</b>	<b>6</b>
1.1	Main Features .....	6
1.2	Safety considerations .....	7
1.3	Applicable standards .....	8
1.4	Abbreviations.....	8
<b>2</b>	<b>Description.....</b>	<b>11</b>
2.1	Front panel .....	11
2.2	Connector panel .....	12
2.3	Bottom view.....	13
2.4	Accessories .....	13
2.4.1	Standard accessories.....	13
2.4.2	Optional accessories .....	14
<b>3</b>	<b>Operating the instrument.....</b>	<b>15</b>
3.1	Instrument Main Menu.....	16
3.1.1	Instrument main functions .....	17
3.2	U, I, f menu.....	17
3.2.1	Meter .....	17
3.2.2	Scope .....	19
3.2.3	Trend.....	21
3.3	Power menu .....	23
3.3.1	Meter.....	23
3.3.2	Trend.....	24
3.4	Energy menu .....	26
3.5	Harmonics menu .....	28
3.5.1	Meter.....	28
3.5.2	Histogram (Bar).....	29
3.5.3	Trend.....	30
3.6	Phase Diagram.....	33
3.6.1	Phase diagram .....	33
3.6.2	Symmetry diagram .....	34
3.6.3	Symmetry trend.....	35
3.7	General Recorder.....	36
3.1	Inrush / Fast recorder .....	39
3.1.1	Setup.....	39
3.1.2	Capturing inrush.....	40
3.1.3	Captured inrush.....	41
3.2	Events table.....	43
3.3	Memory List.....	47
3.3.1	Record.....	48
3.3.2	Waveform snapshot .....	51
3.3.3	Inrush/Fast logger .....	51
3.4	Measurement Setup menu .....	51
3.4.1	Connection setup .....	52
3.4.2	Event setup .....	54
3.5	General Setup menu .....	55
3.5.1	Communication .....	55
3.5.2	Time & Date .....	56
3.5.3	Language .....	56
3.5.4	Clear memory.....	57
3.5.5	Instrument info .....	58

3.5.6	Lock/Unlock.....	58
<b>4</b>	<b>Recording Practice and Instrument Connection .....</b>	<b>60</b>
4.1	Measurement campaign.....	60
4.2	Connection setup .....	64
4.2.1	Connection to the LV Power Systems.....	64
4.2.2	Connection to the MV or HV Power System.....	67
4.2.3	Current clamp selection and transformation ratio setting .....	68
4.3	Number of measured parameters and connection type relationship .....	72
<b>5</b>	<b>Theory and internal operation .....</b>	<b>75</b>
5.1	Measurement methods.....	75
5.1.1	Measurement aggregation over time intervals .....	75
5.1.2	Voltage measurement (magnitude of supply voltage) .....	75
5.1.3	Current measurement (magnitude of supply current).....	76
5.1.4	Frequency measurement .....	76
5.1.5	Phase power measurements.....	77
5.1.6	Total power measurements.....	77
5.1.7	Energy.....	78
5.1.8	Harmonics .....	79
5.1.9	Voltage and current unbalance .....	80
5.1.10	Voltage events .....	81
5.1.11	Data aggregation in GENERAL RECORDING .....	83
5.1.12	Inrush/Fast recorder .....	87
5.2	EN 50160 Standard Overview .....	89
5.2.1	Power frequency .....	89
5.2.2	Supply voltage variations .....	90
5.2.3	Voltage dips (Indicative values).....	90
5.2.4	Short interruptions of the supply voltage .....	90
5.2.5	Long interruptions of the supply voltage.....	90
5.2.6	Supply voltage unbalance .....	90
5.2.7	THD voltage and harmonics.....	90
5.2.8	Interharmonic voltage.....	91
5.2.9	Mains signalling on the supply voltage.....	91
5.2.10	Flicker severity .....	91
5.2.11	PowerQ / PowerQ Plus recorder setting for EN 50160 survey .....	91
<b>6</b>	<b>Technical specifications .....</b>	<b>93</b>
6.1	Measuring system .....	93
6.2	Measurements.....	93
6.2.1	Voltage .....	93
6.2.2	Current .....	93
6.2.3	Frequency .....	94
6.2.4	Power (W, VA, VAR) .....	94
6.2.5	Power factor .....	94
6.2.6	Cosinus $\phi$ .....	94
6.2.7	Energy (Wh, VAh, VARh) .....	95
6.2.8	Voltage harmonics.....	95
6.2.9	Current harmonics.....	95
6.2.10	Unbalance .....	96
6.3	Recorders.....	96
6.3.1	General recorder .....	96
6.3.2	Inrush/fast recorder .....	96

6.4	General specifications .....	97
6.5	Communication .....	97
6.5.1	RS-232 serial interface .....	97
6.5.2	USB interface .....	97
6.6	Display.....	97
6.7	Non - Volatile memory .....	97
<b>7</b>	<b>Maintenance.....</b>	<b>98</b>
7.1	Inserting batteries into the instrument .....	98
7.2	Batteries .....	99
7.3	Power supply considerations.....	100
7.4	Cleaning .....	100
7.5	Periodic calibration .....	100
7.6	Service .....	100
7.7	Troubleshooting.....	100

# 1 Introduction

PowerQ and PowerQ Plus are handheld multifunction instruments for power quality analysis and energy efficiency measurements.

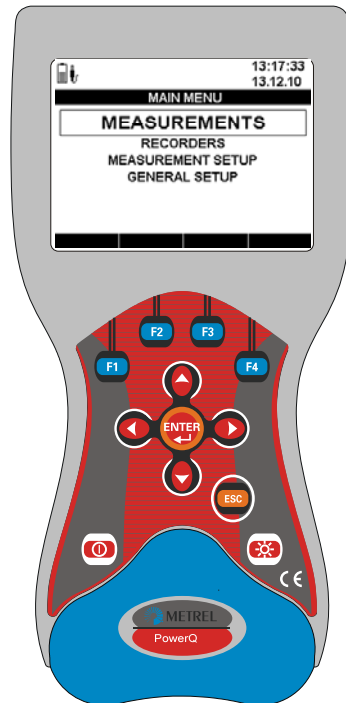


Figure 1.1: Instrument PowerQ / PowerQ Plus

## 1.1 Main Features

- 3 voltage channels with wide measurement range: 0 ÷ 600 Vrms, CAT IV / 600 V.
- 3 current channels with support for automatic clamp recognition and “on instrument” range selection<sup>1</sup>.
- Predefined recorder profile for EN 50160 survey.
- Power measurements compliance with IEC 61557-12 and IEEE 1448.
- Simple to use and powerful recorder with 8 MB of memory and possibility to record 524 different power quality signatures.
- Powerful troubleshooting tools: inrush/fast recorder<sup>2</sup>.
- Voltage events capture<sup>3</sup>.
- 12 hour of autonomous (battery) supply.

---

<sup>1</sup> only with Metrel »Smart clamps«

<sup>2</sup> PowerQ Plus only

<sup>3</sup> PowerQ Plus only

- **PowerView v2.0** is a companion PC Software which provides easiest way to download, view and analyze measured data or print.
  - PowerView v2.0 analyzer exposes a simple but powerful interface for downloading instrument data and getting quick, intuitive and descriptive analysis. Interface has been organized to allow quick selection of data using a Windows Explorer-like tree view.
  - User can easily download recorded data, and organize it into multiple sites with many sub-sites or locations.
  - Generate charts, tables and graphs for your power quality data analyzing, and create professional printed reports.
  - Export or copy / paste data to other applications (e.g. spreadsheet) for further analysis.
  - Multiple data records can be displayed and analyzed simultaneously. Merge different logging data into one measurement, synchronize data recorded with different instruments with time offsets, split logging data into multiple measurements, or extract data of interest.

## 1.2 Safety considerations

To ensure operator safety while using the PowerQ / PowerQ Plus instruments and to minimize the risk of damage to the instrument, please note the following general warnings:



**The instrument has been designed to ensure maximum operator safety. Usage in a way other than specified in this manual may increase the risk of harm to the operator!**



**Do not use the instrument and/or any accessories if there is any damage visible!**



**The instrument contains no user serviceable parts. Only an authorized dealer can carry out service or adjustment!**



**All normal safety precautions have to be taken in order to avoid risk of electric shock when working on electrical installations!**



**Only use approved accessories which are available from your distributor!**



**Instrument contains rechargeable NiMh batteries. The batteries should only be replaced with the same type as defined on the battery placement label or in this manual. Do not use standard batteries while power supply adapter/charger is connected, otherwise they may explode!**



**Hazardous voltages exist inside the instrument. Disconnect all test leads, remove the power supply cable and switch off the instrument before removing battery compartment cover.**



**In hot (> 40 °C) environment the battery holder screw might reach maximum allowed temperature for metal part of handle. In such environment it is advisable not to touch the battery cover during or immediately after the charging.**



**Maximum voltage between any phase and neutral input is 600 V<sub>RMS</sub>. Maximum voltage between phases is 1039 V<sub>RMS</sub>.**



**Always short unused voltage inputs (L1, L2, L3) with neutral (N) input to prevent measurement errors and false event triggering due to noise coupling.**

## 1.3 Applicable standards

The PowerQ / PowerQ Plus are designed and tested in accordance with the following standards:

---

### *Electromagnetic compatibility(EMC)*

EN 61326-2-2: 2006

Electrical equipment for measurement, control and laboratory use.

- Emission: Class A equipment (for industrial purposes)
- Immunity for equipment intended for use in industrial locations

---

### *Safety (LVD)*

EN 61010-1: 2001

Safety requirements for electrical equipment for measurement, control and laboratory use

---

### *Measurements methods*

IEC 61000-4-30: 2008 Class B

Testing and measurement techniques – Power quality measurement methods

IEC 61000-4-7: 2002 + A1: 2008

General guide on harmonics and interharmonics measurements and instrumentation

EN 50160 : 2010

Voltage characteristics of electricity supplied by public distribution networks

---

### **Note about EN and IEC standards:**

Text of this manual contains references to European standards. All standards of EN 6XXXX (e.g. EN 61010) series are equivalent to IEC standards with the same number (e.g. IEC 61010) and differ only in amended parts required by European harmonization procedure.

## 1.4 Abbreviations

In this document following symbols and abbreviations are used:

$Cf_i$  Current crest factor, including  $Cf_{ip}$  (phase p current crest factor). See 5.1.3 for definition.

$Cf_U$  Voltage crest factor, including  $Cf_{Upq}$  (phase p to phase q voltage crest factor). See 5.1.2 for definition.

$\cos\varphi$ ,  $DPF$  Displacement factor including  $\cos\varphi_p$  /  $DPF_p$  (phase p displacement factor). See 5.1.5 and 5.1.6 for definition.

$eP^+$ ,  $eP^-$  Active energy including  $eP_p$  (phase p energy) and  $eP_{tot}$  (total energy). Minus sign indicates generated energy and plus sign, indicate consumed energy. See 5.1.7 for definition.

$eQ^{j+}$ ,  $eQ^{c+}$ ,  
 $eQ^{j-}$ ,  $eQ^{c-}$  Reactive energy including  $eQ_p$  (phase p energy) and  $eQ_{tot}$  (total energy). Minus sign indicates generated energy and plus sign, indicate consumed energy. Inductive reactive energy character is marked with “i” and



	capacitive reactive energy character is marked with “c”. See 5.1.7 for definition.
$eS^+, eS^-$	Apparent energy. Minus sign indicates generated energy and plus sign, indicate consumed energy. See 5.1.7 for definition.
$f, freq$	Frequency, including $freq_{U12}$ (voltage frequency on $U_{12}$ ), $freq_{U1}$ (voltage frequency on $U_1$ ) and $freq_{I1}$ (current frequency on $I_1$ ). See 5.1.4 for definition.
$\bar{i}$	Negative sequence current ratio (%). See 5.1.9 for definition.
$i^0$	Zero sequence current ratio (%). See 5.1.9 for definition.
$I^+$	Positive sequence current component on three phase systems. See 5.1.9 for definition.
$I^-$	Negative sequence current component on three phase systems. See 5.1.9 for definition.
$I^0$	Zero sequence current components on three phase systems. See 5.1.9 for definition.
$I_{\frac{1}{2}Rms}$	RMS current measured over each half period , including $I_{p\frac{1}{2}Rms}$ (phase p current)
$I_{Fnd}$	Fundamental RMS current $I_{h1}$ (on 1 <sup>st</sup> harmonics), including $I_{pFnd}$ (phase p fundamental RMS current). See 5.1.8 for definition.
$I_{hn}$	n <sup>th</sup> current RMS harmonic component including $I_{p hn}$ (phase p; n <sup>th</sup> RMS current harmonic component). See 5.1.8 for definition
$I_{Nom}$	Nominal current. Current of clamp-on current sensor for 1 Vrms at output
$I_{PK}$	Peak current, including $I_{pPK}$ (phase p current) including $I_{NPK}$ (neutral peak current)
$I_{Rms}$	RMS current, including $I_{pRms}$ (phase p current). See 5.1.3 for definition.
$\pm P, P^+, P^-$	Active power including $P_p$ (phase p active power) and $P_{tot}$ (total active power). Minus sign indicates generated power and plus / no sign, indicate consumed power. See 5.1.5 and 5.1.6 for definition.
$p, pg$	Indices. Annotation for parameter on phase p: [1, 2, 3] or phase-to-phase pg: [12, 23, 31]
$PF, PF^+, PF^{c+}, PF^{i+}, PF^-, PF^{c-}, PF^{i-}$	Power factor including $PF_p$ (phase p power factor vector) and $PF_{tot}$ (total power factor vector). Minus sign indicates generated power and plus sign, indicate consumed power. Inductive power factor character is marked with “i” and capacitive power factor character is marked with “c”.  Note: $PF = \text{Cos } \varphi$ when upper harmonics are not present. See 5.1.5 and 5.1.6 for definition.
$\pm Q, Q^+, Q^{c+}, Q^{i+}, Q^-, Q^{c-}, Q^{i-}$	Reactive power including $Q_p$ (phase p reactive power) and $Q_{tot}$ (total reactive power). Minus sign indicates generated power and plus sign, indicate consumed power. Inductive reactive character is marked with “i” and capacitive reactive character is marked with “c”. See 5.1.5 and 5.1.6 for definition.
$S, S^+, S^-$	Apparent power including $S_p$ (phase p apparent power) and $S_{tot}$ (total

apparent power). See 5.1.5 and 5.1.6 for definition. Minus sign indicates apparent power during generation and plus sign indicate apparent power during consumption. See 5.1.5 and 5.1.6 for definition.

$THD_I$	Total harmonic distortion current related to fundamental, including $THD_{Ip}$ (phase p current THD). See 5.1.8 for definition
$THD_U$	total harmonic distortion voltage related to fundamental, including $THD_{Upg}$ (phase p to phase g voltage THD) and $THD_{Up}$ (phase p to neutral voltage THD). See 5.1.9 for definition.
$u^-$	Negative sequence voltage ratio (%). See 5.1.9 for definition.
$u^0$	Zero sequence voltage ratio (%). See 5.1.9 for definition.
$U, U_{Rms}$	RMS voltage, including $U_{pg}$ (phase p to phase g voltage) and $U_p$ (phase p to neutral voltage). See 5.1.2 for definition.
$U^+$	Positive sequence voltage component on three phase systems. See 5.1.9 for definition.
$U^-$	Negative sequence voltage component on three phase systems. See 5.1.9 for definition.
$U^0$	Zero sequence voltage component on three phase systems. See 5.1.9 for definition.
$U_{Dip}$	Minimal $U_{Rms(1/2)}$ voltage measured during dip occurrence
$U_{Fnd}$	Fundamental RMS voltage ( $U_{h1}$ on 1 <sup>st</sup> harmonics), including $U_{pgFnd}$ (phase p to phase g fundamental RMS voltage) and $U_{pFnd}$ (phase p to neutral fundamental RMS voltage). See 5.1.8 for definition
$U_{hN}$	n <sup>th</sup> voltage RMS harmonic component including $U_{pghN}$ (phase p to phase g voltage n <sup>th</sup> RMS harmonic component) and $U_{phN}$ (phase p to neutral voltage n <sup>th</sup> RMS harmonic component). See 5.1.8 for definition.
$U_{Int}$	Minimal $U_{Rms(1/2)}$ voltage measured during interrupt occurrence
$U_{Nom}$	Nominal voltage, normally a voltage by which network is designated or identified
$U_{Pk}$	Peak voltage, including $U_{pgPk}$ (phase p to phase g voltage) and $U_{pPk}$ (phase p to neutral voltage)
$U_{Rms(1/2)}$	RMS voltage refreshed each half-cycle, including $U_{pgRms(1/2)}$ (phase p to phase g half-cycle voltage) and $U_{pRms(1/2)}$ (phase p to neutral half-cycle voltage) See 5.1.10 for definition.
$U_{Swell}$	Maximal $U_{Rms(1/2)}$ voltage measured during swell occurrence
$U_{Sig}$	Mains signalling RMS voltage. Signalling is a burst of signals, often applied at a non-harmonic frequency, that remotely control equipment. See 5.2.9 for details

## 2 Description

### 2.1 Front panel


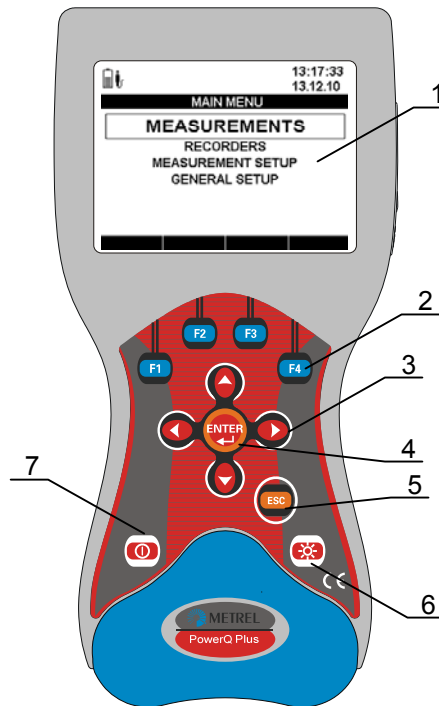


Figure 2.1: Front panel

#### Front panel layout:

- |                      |  |
|----------------------|--|
| 1. <b>LCD</b>        | Graphic display with LED backlight, 320 x 200 pixels.  |
| 2. <b>F1 – F4</b>    | Function keys.   |
| 3. <b>ARROW keys</b> | Move cursor and select parameters.   |
| 4. <b>ENTER key</b>  | Confirms new settings, step into submenu.  |
| 5. <b>ESC key</b>    | Exits any procedure, exit from submenu.  |
| 6. <b>LIGHT key</b>  | LCD backlight on/off (backlight automatically turns off after 15 minutes if no key action occurs).<br>If the <i>LIGHT</i> key is pressed for more than 1.5 seconds, CONTRAST menu is displayed. Contrast can be adjusted with the <i>LEFT</i> and <i>RIGHT</i> keys. |
| 7. <b>ON-OFF key</b> | Turns on/off the instrument.   |

## 2.2 Connector panel

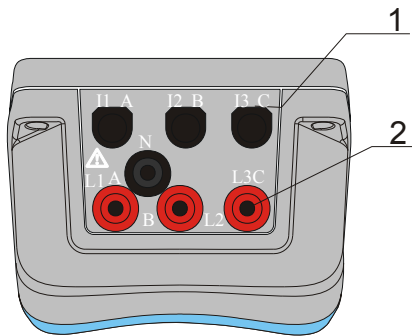

### Warning!

- Use safety test leads only!
- Max. permissible voltage between voltage input terminals and ground is 600 V<sub>RMS</sub> !

Figure 2.2: Top connector panel

Top connector panel layout:

- 1 Clamp-on current transformers (I<sub>1</sub>, I<sub>2</sub>, I<sub>3</sub>) input terminals.
- 2 Voltage (L<sub>1</sub>, L<sub>2</sub>, L<sub>3</sub>, N) input terminals.

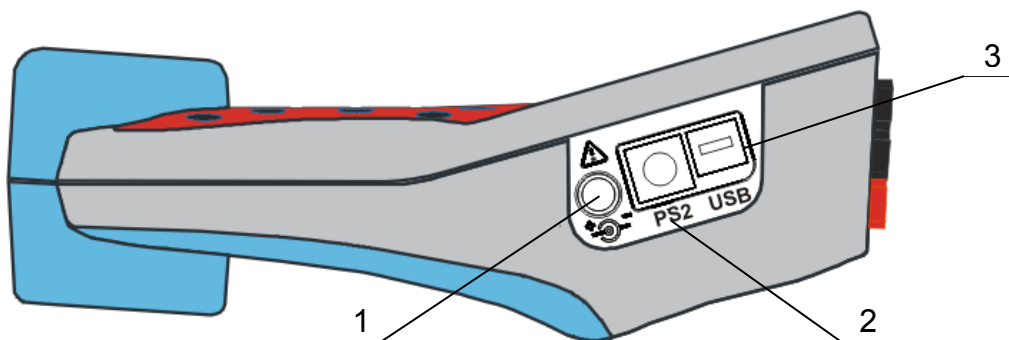


Figure 2.3: Side connector panel

Side connector panel layout:

- 1 External power socket.
- 2 PS-2 – RS-232 serial connector.
- 3 USB – Connector.

## 2.3 Bottom view

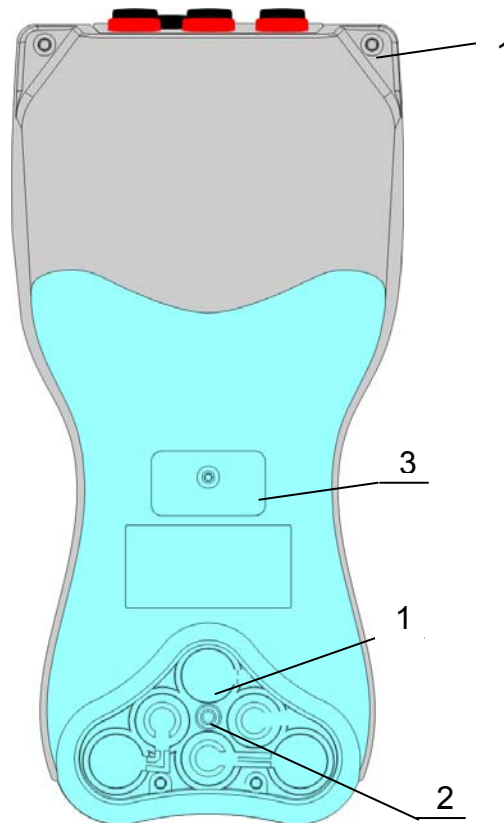


Figure 2.4: Bottom view

Bottom view layout:

1. Battery compartment.
2. Battery compartment screw (unscrew to replace the batteries).
3. Serial number label.

## 2.4 Accessories

### 2.4.1 Standard accessories

Table 2.1: PowerQ / PowerQ Plus standard accessories

Description	Peaces
Flexible current clamp 3000 A / 300 A / 30 A (A 1227)	3
Test probe, red	3
Crocodile clip, black	1
Voltage measurement cable, red	3
Voltage measurement cable, black	1
USB cable	1
RS232 cable	1
12 V / 1.2 A Power supply adapter	1
NiMH rechargeable battery, type HR 6 (AA)	6

Soft carrying bag	1
Instruction manual for PowerQ / PowerQ Plus	1
<b>Compact disk contest – related to PowerQ / PowerQ Plus</b>	
<ul style="list-style-type: none"> <li>• PC software PowerView v2.0 with instruction manual</li> </ul>	
<ul style="list-style-type: none"> <li>• Instruction manual for PowerQ / PowerQ Plus</li> </ul>	
<ul style="list-style-type: none"> <li>• Handbook "Modern Power Quality Measurement Techniques"</li> </ul>	

## 2.4.2 Optional accessories

Table 2.2: PowerQ / PowerQ Plus optional accessories

Ord. code	Description	
A 1020	Small soft carrying bag	<p>The image displays various optional accessories for the PowerQ / PowerQ Plus meter. It includes a small soft carrying bag (A 1020), a current transformer (A 1037), mini current clamps (A 1069, A 1122), a current clamp (A 1033), safety fuse adapters (S 2014), safety flat clamps (S 2015), a connection cable for current clamp (A 1039), 3-phase flexible current clamps (A 1179), a printer DPU 414 (A 1279), and a current clamp (A 1281).</p>
A 1037	Current transformer 5 A / 1 V	
A 1069	Mini current clamp 100 A / 1 V	
A 1122	Mini current clamp 5 A / 1 V	
A 1033	Current clamp 1000 A / 1 V	
S 2014	Safety fuse adapters	
S 2015	Safety flat clamps	
A 1039	Connection cable for current clamp	
A 1179	3-phase flexible current clamps 2000 A / 200 A / 20 A	
A 1279	Printer DPU 414	
A 1281	Current clamp 5 A / 100 A / 1000 A	

### 3 Operating the instrument

This section describes how to operate the instrument. The instrument front panel consists of a graphic LCD display and keypad. Measured data and instrument status are shown on the display. Basic display symbols and keys description is shown on figure bellow.

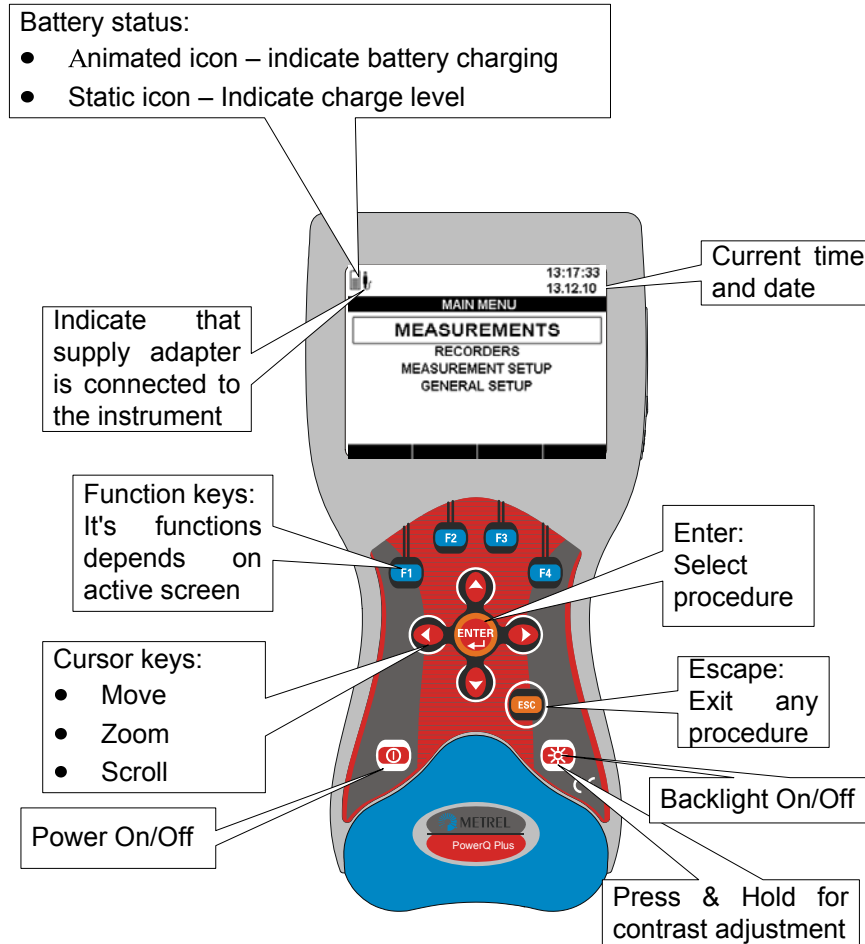


Figure 3.1: Display symbols and keys description

During measurement campaign various screens can be displayed. Most screens share common labels and symbols. These are shown on figure bellow.

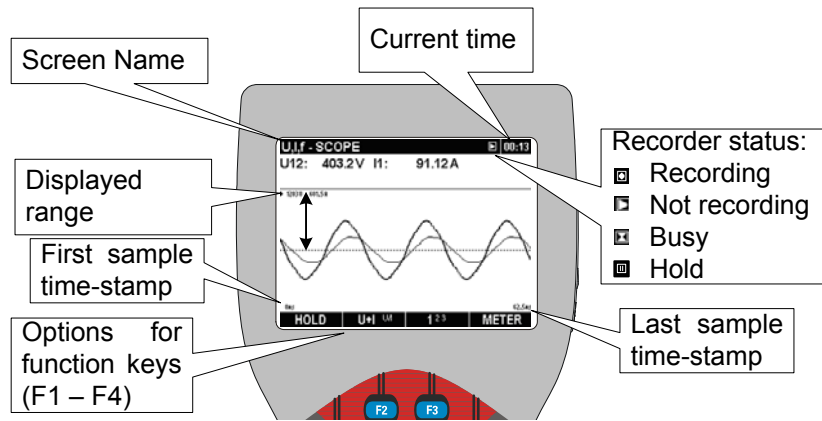


Figure 3.2: Common display symbols and labels during measurement campaign

### 3.1 Instrument Main Menu

After powering on the instrument the “MAIN MENU” is displayed. From this menu all instrument functions can be selected.

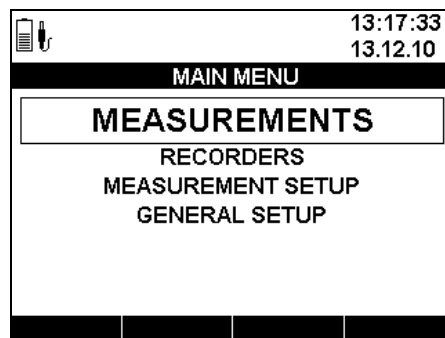


Figure 3.3: “MAIN MENU”

Table 3.1: Instrument screen symbols and abbreviations

	Battery status <ul style="list-style-type: none"> <li>• Animated icon – indicate battery charging</li> <li>• Static icon – Indicate charge level</li> </ul>
	Indicate that charger is connected to the instrument
12:58:24 24.11.08	Current time and date

Table 3.2: Keys functions

	Select function from the “MAIN MENU”.
--	---------------------------------------





Enter selected function.

### 3.1.1 Instrument main functions

By pressing ENTER function, user can select one of four menu subgroup of function:

- Measurements – set of basic measurement screens,
- Recorders – setup and view of various recording,
- Measurement Setup –parameterization of measurement parameters/procedures,
- General Setup – configuring or checking of other instrument parameters.

List of all submenu are presented on following figure.

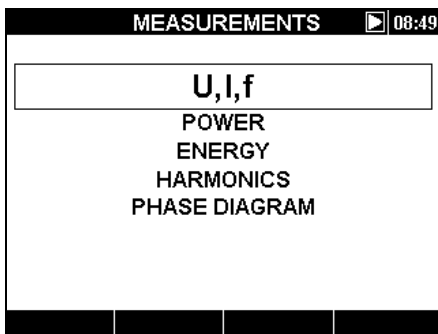


Figure 3.4: Measurements menu

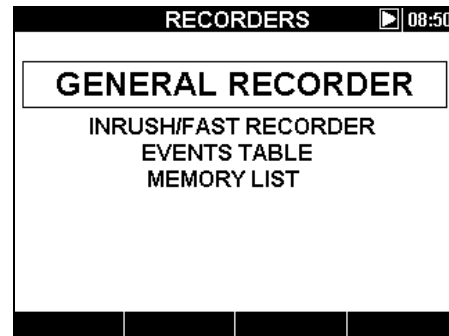


Figure 3.5: Recorders menu

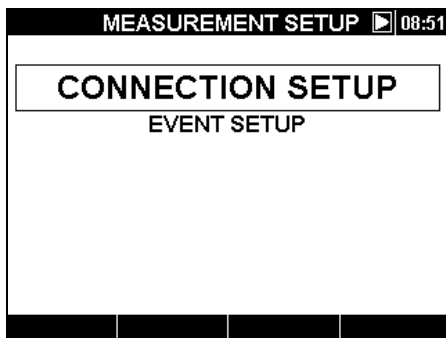


Figure 3.6: Measurement setup menu

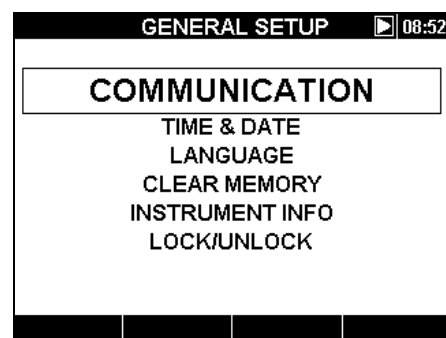


Figure 3.7: General setup menu

## 3.2 U, I, f menu

All important voltage, current and frequency parameters can be observed in the “U, I, f” menu. Measurements results can be viewed in a tabular (METER) or a graphical form (SCOPE, TREND). TREND view is active only in RECORDING mode. See section 3.7 for details.

### 3.2.1 Meter

By entering U, I, f menu, the U, I, f – METER tabular screen is shown (see figure below).

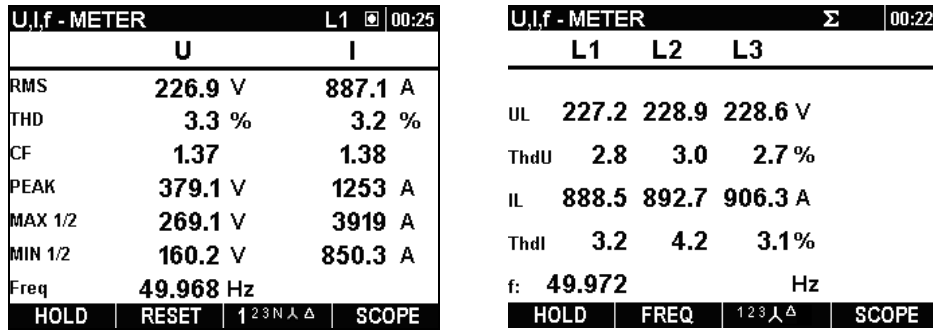


Figure 3.8: U, I, f meter table screens

In those screens on-line voltage and current measurements are shown. Descriptions of symbol and abbreviations used in this menu are shown in table below.

Table 3.3: Instrument screen symbols and abbreviations





<b>L1 L2 L3</b>	
<b>L12 L23 L31</b>	Show currently displayed channel.
<b>人 Δ</b>	
	Current recorder status
	RECORDER is active
	RECORDER is busy (retrieving data from memory)
	RECORDER is not active
<b>20:45</b>	Current instrument time
RMS	True effective value $U_{Rms}$ and $I_{Rms}$
THD	Total harmonic distortion $THD_U$ and $THD_I$
CF	Crest factor $Cf_U$ and $Cf_I$
PEAK	Peak value $U_{Pk}$ and $I_{Pk}$
MAX 1/2	Maximal $U_{Rms(1/2)}$ voltage and maximal $I_{1/2Rms}$ current, measured after RESET (key: F2)
MIN 1/2	Minimal $U_{Rms(1/2)}$ voltage and minimal $I_{1/2Rms}$ current, measured after RESET (key: F2)
f	Frequency on reference channel

**Note:** In case of AD converter overloading current and voltage value will be displayed with inverted color **250.4 V**.

**Note:** If phase current or voltage values are low, accuracy can be compromised. Value will be then displayed with inverted color **0.4 V**.

Table 3.4: Keys functions

		Waveform snapshot:
	<b>HOLD</b>	Hold measurement on display
	<b>SAVE</b>	Save held measurement into memory

	<b>RESET</b>	Reset MAX ½ and MIN ½ values ( $U_{Rms(1/2)}$ and $I_{1/2Rms}$ )
	<b>f</b>	Show frequency trend (available only during recording)
	<b>1 2 3</b>	Show measurements for phase L1
	<b>1 2 3</b>	Show measurements for phase L2
	<b>1 2 3</b>	Show measurements for phase L3
	<b>1 2 3</b>	Summary of all phases measurements
	<b>1 2 3</b>	Show phase-to-phase voltages measurements
	<b>METER</b>	Switch to METER view.
	<b>SCOPE</b>	Switch to SCOPE view
	<b>TREND</b>	Switch to TREND view (available only during recording)
		Return to the “MEASUREMENTS” menu screen.

### 3.2.2 Scope

Various combinations of voltage and current waveforms are displayed.

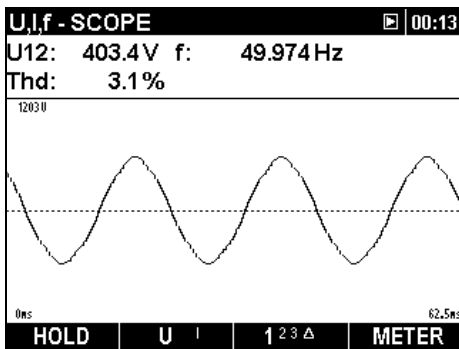


Figure 3.9: Voltage waveform

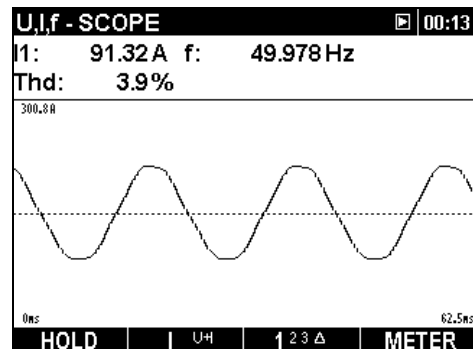


Figure 3.10: Current waveform

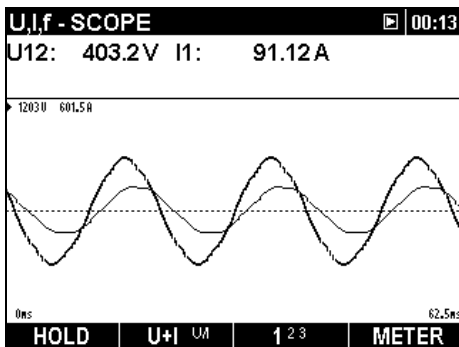


Figure 3.11: Voltage and current waveform (single mode)

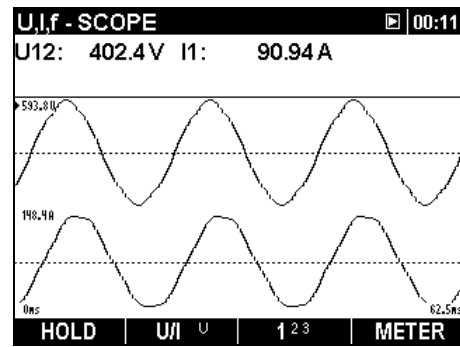


Figure 3.12: Voltage and current waveform (dual mode)

Table 3.5: Instrument screen symbols and abbreviations















	Current recorder status RECORDER is active
	RECORDER is busy (retrieving data from memory)
	RECORDER is not active
<b>20:45</b>	Current instrument time
Up p: [1..3]	True effective value of phase voltage: $U_{1Rms}, U_{2Rms}, U_{3Rms}$
Upg p,g: [1, 2, 3]	True effective value of phase-to-phase (line) voltage: $U_{12Rms}, U_{23Rms}, U_{31Rms}$
Ip p: [1..3]	True effective value of current: $I_{1Rms}, I_{2Rms}, I_{3Rms}$
Thd	Total harmonic distortion for displayed quantity (THD <sub>U</sub> or THD <sub>I</sub> )
f	Frequency on reference channel

Table 3.6: Keys functions

	Waveform snapshot: <b>HOLD</b> Hold measurement on display <b>SAVE</b> Save held measurement into memory
	Select which waveforms to show: <b>U I</b> Show voltage waveform <b>I U+I</b> Show current waveform <b>U+I U+I</b> Show voltage and current waveform (single graph) <b>U/I U</b> Show voltage and current waveform (dual graph)
	Select between phase, all-phases and line view: <b>1 2 3</b>  Show waveforms for phase L1 <b>1 2 3</b>  Show waveforms for phase L2 <b>1 2 3</b>  Show waveforms for phase L3 <b>1 2 3</b>  Summary of all phases waveforms
	<b>METER</b> Switch to METER view <b>SCOPE</b> Switch to SCOPE view <b>TREND</b> Switch to TREND view (available only during recording)
	Select which waveform to zoom (only in U/I or U+I)
	Set vertical zoom
	Set horizontal zoom



Exit from "HOLD" screen without saving.  
Return to the "MEASUREMENTS" menu screen.

### 3.2.3 Trend

While RECORDER is active, TREND view is available (see section 3.7 for instructions how to start recorder).

#### Voltage and current trends

Current and voltage trends can be observed by cycling function key F4 (METER-SCOPE-TREND).

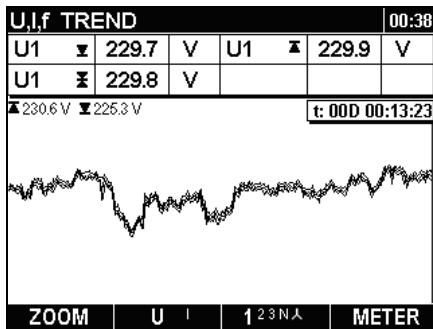


Figure 3.13: Voltage trend

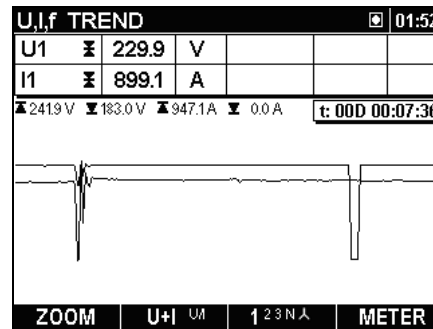


Figure 3.14: Voltage and current trend (single mode)

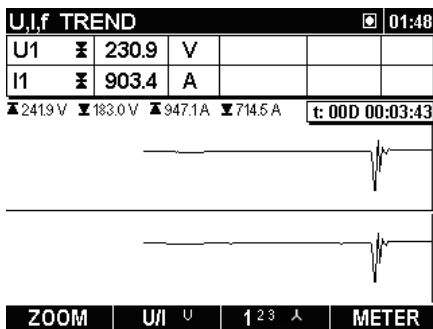


Figure 3.15: Voltage and current trend (dual mode)

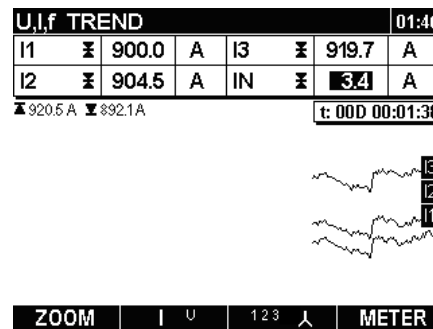


Figure 3.16: Trends of all currents

Table 3.7: Instrument screen symbols and abbreviations

	Current recorder status: RECORDER is active
	RECORDER is busy (retrieving data from memory).
	Current instrument time
Up, Upg	Maximal (▲), average (⊠) and minimal (▼) value of phase voltage

p: [1..3]	$U_{pRms}$ or line voltage $U_{pgRms}$ for last recorded time interval (IP)
Ip	Maximal (▲), average (⌘) and minimal (▼) value of current $I_{pRms}$ for last recorded time interval (IP)
p: [1..3]	
t: 00D 00:13:23	Current RECORDER time (Days hours:min.:sec.)
▲230.6V ▼225.3V	Maximal and minimal recorded voltage
▲947.1A ▼ 0.0A	Maximal and minimal recorded current

Table 3.8: Keys functions

F1	ZOOM+	Zoom in
	ZOOM+-	Zoom out
F2	U I	Select between the following options: Show voltage trend
	I U+	Show current trend
	U+I U+	Show voltage and current trend (single mode)
	U   U	Show voltage and current trend (dual mode)
F3	1 2 3 ↘	Select between phase, all-phases and view: Show trend for phase L1
	1 2 3 ↘	Show trend for phase L2
	1 2 3 ↘	Show trend for phase L3
	1 2 3 ↘	Summary of all phases trends
F4	METER	Switch to METER view.
	SCOPE	Switch to SCOPE view
	TREND	Switch to TREND view
ESC	Return to the “MEASUREMENTS” menu screen.	

**Frequency trend**

Frequency trend can be seen from METER screen by pressing function key F2.

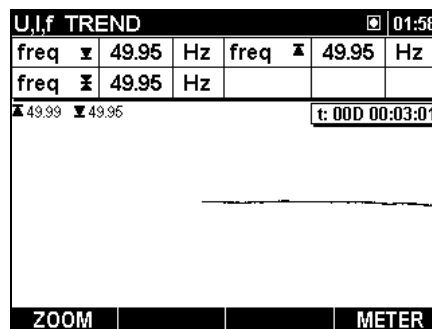


Figure 3.17: U, I, f frequency trend screen

Table 3.9: Instrument screen symbols and abbreviations

	Current recorder status: RECORDER is active
	RECORDER is busy (retrieving data from memory)
<b>20:45</b>	Current instrument time
f	Maximal ( $\overline{f}$ ), average ( $\overline{f}$ ) and minimal ( $\underline{f}$ ) value of frequency at synchronization channel for last recorded time interval (IP)
<b>t: 00D 00:13:23</b>	Current RECORDER time (Days hours:min.:sec.)
$\overline{f}$ 49.99 $\underline{f}$ 49.95	Maximal and minimal frequency on displayed graph

Table 3.10: Keys functions

	<b>ZOOM+</b> Zoom in <b>ZOOM+</b> Zoom out
	<b>METER</b> Return to METER view
	Return to the “MEASUREMENTS” menu screen.

### 3.3 Power menu

In POWER menu instrument show measured power parameters. Results can be seen in a tabular (METER) or a graphical form (TREND). TREND view is active only while RECORDER is active. See section 3.7 for instructions how to start recorder. In order to fully understand meanings of particular power parameter see sections 5.1.5 and 5.1.6.

#### 3.3.1 Meter

By entering POWER menu from Measurements menu the POWER – METER tabular screen is shown (see figure below). METER screen show power, voltage and current signatures.

POWER METER				
	L1	L2	L3	Total
P	10.75	10.92	-22.06	- 0.39 kW
Q	18.69	-18.72	0.67	0.64 kVAr
S	21.56	21.67	22.07	0.75 kVA
pf	+0.49i	+0.50c	-0.99c	-0.52c
dspf	+0.49i	+0.50c	-1.00c	
U	234.5	235.8	235.8	V
I	91.93	91.90	93.61	A

Figure 3.18: Power measurements summary

POWER METER			
	L1		
P	10.89 kW	pf	+0.50i
Q	18.85 kVAr	dspf	+0.49i
S	21.77 kVA	TAN	----
U		I	
RMS	235.8 V		92.33 A
THD	8.2 V		4.44 A
THD	3.4 %		4.8 %
CF	1.37		1.40

Figure 3.19: Detailed Power measurements at phase L1

Description of symbols and abbreviations used in METER screens are shown in table below.

Table 3.11: Instrument screen symbols and abbreviations








<b>L1 L2 L3</b> 	Show currently displayed channel.
	Current recorder status: RECORDER is active RECORDER is busy (retrieving data from memory) RECORDER is not active
<b>20:45</b>	Current instrument time
P, Q, S	Instantaneous active (P), reactive (Q) and apparent (S) power
PF, DPF	Instantaneous power factor (PF) and displacement power factor ( $\cos \varphi$ )
U	True effective value $U_{Rms}$
I	True effective value $I_{Rms}$
RMS	True effective value $U_{Rms}$ and $I_{Rms}$
THD	Total harmonic distortion $THD_U$ and $THD_I$
CF	Crest factor $Cf_U$ and $Cf_I$

Table 3.12: Keys functions

<b>F1</b>	Waveform snapshot:
<b>HOLD</b>	Hold measurement on display
<b>SAVE</b>	Save held measurement into memory
<b>F3</b>	Select between phase, all-phases and line view:
<b>1 2 3</b> 	Show measurements for phase L1
<b>1 2</b> 	Show measurements for phase L2
<b>1 2 3</b> 	Show measurements for phase L3
<b>1 2 3</b> 	Summary of all phases measurements
<b>1 2 3</b> 	Show phase-to-phase voltages measurements
<b>F4</b>	<b>METER</b> Switch to METER view (available only during recording)
	<b>TREND</b> Switch to TREND view (available only during recording)
<b>ESC</b>	Exit from "HOLD" screen without saving Return to the "MEASUREMENTS" menu screen.

### 3.3.2 Trend

During active recording TREND view is available (see section 3.7 for instructions how to start RECORDER).














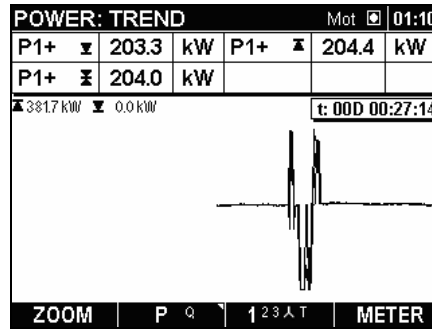











Figure 3.20: Power trend screen

Table 3.13: Instrument screen symbols and abbreviations

	Current recorder status RECORDER is active
	RECORDER is busy (retrieving data from memory)
	Show selected power mode: Consumed power data (+) are shown Generated power data (-) are shown
	Current instrument time
Pp±, Pt± p: [1..3]	Maximal (▲), average (⊠) and minimal (▼) value of consumed (P <sub>1</sub> <sup>+</sup> , P <sub>2</sub> <sup>+</sup> , P <sub>3</sub> <sup>+</sup> , P <sub>tot</sub> <sup>+</sup> ) or generated (P <sub>1</sub> <sup>-</sup> , P <sub>2</sub> <sup>-</sup> , P <sub>3</sub> <sup>-</sup> , P <sub>tot</sub> <sup>-</sup> ) active power for last recorded time interval (IP)
Qip±, Qit± p: [1..3]	Maximal (▲), average (⊠) and minimal (▼) value of consumed (Q <sub>i1</sub> <sup>+</sup> , Q <sub>i2</sub> <sup>+</sup> , Q <sub>i3</sub> <sup>+</sup> , Q <sub>itot</sub> <sup>+</sup> ) or generated (Q <sub>i1</sub> <sup>-</sup> , Q <sub>i2</sub> <sup>-</sup> , Q <sub>i3</sub> <sup>-</sup> , Q <sub>itot</sub> <sup>-</sup> ) reactive inductive power (Q <sub>i1</sub> <sup>±</sup> , Q <sub>i2</sub> <sup>±</sup> , Q <sub>i3</sub> <sup>±</sup> , Q <sub>itot</sub> <sup>±</sup> ) for last recorded time interval (IP)
Qcp±, Qct± p: [1..3]	Maximal (▲), average (⊠) and minimal (▼) value of consumed (Q <sub>c1</sub> <sup>+</sup> , Q <sub>c2</sub> <sup>+</sup> , Q <sub>c3</sub> <sup>+</sup> , Q <sub>ctot</sub> <sup>+</sup> ) or generated (Q <sub>c1</sub> <sup>-</sup> , Q <sub>c2</sub> <sup>-</sup> , Q <sub>c3</sub> <sup>-</sup> , Q <sub>ctot</sub> <sup>-</sup> ) reactive capacitive power (Q <sub>c1</sub> <sup>±</sup> , Q <sub>c2</sub> <sup>±</sup> , Q <sub>c3</sub> <sup>±</sup> , Q <sub>ctot</sub> <sup>±</sup> ) for last recorded time interval (IP)
Sp±, St± p: [1..3]	Maximal (▲), average (⊠) and minimal (▼) value of consumed apparent power (S <sub>1</sub> <sup>+</sup> , S <sub>2</sub> <sup>+</sup> , S <sub>3</sub> <sup>+</sup> , S <sub>tot</sub> <sup>+</sup> ) or generated apparent power (S <sub>1</sub> <sup>-</sup> , S <sub>2</sub> <sup>-</sup> , S <sub>3</sub> <sup>-</sup> , S <sub>tot</sub> <sup>-</sup> ) for last recorded time interval (IP)
PFip±, PFit± p: [1..3]	Maximal (▲), average (⊠) and minimal (▼) value of inductive power factor (1 <sup>st</sup> quadrant: PF <sub>i1</sub> <sup>+</sup> , PF <sub>i2</sub> <sup>+</sup> , PF <sub>i3</sub> <sup>+</sup> , PF <sub>itot</sub> <sup>+</sup> and 3 <sup>rd</sup> quadrant: PF <sub>i1</sub> <sup>-</sup> , PF <sub>i2</sub> <sup>-</sup> , PF <sub>i3</sub> <sup>-</sup> , PF <sub>itot</sub> <sup>-</sup> ) for last recorded time interval (IP)
PFcp±, PFt± p: [1..3]	Maximal (▲), average (⊠) and minimal (▼) value of capacitive power factor (4 <sup>th</sup> quadrant: PF <sub>c1</sub> <sup>+</sup> , PF <sub>c2</sub> <sup>+</sup> , PF <sub>c3</sub> <sup>+</sup> , PF <sub>ctot</sub> <sup>+</sup> and 2 <sup>nd</sup> quadrant: PF <sub>c1</sub> <sup>-</sup> , PF <sub>c2</sub> <sup>-</sup> , PF <sub>c3</sub> <sup>-</sup> , PF <sub>ctot</sub> <sup>-</sup> ) for last recorded time interval (IP)
	Current RECORDER time (Days hours:min.:sec.)
	Maximal and minimal recorded quantity

Table 3.14: Keys functions

	<b>ZOOM+</b> Zoom in <b>ZOOM+-</b> Zoom out
 Press & Hold	Toggle between consumed or generated power parameters view: 
	Select between trending various parameters:  Active power  Reactive inductive power  Reactive capacitive power  Apparent power  Inductive power factor  Capacitive power factor  Inductive displacement factor (cos $\varphi$ )  Capacitive displacement factor (cos $\varphi$ )
	Select between single phase, all-phases and total trend graph  Power parameters for phase L1  Power parameters for phase L2  Power parameters for phase L3  Power parameters L1, L2 and L3 on the same graph  Total power parameters
	<b>METER</b> Switch to METER view (available only during recording) <b>TREND</b> Switch to TREND view (available only during recording)
	Return to the “MEASUREMENTS” menu screen.

### 3.4 Energy menu

Instrument shows status of energy counters in energy menu. Results can be seen in a tabular (METER) form. For representing data in graph (TREND) form, download data to PC and use software PowerView v2.0. Energy measurement is active only if RECORDER is active. See section 3.7 for instructions how to start RECORDER. In order to fully understand meanings of particular energy parameter see section 5.1.7. The meter screens are shown on figures below.

ENERGY				11:27
TOTAL ENERGY				
	L1	L2	L3	
eP+	0181.14	0297.77	0300.83	kWh
eP-	0000.00	0000.00	0000.00	kWh
eQ+	0022.58	0000.00	0000.16	kVArh
eQ-	0011.39	0000.06	0000.06	kVArh
Start:	11:18:10	11.11.09		
Duration:	00 h 08 m 51 s			
		123人T	LST.IP	

ENERGY				11:38
TOTAL ENERGY				
eP+	000000362.768			kWh
eP-	000000000.000			kWh
eQ+	000000023.570			kVArh
eQ-	000000009.737			kVArh
Pt	5.370	MW	Qt	-0.327 M <sup>V</sup> Ar
Start:	11:34:20	11.11.09		
Duration:	00 h 04 m 05 s			
		123人T	LST.IP	

Figure 3.21: Energy counters screen

Table 3.15: Instrument screen symbols and abbreviations












Current recorder status:	
	RECORDER is active
	RECORDER is busy (retrieving data from memory)
	RECORDER is not active
	Current instrument time
eP+	Consumed phase (eP <sub>1</sub> <sup>+</sup> , eP <sub>2</sub> <sup>+</sup> , eP <sub>3</sub> <sup>+</sup> ) or total (eP <sub>tot</sub> <sup>+</sup> ) active energy
eP-	Generated phase (eP <sub>1</sub> <sup>-</sup> , eP <sub>2</sub> <sup>-</sup> , eP <sub>3</sub> <sup>-</sup> ) or total (eP <sub>tot</sub> <sup>-</sup> ) active energy
eQ+	Consumed phase (eQ <sub>1</sub> <sup>+</sup> , eQ <sub>2</sub> <sup>+</sup> , eQ <sub>3</sub> <sup>+</sup> ) or total (eQ <sub>tot</sub> <sup>+</sup> ) reactive energy <b>Note:</b> eQ+ is two quadrant measurement. For separate measurements (eQ <sub>i</sub> <sup>+</sup> , eQ <sub>c</sub> <sup>-</sup> ) download data to PC and use software PowerView v2.0 in order to observe results.
eQ-	Generated phase (eQ <sub>1</sub> <sup>-</sup> , eQ <sub>2</sub> <sup>-</sup> , eQ <sub>3</sub> <sup>-</sup> ) or total (eQ <sub>tot</sub> <sup>-</sup> ) reactive energy <b>Note:</b> eQ- is two quadrant measurement. For four quadrant measurement (eQ <sub>i</sub> <sup>-</sup> , eQ <sub>c</sub> <sup>+</sup> ) download data to PC and use software PowerView v2.0 in order to observe results.
Pp, Pt p: [1..3]	Instantaneous phase active power (P <sub>1</sub> , P <sub>2</sub> , P <sub>3</sub> ) or total P <sub>tot</sub> active power
Qp, Qt p: [1..3]	Instantaneous reactive power (Q <sub>1</sub> , Q <sub>2</sub> , Q <sub>3</sub> , Q <sub>tot</sub> ) or total Q <sub>tot</sub> reactive power
Start	Recorder start time and date
Duration	Current RECORDER time

Table 3.16: Keys functions

Select between single phase and total energy meter	
	 Energy parameters for phase L1
	 Energy parameters for phase L2
	 Energy parameters for phase L3
	 Summary for all phases energy
	 Energy parameters for Totals
Toggle between time interval:	
	

- LST.IP** Show energy registers for last interval
- CUR.IP** Show energy registers for current interval
- TOT EN** Show energy registers for whole record



Return to the “MEASUREMENTS” menu screen.

### 3.5 Harmonics menu

Harmonics presents voltage and current signals as a sum of sinusoids of power frequency and its integer multiples. Power frequency is called fundamental frequency. Sinusoidal wave with frequency k times higher than fundamental (k is an integer) is called harmonic wave and is denoted with amplitude and a phase shift (phase angle) to a fundamental frequency signal. See 5.1.8 for details.

#### 3.5.1 Meter

By entering HARMONICS menu from MEASUREMENTS menu the HARMONICS – METER tabular screen is shown (see figure below). In this screens voltage and current harmonics and THD are shown.

HARMON. METER							人	▶	11:41			
	U1		I1		U2		I2		U3		I3	
	V	A	V	A	V	A	V	A	V	A		
RMS	229.8	1769	230.2	1766	230.1	1768						
	V	A	V	A	V	A	V	A	V	A		
THD	2.1	15.9	2.1	14.6	2.1	15.7						
h 1	229.7	1768	230.1	1766	230.0	1768						
h 2	0.3	0.9	0.3	2.1	0.4	3.7						
h 3	0.2	1.5	0.3	1.4	0.4	2.0						
h 4	0.2	2.1	0.4	1.8	0.4	3.4						
	<b>HOLD</b>	<b>V-A</b>	<b>%</b>	<b>123</b>	<b>人</b>	<b>△</b>	<b>BAR</b>					

Figure 3.22: Harmonics meter table

Description of symbols and abbreviations used in METER screens are shown in table below.

Table 3.17: Instrument screen symbols and abbreviations

<b>L1</b> <b>L2</b> <b>L3</b>	
<b>L12</b> <b>L23</b> <b>L31</b>	Show currently displayed channel.
<b>人</b> <b>△</b>	
	Current recorder status:
	RECORDER is active
	RECORDER is busy (retrieving data from memory)
	RECORDER is not active
<b>20:45</b>	Current instrument time
RMS	True effective value $U_{Rms}$ and $I_{Rms}$
THD	Total harmonic distortion $THD_U$ and $THD_I$

hn n-th harmonic voltage  $U_{h_n}$  or current  $I_{h_n}$  component  
 n: 0..50

Table 3.18: Keys functions

<b>F1</b>	<b>HOLD</b>	Waveform snapshot: Hold measurement on display
	<b>SAVE</b>	Save held measurement into memory
<b>F2</b>	<b>% V-A</b>	Represent harmonics as % of first harmonic RMS value
	<b>V-A %</b>	Represent values in RMS quantities (Volts, Ampere)
<b>F3</b>	Select between single phase, all-phases and line harmonics view	
	<b>1 2 3</b> $\wedge$ $\Delta$	Harmonics components for phase L1
	<b>1 2 3</b> $\wedge$ $\Delta$	Harmonics components for phase L2
	<b>1 2 3</b> $\wedge$ $\Delta$	Harmonics components for phase L3
	<b>1 2 3</b> $\wedge$ $\Delta$	Summary of components on all phases
	<b>1 2 3</b> $\wedge$ $\Delta$	Harmonics components for phase-to-phase voltages
<b>F4</b>	<b>METER</b>	Switch to METER view
	<b>BAR</b>	Switch to BAR view
	<b>TREND</b>	Switch to TREND view (available only during recording)
<b>▲ ▼</b>	Shift through harmonic components	
<b>ESC</b>	Exit from "HOLD" screen without saving. Return to the "MEASUREMENTS" menu screen.	

### 3.5.2 Histogram (Bar)

Bar screen displays dual bar graphs. The upper bar graph shows voltage harmonics and the lower bar graph shows current harmonics.

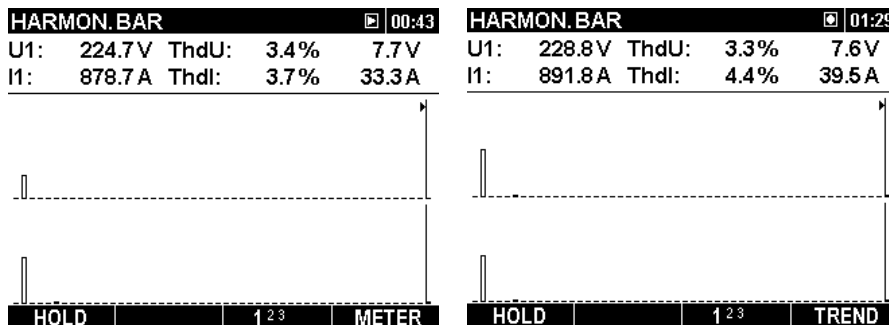


Figure 3.23: Harmonics histogram screens

Description of symbols and abbreviations used in BAR screens are shown in table below.

Table 3.19: Instrument screen symbols and abbreviations

	Current recorder status: RECORDER is active
	RECORDER is busy (saving data to memory)
	RECORDER is not active
	Current instrument time
	Show selected harmonic component
Up, Un p:1..3	True effective phase or line voltage $U_{Rms}$
Ip, In p:1..3	True effective phase current $I_{Rms}$
ThdU	Total voltage harmonic distortion $THD_U$
ThdI	Total current harmonic distortion $THD_I$
hn/ihn n: 0..50	n-th voltage or current harmonic component $U_{h_n}$ or $I_{h_n}$

Table 3.20: Keys functions

	Waveform snapshot: <b>HOLD</b> Hold measurement on display <b>SAVE</b> Save held measurement into memory
	Select between single phases and harmonics bars <b>1 2 3</b> Harmonics components for phase L1 <b>1 2 3</b> Harmonics components for phase L2 <b>1 2 3</b> Harmonics components for phase L3
	<b>METER</b> Switch to METER view <b>BAR</b> Switch to BAR view <b>TREND</b> Switch to TREND view (available only during recording)
	Toggle cursor between voltage and current histogram
	Scale displayed histogram by amplitude
	Scroll cursor to select single harmonic bar
	Exit from "HOLD" screen without saving. Return to the "MEASUREMENTS" menu screen.

### 3.5.3 Trend

During active RECORDER, TREND view is available (see section 3.7 for instructions how to start RECORDER). Voltage and current harmonics components can be observed by cycling function key F4 (METER-BAR-TREND).

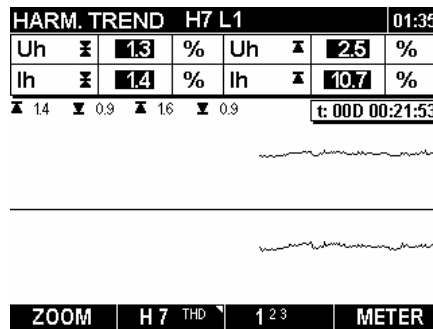


Figure 3.24: Harmonics trends screen

Table 3.21: Instrument screen symbols and abbreviations

	Current recorder status: RECORDER is active
	RECORDER is busy (retrieving data from memory)
<b>20:45</b>	Current instrument time
ThdU	Maximal (▲) and average (⊗) value of total voltage harmonic distortion THD <sub>U</sub> for selected phase
ThdI	Maximal (▲) and average (⊗) value of total current harmonic distortion THD <sub>I</sub> for selected phase
Uh	Maximal (▲) and average (⊗) value for selected n-th voltage harmonic component for selected phase
Ih	Maximal (▲) and average (⊗) value of selected n-th current harmonic component for selected phase
<b>t: 00D 00:13:23</b>	Current RECORDER time (Days hours:min.:sec.)
▲ 14V ▼ 0.9V	Maximal (▲) and minimal (▼) recorded quantity
▲ 16A ▼ 0.9A	

Table 3.22: Keys functions



**ZOOM+** Zoom in  
**ZOOM-** Zoom out

Select:

Max. 3 harmonics for observing trend

Harmonics units:















- % of first harmonics,
- absolute units (Volts/Ampere)



Press & Hold

SELECT HARMONICS								
1	2	3	4	5	6	7	8	9
10	11	12	13	14	15	16	17	18
19	20	21	22	23	24	25	26	27
28	29	30	31	32	33	34	35	36
37	38	39	40	41	42	43	44	45
46	47	48	49	50	%	V-A		

---

		Select between trending various parameters. By default these are:
		Total harmonic distortion for selected phase (THDU <sub>p</sub> )
		3 <sup>rd</sup> harmonics for selected phase (U <sub>p</sub> h <sub>3</sub> )
		5 <sup>th</sup> harmonics for selected phase (U <sub>p</sub> h <sub>5</sub> )
		7 <sup>th</sup> harmonics for selected phase (U <sub>p</sub> h <sub>7</sub> )
		Select between single phase, all-phases and line harmonics view
		Harmonics components for phase L1 (U <sub>1</sub> h <sub>n</sub> )
		Harmonics components for phase L2 (U <sub>2</sub> h <sub>n</sub> )
		Harmonics components for phase L3 (U <sub>3</sub> h <sub>n</sub> )
		Switch to METER view
		Switch to BAR view
		Switch to TREND view (available only during recording)
		Return to the “MEASUREMENTS” menu screen.






---

### Selection of harmonics for observing trend

Max. 3 harmonics can be selected. Press and hold F2 key in TREND screen and a spreadsheet for selection will open. Note that only recorded harmonics can be selected. For setting recording parameters see section 3.7

Table 3.23: Keys functions

---

		Select or deselect harmonics in a spreadsheet
		Cursor keys (for moving trough a spreadsheet)
		Confirms selection of harmonics for observing trend.
		Cancel selection of harmonics for observing trend without changes.

---



## 3.6 Phase Diagram

Phase diagram graphically represent fundamental voltages, currents and phase angles of the network. This view is strongly recommended for checking instrument connection before measurement. Note that most measurement issues arise from wrongly connected instrument (see 4.1 for recommended measuring practice). On phase diagram instrument shows:

- Graphical presentation of voltage and current phase vectors of the measured system,
- Unbalance of the measured system.

### 3.6.1 Phase diagram

By entering PHASE DIAGRAM menu from MEASUREMENTS menu following screen is shown (see figure below).

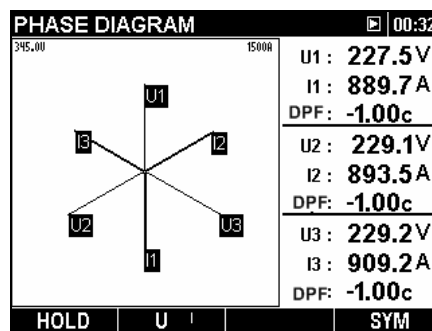












Figure 3.25: Phase diagram screen.

Table 3.24: Instrument screen symbols and abbreviations

	Current recorder status: RECORDER is active
	RECORDER is busy (retrieving data from memory)
	RECORDER is not active
<b>20:45</b>	Current instrument time
U1, U2, U3	Fundamental voltages $U_{1Fnd}$ , $U_{2Fnd}$ , $U_{3Fnd}$
I1, I2, I3	Fundamental currents $I_{1Fnd}$ , $I_{2Fnd}$ , $I_{3Fnd}$
DPF	Displacement factor ( $\cos \phi$ ) for particular phase: $DPF_1$ , $DPF_2$ , $DPF_3$
345.00	Indicate current and voltage scaling.
1500A	Value represents current or voltage value at the top of the graph (top horizontal line).

Table 3.25: Keys function

	Waveform snapshot:
<b>HOLD</b>	Hold measurement on display
<b>SAVE</b>	Save held measurement into memory

		Selects voltage for scaling (with cursors)
		Selects current for scaling (with cursors)
		Switch to phase diagram
		Switch to symmetry diagram
		Switch to TREND view (available only during recording)
		Show details about the selected event.
		Scale displayed diagram by amplitude.
		Exit from "HOLD" screen without saving. Back to the "MEASUREMENTS" menu.

### 3.6.2 Symmetry diagram

Symmetry diagram represent current and voltage symmetry or unbalance of the measuring system. Unbalance arises when RMS values or phase angles between consecutive phases are not equal. Diagram is shown on figure bellow.










Figure 3.26: Symmetry diagram screen

Table 3.26: Instrument screen symbols and abbreviations

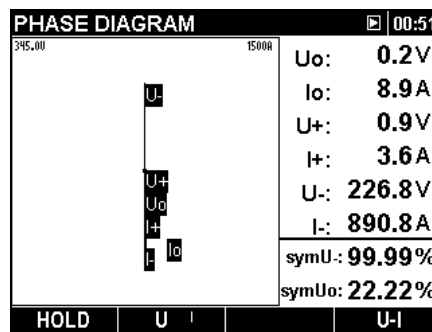	Current recorder status: RECORDER is active
	RECORDER is busy (retrieving data from memory)
	RECORDER is not active
	Current instrument time
U <sub>0</sub>	Zero sequence voltage component U <sup>0</sup>
I <sub>0</sub>	Zero sequence current component I <sup>0</sup>
U <sub>+</sub>	Positive sequence voltage component U <sup>+</sup>
I <sub>+</sub>	Positive sequence current component I <sup>+</sup>
U <sub>-</sub>	Negative sequence voltage component U <sup>-</sup>
I <sub>-</sub>	Negative sequence current component I <sup>-</sup>
symU <sub>-</sub>	Negative sequence voltage ratio u <sup>-</sup>

symI-	Negative sequence current ratio $i^-$
symU+	Zero sequence voltage ratio $u^0$
symI-	Zero sequence current ratio $i^0$
345.00 1500A	Indicate current and voltage scaling. Value represents current or voltage value at the top of the graph (top horizontal line).

Table 3.27: Keys function

<b>F1</b>	Waveform snapshot:
<b>HOLD</b>	• Hold measurement on display
<b>SAVE</b>	• Save held measurement into memory
<b>F2</b>	Toggle $u^-/u^0$ voltages and select voltage for scaling (with cursors)
	Toggle $i^-/i^0$ currents and select currents for scaling (with cursors)
<b>F4</b>	Switch to phase diagram
	Switch to symmetry diagram
	Switch to TREND view (available only during recording)
 	Scale displayed diagram by amplitude.
<b>ESC</b>	Back to the “MEASUREMENTS” menu.

### 3.6.3 Symmetry trend

During active recording SYMETRY TREND view is available (see section 3.7 for instructions how to start RECORDER).

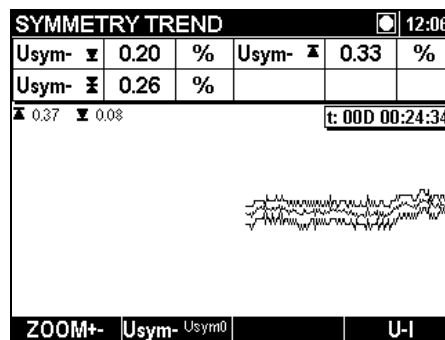




Figure 3.27: Symmetry trend screen

Table 3.28: Instrument screen symbols and abbreviations

	Current recorder status:
	RECORDER is active
	RECORDER is busy (retrieving data from memory)
<b>20:45</b>	Current instrument time
Usym-	Maximal (▲), average (▣) and minimal (▾) value of negative sequence

	voltage ratio u- for last recorded time interval (IP)
Usym0	Maximal (▲), average (⚡) and minimal (▼) value of zero sequence voltage ratio $u^0$ for last recorded time interval (IP)
Isym-	Maximal (▲), average (⚡) and minimal (▼) value of negative sequence current ratio i- for last recorded time interval (IP)
Isym0	Maximal (▲), average (⚡) and minimal (▼) value of zero sequence current ratio $i^0$ for last recorded time interval (IP)
t: 00D 00:13:23	Current RECORDER time (Days hours:min.:sec.)
▲0.578 ▼0.495	Maximal (▲) and minimal (▼) recorded quantity

Table 3.29: Keys functions

F1	ZOOM+	Zoom in
	ZOOM+-	Zoom out
F2	Usym- Usym0	Negative sequence voltage ratio view
	Usym0 Isym-	Zero sequence voltage ratio view
	Isym- Isym0	Negative sequence current ratio view
	Isym0 Usym-	Zero sequence current ratio view
F4	U-I	Switch to phase diagram
	SYM	Switch to symmetry diagram
	TREND	Switch to TREND view (available only during recording)
ESC	Back to the “MEASUREMENTS” menu screen.	

### 3.7 General Recorder

PowerQ / PowerQ Plus has ability to record measured data in the background. In RECORDER menu user can customize recorder parameters in order to meet his criteria about type, duration, and the number of signals for the recording campaign. By entering “RECORDER” menu, following screen is shown:



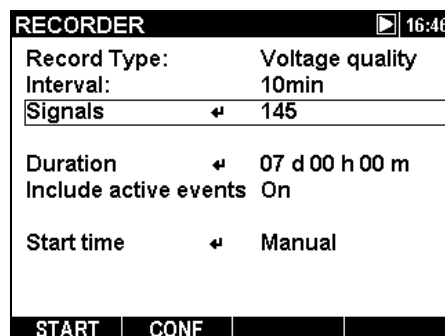



Figure 3.28: Basic recorder setup screen



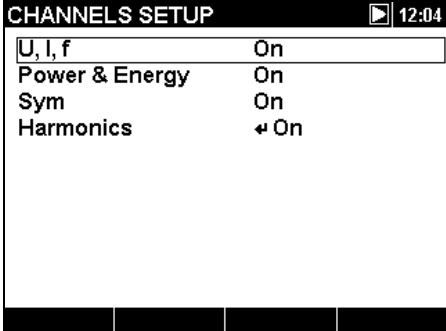

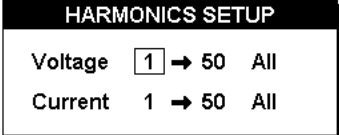


In following table description of recorder settings is given:

Table 3.30: Recorder settings description

<p><b>Record Type</b></p>	<p>Select type of recording. Following options are available and can be set by using configuration menu:</p> <ul style="list-style-type: none"> <li>Record (user defined)</li> <li>Voltage quality (according to EN 50160)</li> </ul>
<p><b>Interval</b></p>	<p>Select recorder aggregation interval. For each time interval minimal, average and maximal value will be recorded (for each signal). The smaller the interval is, more measurements will be used for the same record duration.</p> <p><b>Note:</b> The instrument automatically changes the duration in case there is not enough memory for the desired interval and duration.</p> <p><b>Note:</b> EN 50160 record type stores only average values per interval.</p>
<p><b>Signals</b></p>	<p>Select signals to record. See 4.3 for detail channel list.</p>  <ul style="list-style-type: none"> <li>U, I, f – select voltage, current and freq. parameters for recording.</li> <li>Power &amp; Energy – select power and energy parameters for recording.</li> <li>Sym – select unbalance parameters for recording.</li> <li>Harmonics – select which voltage and current harmonics you want to include in the record.</li> </ul>  <p>User can choose:</p> <ul style="list-style-type: none"> <li>○ First and last voltage and current harmonic to record;</li> <li>○ Select even, odd or all harmonics components for recording.</li> </ul>
<p><b>Duration</b></p>	<p>Select the duration of the record.</p> 

	<b>Note:</b> If the set duration time is longer than memory allows it, it will be automatically shortened.
<b>Include active events</b>	Select whether you want to include active events in record.
<b>Start time</b>	<p>Define start time of recording:</p> <ul style="list-style-type: none"> <li>Manual, pressing function key F1</li> <li>Add predefined start time, when recorder should start</li> </ul> <div style="border: 1px solid black; padding: 5px; width: fit-content; margin: 10px auto;"> <p style="text-align: center; margin: 0;"><b>SET START TIME</b></p> <p style="text-align: center; margin: 0;">01:03:00</p> <p style="text-align: center; margin: 0;">01.01.00</p> </div>

Table 3.31: Keys functions

	<b>START</b> <b>STOP</b>	<p>Start the recorder</p> <p>Stop the recorder</p>
		<p>Open configuration sub menu.</p> <div style="border: 1px solid black; padding: 5px; width: fit-content; margin: 10px auto;"> <p style="text-align: center; margin: 0;"><b>CONFIGURATION MENU</b></p> <p style="margin: 0;">EN50160</p> <p style="background-color: black; color: white; margin: 0;">Configuration 1</p> <p style="margin: 0;">Configuration 2</p> <p style="margin: 0;">Default configuration</p> </div> <p>Possible options are:</p> <ul style="list-style-type: none"> <li>“EN50160” – predefined configuration for EN 50160 survey.</li> <li>Configuration 1 - user defined configuration.</li> <li>Configuration 2 - user defined configuration.</li> <li>“Default configuration” – factory defaults.</li> </ul>
	<b>CONF</b>	<p><b>Note:</b> EN 50160 configuration records only average values for defined time period.</p> <p><b>Note:</b> EN 50160 by default records voltage parameters only. Current, power and other dependent quantities are not recorded nor shown in trend graphs by default. Using SIGNALS menu user can add power or currents channels and perform EN 50160 and power measurement simultaneously.</p>
	<b>LOAD</b>	Load the selected configuration (active in configuration sub menu).
	<b>SAVE</b>	Save the changes to the selected configuration (active in configuration sub menu).
		Enter the selected submenu.
		Select parameter / change value.
		Select parameter / change value.



Back to the previous menu.

### 3.1 Inrush / Fast recorder<sup>1</sup>

High inrush currents of motors can cause breakers to trip or fuses to open. Maximum expected current during the inrush might be 6 to 14 times greater than the full load current of the motor.

This function is based on a principle of logging data exceeding the set (trigger) level with positive, negative or both slopes on a current or voltage input.

When trigger occurs, data capturing begins. Instrument record until **Duration** time has been reached. According to the **Pretrigger length** parameter, instrument also record data before trigger has occurred.

#### 3.1.1 Setup

By selecting the “INRUSH/FAST RECORDER” from the “RECORDERS” menu screen the “INRUSH Recorder Setup” screen is shown (see figure below).

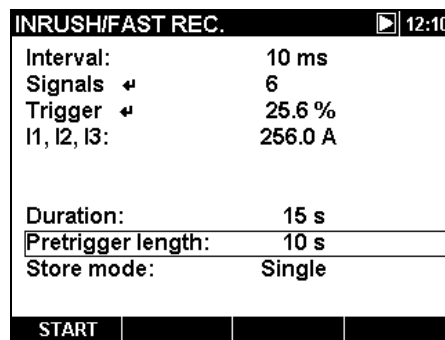


Figure 3.29: Inrush recorder setup screen







Table 3.32: Instrument screen symbols and abbreviations

<b>Interval</b>	Logging interval setup (from 10 ms to 200 ms).									
<b>Signals</b>	Select logging signals: <div style="text-align: center;"> <table border="1"> <tr> <th colspan="3">SIGNALS</th> </tr> <tr> <td>U1</td> <td>U2</td> <td>U3</td> </tr> <tr> <td>I1</td> <td>I2</td> <td>I3</td> </tr> </table> </div>	SIGNALS			U1	U2	U3	I1	I2	I3
SIGNALS										
U1	U2	U3								
I1	I2	I3								
<b>Trigger</b>	Trigger set up: <ul style="list-style-type: none"> <li>• Current input for trigger source</li> <li>• Trigger level at which inrush logging will start</li> <li>• Trigger slope direction (FALL, RISE, BOTH).</li> </ul>									

<sup>1</sup> PowerQ Plus only

	<div style="display: flex; justify-content: space-around;"> <div style="border: 1px solid black; padding: 5px; width: 45%;"> <p style="text-align: center; margin: 0;"><b>TRIGGER</b></p> <div style="display: flex; justify-content: space-around; margin-bottom: 5px;"> <span style="border: 1px solid black; padding: 2px;">I1</span> <span style="border: 1px solid black; padding: 2px;">I2</span> <span style="border: 1px solid black; padding: 2px;">I3</span> </div> <p style="font-size: small; margin: 0;">Level: 25.6 % I1, I2, I3: 256.0 A</p> <p style="font-size: small; margin: 0;">Slope: FALL</p> </div> <div style="border: 1px solid black; padding: 5px; width: 45%;"> <p style="text-align: center; margin: 0;"><b>TRIGGER</b></p> <div style="display: flex; justify-content: space-around; margin-bottom: 5px;"> <span style="border: 1px solid black; padding: 2px;">U1</span> <span style="border: 1px solid black; padding: 2px;">U2</span> <span style="border: 1px solid black; padding: 2px;">U3</span> </div> <p style="font-size: small; margin: 0;">Level: 27.8 % U1, U2, U3: 278.0 V</p> <p style="font-size: small; margin: 0;">Slope: FALL</p> </div> </div>
<b>Duration</b>	Total logging time in seconds.
<b>Pretrigger length</b>	Adjusting length of the logging part prior to trigger condition occurrence.
<b>Store mode</b>	Store mode setup: <ul style="list-style-type: none"> <li><b>Single</b> – single inrush logging;</li> <li><b>Continuous</b> – consecutive inrush logging until user stop or instrument runs out of storage memory. Every consecutive inrush logging will be treated as a separate record.</li> </ul>

Table 3.33: Keys functions

	<b>START</b> <b>U I</b> <b>I U</b>	Start the inrush logger. Toggle between voltage and current trigger signal selection (Only in “Trigger” dialog window). <b>Note:</b> If user forces inrush logging to stop no data is recorded. Logging of data only occurs when trigger is activated.
	<b>SET</b>	Toggle between ON (selected) and OFF (deselected) for recording in SIGNAL dialog. Toggle between ON (selected) and OFF (deselected) for triggering in TRIGGER dialog.
		Select “Interval”, “Signals”, “Trigger”, “Duration”, “Pretrigger length or “Store mode” on the “INRUSH LOGGER” setup screen. If in “Signals” dialog, scroll between voltage and current values. If in “Trigger” dialog, scroll between trigger source, trigger level and trigger slope.
		If “Interval” is selected, change interval period. If “Signals” dialog is open, scroll through all channels. If “Trigger” dialog is open, scroll through trigger sources / change trigger level / change trigger slope.
		Open SIGNALS dialog box (if “Signals” is selected). In this dialog box the individual signals can be selected for logging. Open TRIGGER dialog box (if “Trigger” is selected). In this dialog box the trigger channels can be selected, level and slope of the trigger signal can be defined for triggering.
		Return to the “RECORDERS” menu screen or close the “Signals” or “Trigger” dialog box (if dialog box is open).

### 3.1.2 Capturing inrush

Following screen opens when a user starts the inrush logger.



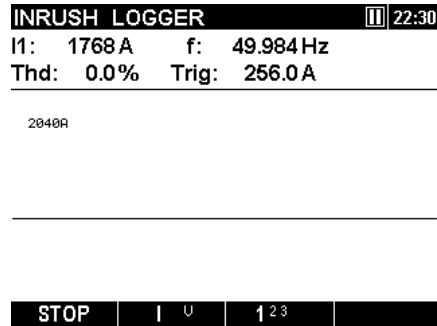


Figure 3.30: Inrush logger capture screen

Table 3.34: Instrument screen symbols and abbreviations

	Current recorder status:
	<ul style="list-style-type: none"> <li>Instrument is waiting (trigger conditions are not met);</li> <li>Instrument is recording (beep indicates that trigger limit has been reached).</li> </ul>
<b>20:45</b>	Current instrument time.
U1..U3	True effective voltage value $U_{Rms(10)}$ .
I1..I3	True effective current value $U_{Rms(10)}$ .
Thd	Total harmonic distortion $THD_U$ or $THD_I$ .
f	Frequency on reference channel.
Trig	Settled trigger value.
230.4 V 2040 A	Represent current (voltage) value at the top of the graph (horizontal line between graph and table values).

Table 3.35: Keys function

	<b>STOP</b>	Stop the inrush logger. <b>Note:</b> If user forces inrush logging to stop no data is recorded. Logging of data only occurs when trigger is activated.
	<b>U I</b> <b>I U</b>	Toggle between voltage and current channel. Show $U_{rms(1/2)}$ voltage trend graph. Show $I_{1/2Rms}$ current trend graph.
	<b>1 2 3</b> <b>1 2 3</b> <b>1 2 3</b>	Select between phases. Show graph and parameters for phase L1. Show graph and parameters for phase L2. Show graph and parameters for phase L3.
		Return to the “RECORDERS” menu screen.

### 3.1.3 Captured inrush

Captured inrush can be viewed from the Memory list menu. The recorded signal trace can be scrolled through and reviewed with a cursor. Data are displayed in graphical (logger histogram) and in numeric (interval data) form. The following values can be displayed in the data fields:

- Minimum, maximum and average data of the interval selected with the cursor,
- Time relative to the trigger-event time.

Complete trace of selected signal can be viewed on the histogram. The cursor is positioned to the selected interval and can be scrolled over all intervals. All results are saved to the instrument memory. Signals are auto scaled.

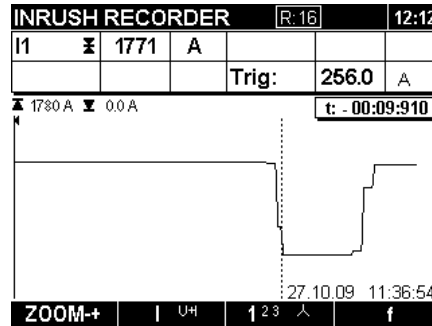






Figure 3.31: Captured inrush

Table 3.36: Instrument screen symbols and abbreviations

	Instrument loading data from memory.
	Show record number in MEMORY LIST.
	Current instrument time.
	Indicate position of the cursor at the graph.
U1..U3	True effective voltage value $U_{Rms(10)}$ at cursor point.
I1..I3	True effective current value $I_{Rms(10)}$ at cursor point.
Trig	Settled trigger value.
	Maximal and minimal (current/voltage) value on graph.
01.01.00 00:46:31	Date and time at the current cursor position.
	Time relative to the trigger event occurrence.

Table 3.37: Keys function

		Zoom in.
		Zoom out.
		Toggle between voltage and current channel: Show $U_{rms(1/2)}$ voltage trend graph;
		Show $I_{1/2Rms}$ current trend graph;
		Show voltage $U_{rms(1/2)}$ and current $I_{1/2Rms}$ trend in single graph;
		Show voltage $U_{rms(1/2)}$ and current $I_{1/2Rms}$ trend in two separate graphs.
		Select between phase, all-phases and view:
		Show trend for phase L1
		Show trend for phase L2
		Show trend for phase L3
		Summary of all phases trends

	<b>f</b>	Show frequency trend.
	<b>TREND</b>	Show voltage/current trend
		Select between scopes.
		Scroll the cursor along logged data.
		Return to the “INRUSH LOGGER” setup screen.

### 3.2 Events table<sup>1</sup>

In this table captured voltage dips, swells and interrupts are shown. Note that events appear in the table after finishing, when voltage return to the normal value. All events can be grouped or separated by phase. This is toggled by pressing function key F1.

#### Group view

In this view voltage event are grouped according to IEC 61000-4-30 (see section 5.1.10 for details). Table where events are summarized is shown bellow. Each line in table represents one event, described by event number, event start time and duration and level. Additionally in colon “T” event characteristics are shown (see table bellow for details).

VOLTAGE EVENTS					01:48
Date: 01.01.00					
No:	L Start:	T	Level:	Duration:	
600	00:00:03:539	IDS	233.9V	1.856 hrs	
583	00:00:03:532	IDS	231.9V	14.833 min	
556	00:00:03:537	S	233.8V	53.158 sec	
542	00:00:03:553	S	235.2V	3.129 hrs	
520	00:24:47:589	S	274.8V	3.530 sec	
516	00:24:03:056	ID	1.4V	43.543 sec	
509	00:23:02:225	ID	0.3V	1.300 sec	
$\Sigma$ PH				STAT	

Figure 3.32: Voltage events in group view screen

By pressing “Enter” on particular events we can examine its details. Event is split on phase events sorted by start time. Colon “T” shows transition from one event state to another (see table bellow for details).

<sup>1</sup> PowerQ Plus only

VOLTAGE EVENTS				
Date: 01.01.00				
No:	L	Start:	T	Level: Duration:
553	1	00:00:03:537	N->S	232.4V 53.158 sec
554	2	00:00:03:537	N->S	233.8V 3.129 hrs
555	3	00:00:03:537	N->S	233.7V 3.530 sec

Figure 3.33: Voltage events group view screen

Table 3.38: Instrument screen symbols and abbreviations









	Current recorder status: RECORDER is active
	RECORDER is busy (retrieving data from memory)
	RECORDER is not active
Date	Date when selected event has occurred
No.	Unified event number (ID)
L	Indicate phase or phase-to-phase voltage where event has occurred: 1 – event on phase $U_1$ 2 – event on phase $U_2$ 3 – event on phase $U_3$ 12 – event on voltage $U_{12}$ 23 – event on voltage $U_{23}$ 31 – event on voltage $U_{31}$ <b>Note:</b> this indication is shown only in event details, since one grouped event can have many phase events.
Start	Event start time (when first $U_{Rms(1/2)}$ ) value cross threshold.
T	Indicates type of event or transition: D – Dip I – Interrupt S – Swell N → D Transition from normal state to dip N → S Transition from normal state to swell D → I Transition from dip to interrupt
Level	Minimal or maximal value in event $U_{Dip}$ , $U_{Int}$ , $U_{Swell}$
Duration	Event duration.

Table 3.39: Keys functions

		Group view is shown. Press to switch on “PHASE” view.
		Phase view is shown. Press to switch on “GROUP” view.
		Show event summary (by types and phases):

VOLTAGE EVENTS				01:11
	L1	L2	L3	
U	226.6	227.7	228.4V	
EVENTS				
Swell:	6	5	7	
Dip:	3	1	2	
Inter.:	0	0	0	
Start:	17:17:14	01.01.08		
Curr.:	01:11:12	03.02.08		

**EVENTS** Back to Group view.

Show details about the selected event.



VOLTAGE EVENTS					01:48
Date: 01.01.00					
No:	L	Start:	T	Level:	Duration:
553	1	00:00:03:537	N->S	232.4V	53.158 sec
554	2	00:00:03:537	N->S	233.8V	3.129 hrs
555	3	00:00:03:537	N->S	233.7V	3.530 sec



Select event.



Exit from detailed view of an event.

Back to the "RECORDERS" menu screen.

### Phase view

In this view voltage events are separated by phases. This is convenient view for troubleshooting. Additionally user can use filters in order to observe only particular type of event on a specific phase. Captured events are shown in a table, where each line contains one phase event. Each event has an event number, event start time, duration and level. Additionally in colon "T" type of event is shown (see table below for details).

VOLTAGE EVENTS					01:05
Date: 01.01.00					
No:	L	Start:	T	Level:	Duration:
599	3	00:00:23:845	S	232.5V	-- -- --
595	2	00:00:03:539	S	233.9V	-- -- --
594	1	00:00:03:539	S	232.3V	-- -- --
598	3	00:00:22:165	D	37.4V	1.680 sec
597	3	00:00:22:165	I	0.3V	1.670 sec
596	3	00:00:03:539	S	229.6V	18.626 sec
571	3	00:00:40:595	S	231.4V	-- -- --
568	2	00:00:03:532	S	231.9V	-- -- --
582	1	00:00:45:037	S	229.7V	-- -- --
573	1	00:00:43:456	D	11.8V	1.581 sec
PH	Σ	Σ	DIP	1 2 3 Σ	STAT

Figure 3.34: Voltage events screens

You can also see details of each individual voltage event and statistics of all events. Statistics show count registers for each individual event type by phase.

Table 3.40: Instrument screen symbols and abbreviations

















	Current recorder status RECORDER is active
	RECORDER is busy (retrieving data from memory)
	RECORDER is not active
Date	Date when selected event has occurred
No.	Unified event number (ID)
L	Indicate phase or phase-to-phase voltage where event has occurred: 1 – event on phase $U_1$ 2 – event on phase $U_2$ 3 – event on phase $U_3$ 12 – event on voltage $U_{12}$ 23 – event on voltage $U_{23}$ 31 – event on voltage $U_{31}$
Start	Event start time (when first $U_{Rms(1/2)}$ value cross threshold.
T	Indicates type of event or transition: D – Dip I – Interrupt S – Swell
Level	Minimal or maximal value in event $U_{Dip}$ , $U_{Int}$ , $U_{Swell}$
Duration	Event duration.

Table 3.41: Keys function

		Group view is shown. Press to switch on “PHASE” view.
		Phase view is shown. Press to switch on “GROUP” view.
	Filter events by type:	
		Show all events
		Show dips only
		Show interrupts only
		Show swells only
	Filter events by phase:	
		Show only events on phase 1
		Show only events on phase 2
		Show only events on phase 3
		Show all events

**STAT** Show event summary (by types and phases):



VOLTAGE EVENTS				01:11
	L1	L2	L3	
U	226.6	227.7	228.4V	
EVENTS				
Swell:	6	5	7	
Dip:	3	1	2	
Inter.:	0	0	0	
Start:	17:17:14	03.02.38		
Curr.:	01:11:12	01.01.00		

**EVENTS** Back to Group view.

Show details about the selected event:



VOLTAGE EVENTS				01:06
Dip:				
Min:	L3		37.4V	
Start:		00:00:22:165		01.01.00
End:		00:00:23:845		01.01.00
Duration:		00:00:00:01:680		



Select event.



Exit from detailed view of an event.  
Back to the "RECORDER" menu screen.

### 3.3 Memory List

Using this menu user can view and browse through saved records. By entering this menu, information about last record is shown.

MEMORY LIST				00:19
Record No:				7
Type:			Inrush logging	
Signals:				6
Start:		01:47:13		01.01.00
End:		01:47:16		01.01.00
Size (kB):				4
Saved Records:				7
CLEAR				

Figure 3.35: Memory list screen

Table 3.42: Instrument screen symbols and abbreviations

	Current recorder status
	RECORDER is active
	RECORDER is busy (retrieving data from memory)








	RECORDER is not active
	Current instrument time
<b>Record No</b>	Selected record number, for which details are shown.
<b>Type</b>	Indicate type of record, which can be one of following: <ul style="list-style-type: none"> <li>• inrush logging,</li> <li>• waveform snapshot,</li> <li>• general recording.</li> </ul>
<b>Signals</b>	Number of recorded signals.
<b>Start</b>	Record start time.
<b>End</b>	Record stop time.
<b>Size (kB)</b>	Record size in kilobytes (kB).
<b>Saved records</b>	Total number of records in memory.

Table 3.43: Keys functions

	<b>VIEW</b>	View details of currently selected record.
	<b>CLEAR</b>	Clear the last record. In order to clear complete memory, delete records one by one.
	<b>CLRALL</b>	Clear all saved records.
		Browse through records (next or previous record).
		Returns to the “RECORDERS” menu screen.


### 3.3.1 Record

This type of record is made by RECORDER. Record front page is similar to the RECORDER menu, as shown on figure below.

RECORDER		R:10	18:23
Record Type:	Record		
Interval:	1s		
Signals	173		
Duration	00 h 05 m 12 s		
Include active events	0		
Start time	18:13:10 26.10.09		
VIEW			

Figure 3.36: Front page of Record in MEMORY LIST menu

Table 3.44: Recorder settings description


	Current instrument time.
---	--------------------------




<b>R:10</b>	Show record number in MEMORY LIST.
<b>Record type: RECORD</b>	Indicator that record type is made by GENERAL RECORDER.
<b>Interval: 1s</b>	Show interval used for GENERAL RECORDER.
<b>Signals: 173 (max, min, avg)</b>	Show number of signals in record.
<b>Memory type: Linear</b>	Show how memory is organized.
<b>Duration: 00h 05m 12s</b>	Show duration of record.
<b>Include active events: 0</b>	Show number of captured voltage events.
<b>Start time</b>	Show record start time.


Table 3.45: Keys function


Switch to the CHANNELS SETUP menu screen.

User can observe particular signal group by pressing on  key (VIEW).

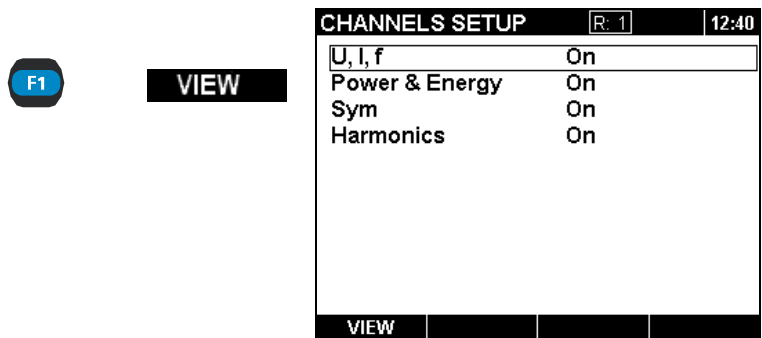

  Select parameter (only in CHANNELS SETUP menu).

 Back to the previous menu.

By pressing  **VIEW** in CHANNELS SETUP menu TREND screen will appear. TREND type depends on the position of a cursor. Typical screen is shown on figure bellow.

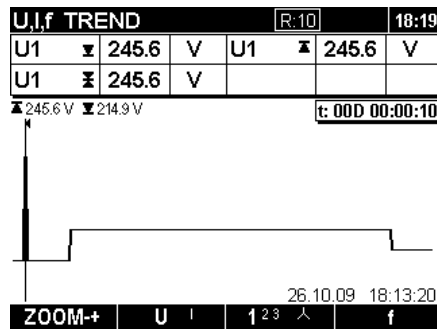


Figure 3.37: Viewing recorder U,I,f TREND data

Table 3.46: Instrument screen symbols and abbreviations

<b>R:8</b>	Show record number in MEMORY LIST.
<b>20:45</b>	Current instrument time.
<b>⌋</b>	Indicate position of the cursor at the graph.
Up, Upg:	Maximal ( <b>▲</b> ), average ( <b>⊠</b> ) and minimal ( <b>▼</b> ) recorded value of phase voltage $U_{pRms}$ or line voltage $U_{pgRms}$ for time interval selected by cursor.
Ip:	Maximal ( <b>▲</b> ), average ( <b>⊠</b> ) and minimal ( <b>▼</b> ) recorded value of current $I_{pRms}$ for time interval selected by cursor.
<b>t: 00D 00:13:23</b>	Time position of cursor regarding to the record start time.
<b>▲230.6 V ▼225.3 V</b>	Maximal and minimal Up/Upg on displayed graph;
<b>▲947.1A ▼ 0.0 A</b>	Maximal and minimal Ip on displayed graph.
26.10.09 18:13:20	Time clock at position of cursor.

Table 3.47: Keys functions

<b>F1</b>	<b>ZOOM+</b> <b>ZOOM-</b>	Zoom in. Zoom out.
<b>F2</b>	<b>U I</b> <b>I U+I</b> <b>U+I U+I</b> <b>U/I U</b>	Select between the following options: Show voltage trend; Show current trend; Show voltage and current trend in single graph; Show voltage and current trend in two separate graphs.
<b>F3</b>	<b>1 2 3 ↘</b> <b>1 2 3 ↘</b> <b>1 2 3 ↘</b> <b>1 2 3 ↘</b>	Select between phase, all-phases and view: Show trend for phase L1 Show trend for phase L2 Show trend for phase L3 Summary of all phases trends
<b>F4</b>	<b>f</b>	Show frequency trend.



Select which waveform to zoom (only in U/I or U+I trends).



Scroll the cursor  $\uparrow$  along logged data.



Return to the “CHANNELS SETUP” menu screen.

**Note:** Other recorded data (power, harmonics, etc.) has similar manipulation principle as described in table above.

### 3.3.2 Waveform snapshot

This type of record can be made by using Hold → Save procedure. Its front page is similar to the screen where it was recorded, as shown on figure below.

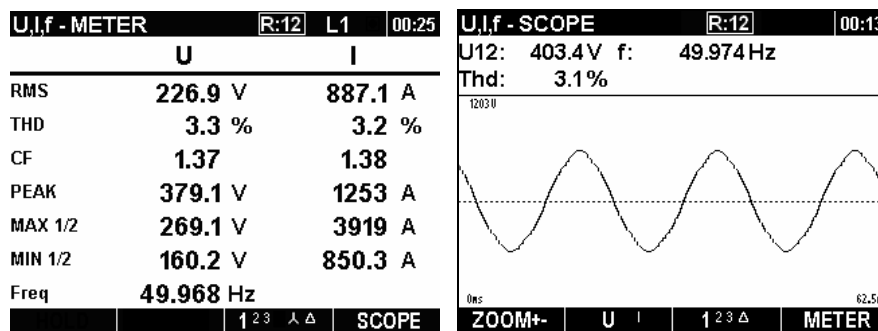


Figure 3.38: Front page of Normal record in MEMORY LIST menu

For screen symbols and key functions see corresponding METER, SCOPE, BAR graph, PHASE DIAG. description given in appropriate sections (U, I, f; Power, etc..).

### 3.3.3 Inrush/Fast logger

This type of record is made by Inrush logger. For details regarding manipulation and data observing see section 3.1.3.

## 3.4 Measurement Setup menu

From the “MEASUREMENT SETUP” menu measurement parameters can be reviewed, configured and saved.

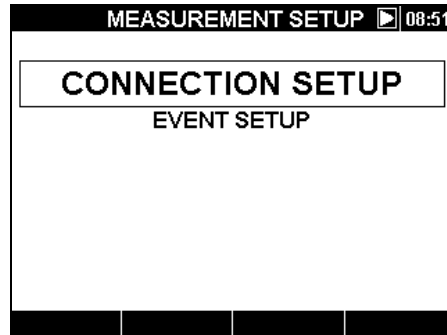





Figure 3.39: MEASUREMENT SETUP menu

Table 3.48: Description of setup options

<b>Connection setup</b>	Setup measurement parameters.
<b>Event setup</b>	Setup event parameters.

Table 3.49: Keys function

	Select function from the “SETUP” menu.
	Enter the selected item.
	Back to the “MAIN MENU” screen.

### 3.4.1 Connection setup

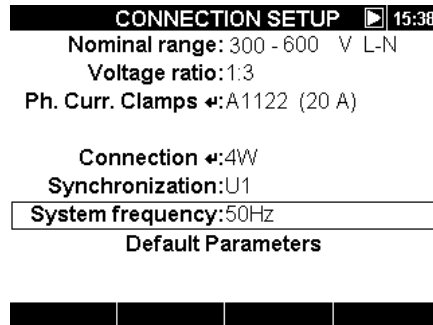


Figure 3.40: “CONNECTION SETUP” screen

Table 3.50: Description of Connection setup

<b>Nominal range</b>	Nominal voltage range. Select voltage range according to the <b>nominal network</b> voltage.	
	<b>1W and 4W</b>	<b>3W and OPEN D</b>
	50 ÷ 70 V (L-N)	86÷121 V (L-L)
	70 ÷ 130 V (L-N)	121÷225 V (L-L)
	130 ÷ 300 V (L-N)	225÷519 V (L-L)
	300 ÷ 600 V (L-N)	520÷1039 V (L-L)


**Voltage ratio**

Scaling factor for voltage transducer. Use this factor if external voltage transformers or dividers should be taken into account. All readings are then related to the primary voltage. See 4.2.2 for connection details.

**Note:** scale factor can be set only when the lowest Voltage range is selected!

**Note:** Maximum value is limited to 4000.

**Ph. Curr. Clamps**

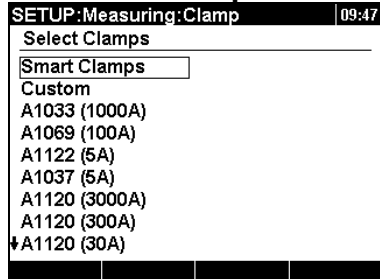


Select phase clamps for phase current measurements.

**Note:** For Smart clamps (A 1227, A 1281) always select “Smart clamps”.

**Note:** See section 4.2.3 for details regarding further clamps settings.

**Connection**

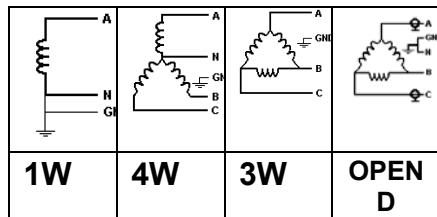

Method of connecting the instrument to multi phase systems (see 4.2.1 for details).

- **1W:** 1-phase 2-wire system;
- **3W:** 3-phase 3-wire system;
- **4W:** 3-phase 4-wire system;
- **OPEN D:** open delta 3-wire system.

**Synchronization**

Synchronization channel. This channel is used for instrument synchronization to the network frequency. Also a frequency measurement is performed on that channel. Depending on **Connection** user can select:

- **1W:** U1 or I1.
- **3W, OPEN D:** U12, or I1.
- **4W:** U1, I1.

**System frequency**

Select system frequency.

- 50 Hz
- 60 Hz

**Default parameters**

Set factory default. These are:  
 Nominal range: 130 ÷ 300 V (L-N);  
 Voltage ratio: 1:1;  
 Phase current clamps: Smart Clamps;  
 Connection: 4W;  
 Synchronization: U1  
 System frequency: 50 Hz.

Table 3.51: Keys functions



Change selected parameter value.



Select Connection setup parameter.



Enter into submenu.  
Confirm Default parameters.



Back to the “MEASUREMENT SETUP” menu screen.

### 3.4.2 Event setup

In this menu you can setup voltage events and their parameters. See 5.1.10 for further details regarding measurement methods. Captured events can be observed through EVENTS TABLE menu. See 3.2 for details.

SETUP:Voltage Events		01:21
Nominal voltage:	230.0V	
Swell:	253.0V +10.0%	
Dip:	207.0V -10.0%	
Interrupt:	11.5V 5.0%	
Capture Events:	Disabled	

Figure 3.41: Voltage events setup screen.

Table 3.52: Description of Voltage event setup

<b>Nominal voltage</b>	Set nominal voltage.
<b>Swell</b>	Set swell threshold value.
<b>Dip</b>	Set dip threshold value.
<b>Interrupt</b>	Set interrupt threshold value.
<b>Capture Events</b>	Enable or disable event capturing.

**Note:** Enable events only if you want to capture it without recording. In case you want observe events only during recording use option:

Include active events: On in GENERAL RECORDER menu.

**Note:** In case of Connection type: 1W, it is recommended to connect unused voltage inputs to N voltage input in order to avoid false triggering.

Table 3.53: Keys function



Change value.



Select Voltage events setup parameter.



Back to the “MEASUREMENT SETUP” menu screen.

### 3.5 General Setup menu

From the “GENERAL SETUP” menu communication parameters, real clock time, language can be reviewed, configured and saved.

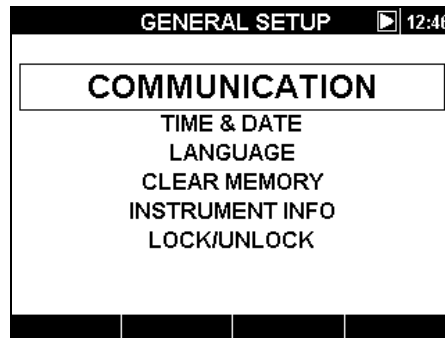





Figure 3.42: GENERAL SETUP menu

Table 3.54: Description of General setup options

<b>Communication</b>	Setup communication baud rate and source.
<b>Time &amp; Date</b>	Set time and date.
<b>Language</b>	Select language.
<b>Clear memory</b>	To clear saved events or records.
<b>Instrument info</b>	Information about the instrument.
<b>Lock/Unlock</b>	Lock instrument to prevent unauthorized access.

Table 3.55: Keys functions

	Select function from the “GENERAL SETUP” menu.
	Enter the selected item.
	Back to the “MAIN MENU” screen.

#### 3.5.1 Communication

Communication port (RS232, USB) and communication speed can be set in this menu.

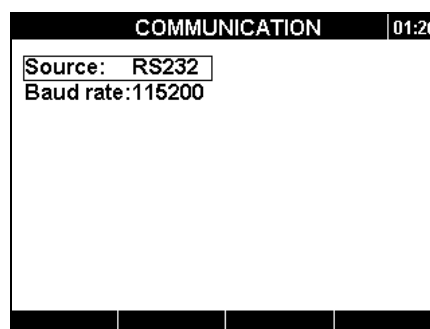





Figure 3.43: Communication setup screen

Table 3.56: Description of Communication setup options

<b>Source:</b>	Select RS-232, USB communication port.
<b>Baud rate:</b>	Select port speed.

Table 3.57: Keys functions

	Change communication source (RS – 232, USB) Change communication speed from 2400 baud to 115200 baud for RS232 and from 2400 baud to 921600 baud for USB.
	Cursor keys. Select parameter.
	Back to the “GENERAL SETUP” menu screen.

### 3.5.2 Time & Date

Time and date can be set in this menu.

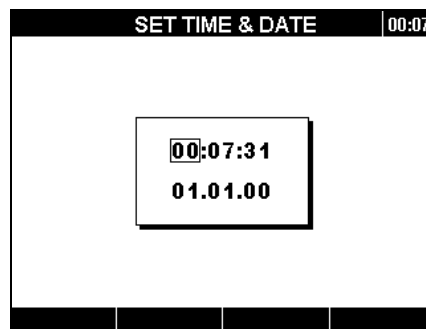





Figure 3.44: Set time &amp; date screen

Table 3.58: Keys functions

	Select between the following parameters: hour, minute, second, day, month or year.
	Change value of the selected item.
	Return to the “GENERAL SETUP” menu screen.

### 3.5.3 Language

Different languages can be selected in this menu.



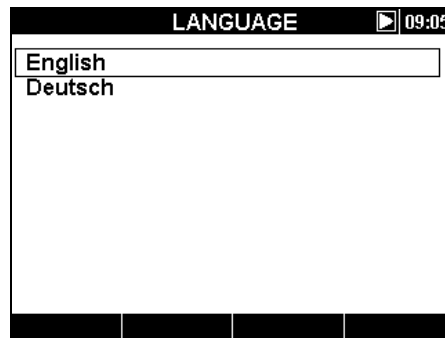





Figure 3.45: Language setup screen

Table 3.59: Keys functions

	Select language.
	Confirm the selected language.
	Back to the “GENERAL SETUP” menu screen.

### 3.5.4 Clear memory

Events and Records stored in memory can be cleared.

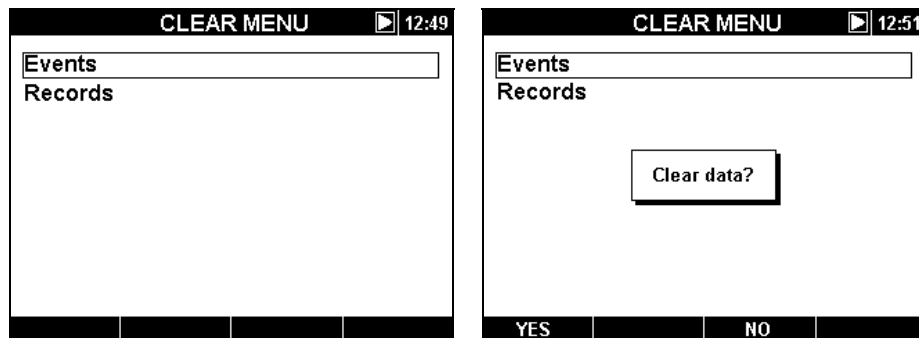





Figure 3.46: Clear memory menu and confirmation screen

Table 3.60: Keys functions

	Select option to be cleared.
	Enter the confirmation screen.
	Confirm clearing of selected memory.



Abort clearing of selected memory.



Back to the “GENERAL SETUP” menu screen.

### 3.5.5 Instrument info

Basic information concerning the instrument can be viewed in this menu: company, user data, serial number, firmware version and hardware version.

INSTRUMENT INFO		▶ 09:04
Company:	METREL	
User data:	Operater	
Serial No:	-----	
FW ver.:	11.0. ---	
HW ver.:	3.0	
Memory size (kB):	7853	
Free memory (kB):	3341	

Figure 3.47: Instrument info screen

Table 3.61: Keys functions



Back to the “GENERAL SETUP” menu screen.

### 3.5.6 Lock/Unlock

PowerQ / PowerQ Plus has the ability to prevent unauthorized access to all important instrument functionality by simply locking the instrument. There are several reasons for instrument locking, especially if instrument is left for a longer period at an unsupervised measurement spot. Some reasons are: prevention of unintentional stopping of record, changing of instrument or measurement setup, etc. Although instrument lock prevent unauthorized changing of instrument working mode, it does not prevent non-destructive operation as displaying current measurement values or trends.

User locks the instrument by entering secret lock code in the Lock/Unlock screen.

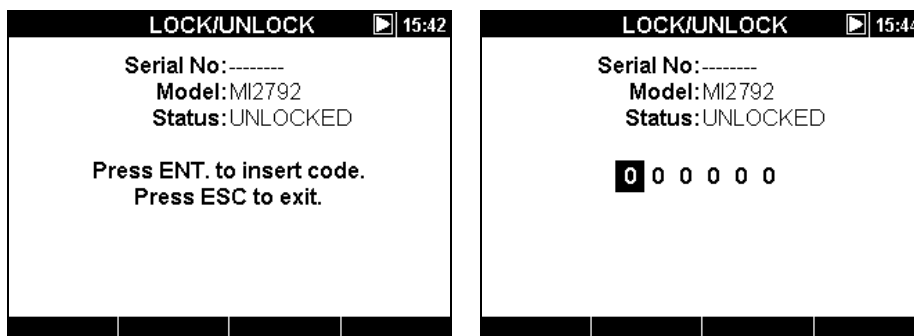






Figure 3.48: Lock/Unlock screen

Table 3.62: Keys function

	Select digit
	Change value of the selected digit
	Set / Confirm lock code.
	Back to the “GENERAL SETUP” menu screen.

Following table shows how locking impacts instrument functionality.

Table 3.63: Locked instrument functionality

MEASUREMENTS	Waveform snapshot functionality blocked
RECORDERS	No access
MEASUREMENT SETUP	No access
GENERAL SETUP	No access except to Lock/Unlock menu

A warning message appears if user tries to enter restricted instrument functions. By pressing ENTER during the warning message appearance, the LOCK/UNLOCK screen will be entered where the instrument can be unlocked by entering the previously entered lock code.

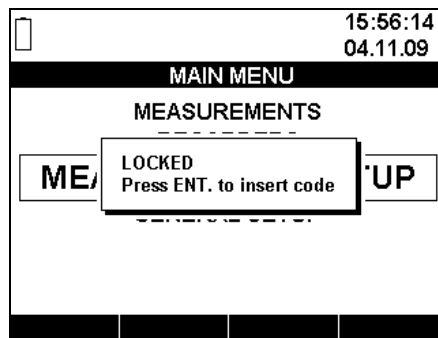


Figure 3.49: Locked instrument warning message

Note: In case user forget unlock code, general unlock code “120371” can be used to unlock the instrument.

## 4 Recording Practice and Instrument Connection

In following section recommended measurement and recording practice is described.

### 4.1 Measurement campaign

Power quality measurements are specific type of measurements, which can last many days, and mostly they are *performed* only once. Usually recording campaign is performed to:

- Statistically analyze some points in the network.
- Troubleshoot malfunctioning device or machine

Since measurements are mostly *performed* only once, it is very important to properly set measuring equipment. Measuring with wrong setting can lead to false or useless measurement results. Therefore instrument and user should be fully prepared before measurement begins.

In this section recommended recorder procedure is shown. We recommend to strictly follow guidelines in order to avoid common problems and measurement mistakes. Figure bellow shortly summarizes recommended measurement practice. Each step is then described in details.

**Note:** PC software PowerView v2.0 has the ability to correct (after measurement is done):

- wrong real-time settings,
- wrong current and voltage scaling factor.

False instrument connection (messed wiring, opposite clamp direction), can't be fixed afterwards.

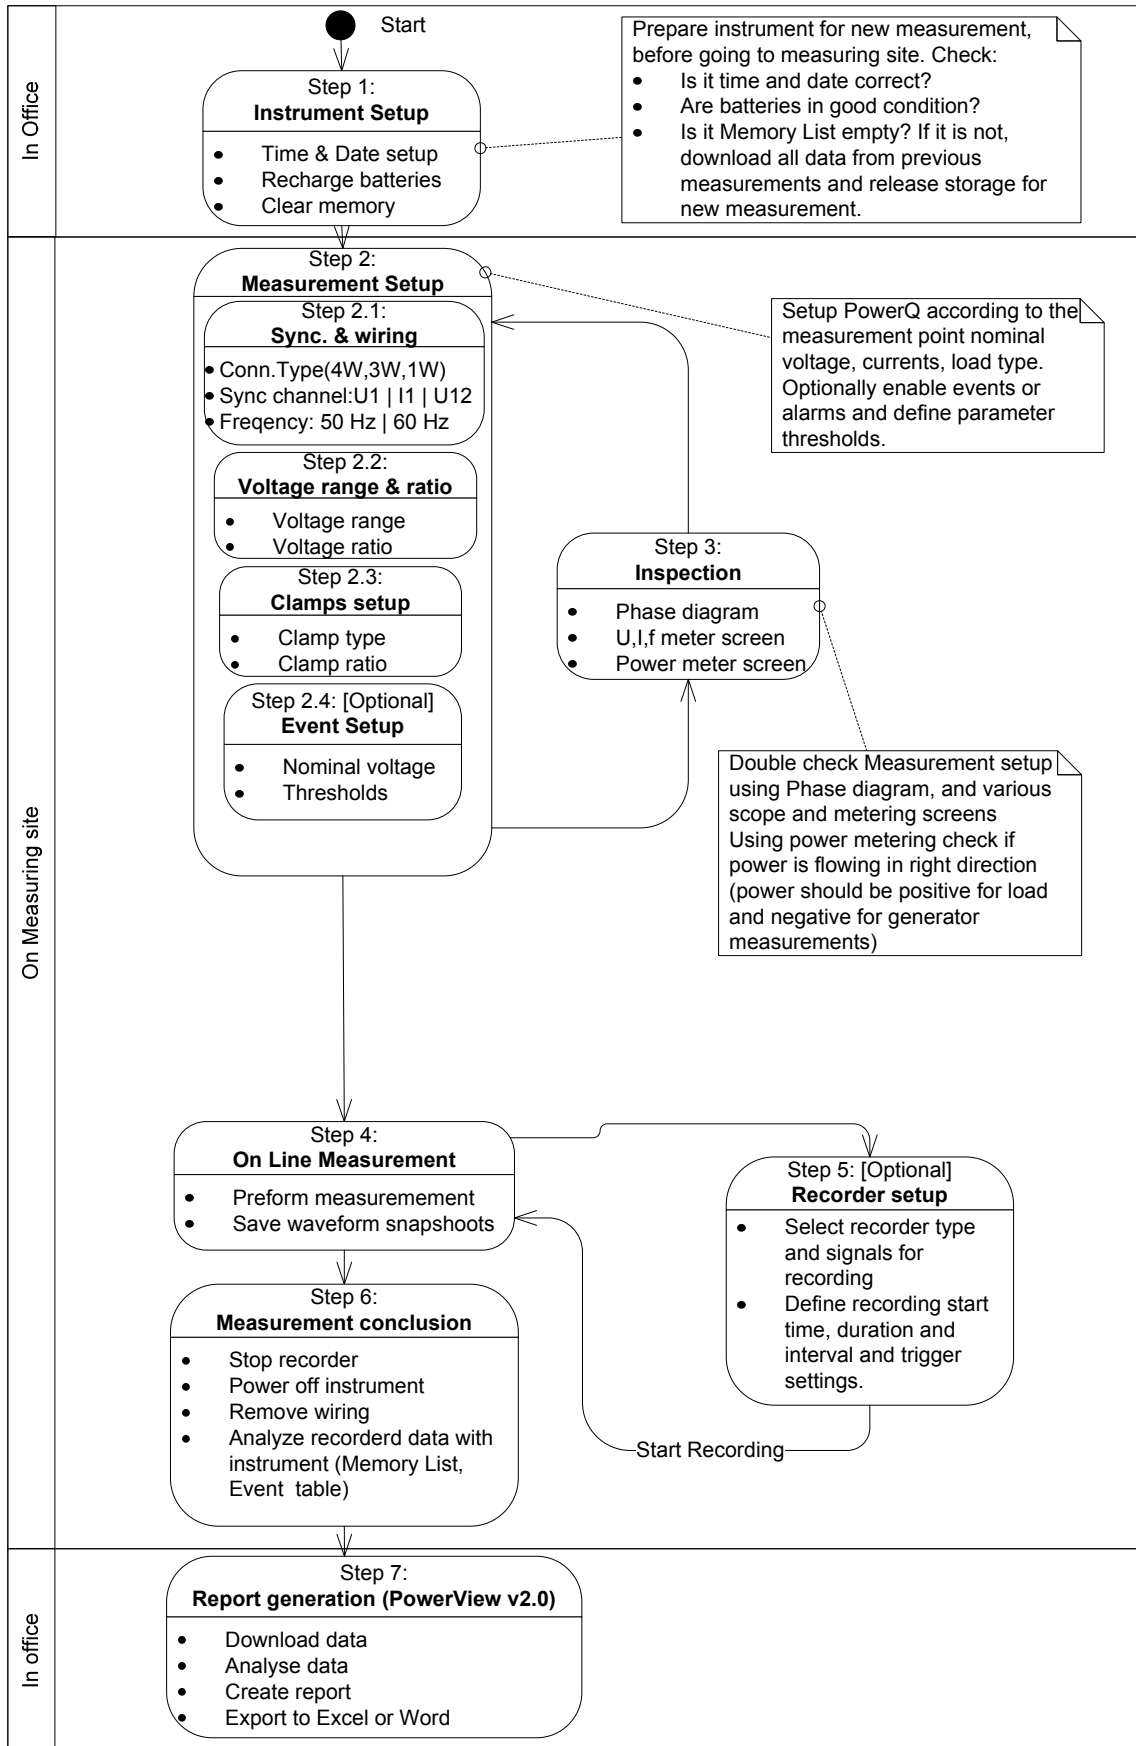


Figure 4.1: Recommended measurement practice

### **Step 1: Instrument setup**

On site measurements can be very stressful, and therefore it is good practice to prepare measurement equipment in an office. Preparation of PowerQ / PowerQ Plus include following steps:

- Visually check instrument and accessories.  
**Warning:** Don't use visually damaged equipment!
- Always use batteries that are in good condition and fully charge them before you leave.  
**Note:** Keep your batteries in good condition. In problematic PQ environment where dips and interrupts frequently occurs instrument power supply fully depends on batteries!
- Download all previous records from instrument and clear the memory. (See section 0 for instruction regarding memory clearing)
- Set instrument time and date. (See section 0 for instruction regarding time and date settings)

### **Step 2: Measurement setup**

Measurement setup adjustment is *performed* on measured site, after we find out details regarding nominal voltage, currents, type of wiring etc.

#### **Step 2.1: Synchronization and wiring**

- Connect current clamps and voltage tips to the "Device under measurement" (See section 4.2 for details).
- Select proper type of connection in "Connection setup" menu (See section 3.4.1 for details).
- Select synchronization channel. Synchronization to voltage is recommended, unless measurement is performed on highly distorted loads, such as PWM drives. In that case current synchronization can be more appropriate. (See section 3.4.1 for details).
- Select System frequency. System frequency is default mains system frequency.

#### **Step 2.2: Voltage range and ratio**

- Select proper voltage range according to the network nominal voltage.  
**Note:** For 4W and 1W measurement all voltages are specified as phase-to-neutral (L-N). For 3W measurements all voltages are specified as phase-to-phase (L-L)
- In case of indirect voltage measurement, select voltage range: 50 V ÷ 70 V and select "Voltage ratio" according to transducer ratio. (See section 3.4.1 for details).

#### **Step 2.3: Current clamps setup**

- Using "Current Clamps" menu, select proper clamps (see sections 3.4.1 for details).
- Select proper clamps parameters according to the type of connection (see section 4.2.3 for details).

### **Step 2.4: Event setup (optional)**

Use this step only if voltage events are object of concern. Select nominal voltage and threshold values for: dip, swell and interrupts (see sections 3.4.2 and 3.2 for details).

**Note:** Enable events in EVENT SETUP only if you want to capture events, without RECORDER assistance.

### **Step 3: Inspection**

After setup instrument and measurement is finished, user need to recheck if everything is connected and configured properly. Following steps are recommended.

- Using PHASE DIAGRAM menu check if voltage and current phase sequence is right regarding to the system. Additionally check if current has right direction.
- Using U, I, f menu check if voltage and current value has proper value.
- Additionally check voltage and current THD.

**Note:** Excessive THD can indicate that too small range was chosen!

**Note:** In case of AD converter overloading current and voltage value will be displayed with inverted color **250.4 V**.

**Note:** If phase current or voltage values are low, accuracy can be compromised. Value will be then displayed with inverted color **0.4 V**.

- Using POWER menu check signs and indices of active, reactive power and power factor.

If any of these steps give you suspicious measurement results, return to Step 2 and double check measurement parameters.

### **Step 4: On-line measurement**

Instrument is now ready for measurement. Observe on line parameters of voltage, current, power, harmonics, etc. according to the measurement protocol or customer issues.

**Note:** Use waveform snapshots to capture important measurement. Waveform snapshot capture all power quality signatures at once (voltage, current, power, harmonics).

### **Step 5: Recorder setup and recording**

Using RECORDERS menu select type of recording and configure recording parameters such as:

- Recorder **Signals** included in recording
- Time **Interval** for data aggregation (IP)
- Record duration
- Recording start time (optional)
- Include events capture if necessary

After setting recorder, recording can be started. (see section 3.7 for recorder details).

**Note:** Recording usually last few days. Assure that instrument during recording session is not reachable to the unauthorized persons. If necessary use LOCK functionality described in section 3.5.6.

### **Step 6: Measurement conclusion**

Before leaving measurement site we need to

- Preliminary evaluate recorded data using TREND screens.
- Stop recorder

- Assure that we record and measure everything we needed.

### Step 7: Report generation (PowerView v2.0)

Download records using PC software PowerView v2.0 and perform analysis. See PowerView v2.0 manual for details.

## 4.2 Connection setup

### 4.2.1 Connection to the LV Power Systems

This instrument can be connected to the 3-phase and single phase network.

The actual connection scheme has to be defined in CONNECTION SETUP menu (see Figure below).

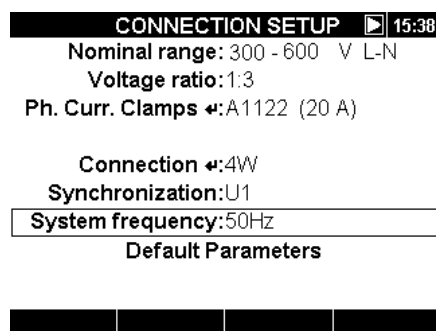


Figure 4.2: Connection setup menu

When connecting the instrument it is essential that both current and voltage connections are correct. In particular the following rules have to be observed:

Clamp-on current clamp-on transformers

- The arrow marked on the clamp-on current transformer should point in the direction of current flow, from supply to load.
- If the clamp-on current transformer is connected in reverse the measured power in that phase would normally appear negative.

Phase relationships

- The clamp-on current transformer connected to current input connector  $I_1$  has to measure the current in the phase line to which the voltage probe from  $L_1$  is connected.

### 3-phase 4-wire system

In order to select this connection scheme, choose following connection on the instrument:



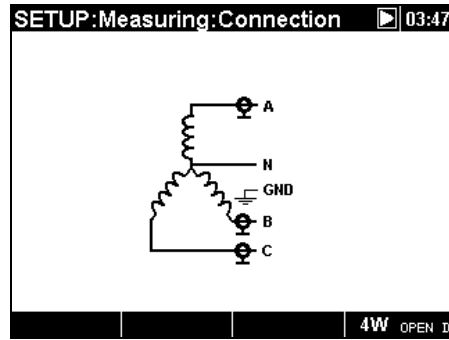


Figure 4.3: Choosing 3-phase 4-wire system on instrument

Instrument should be connected to the network according to figure below:

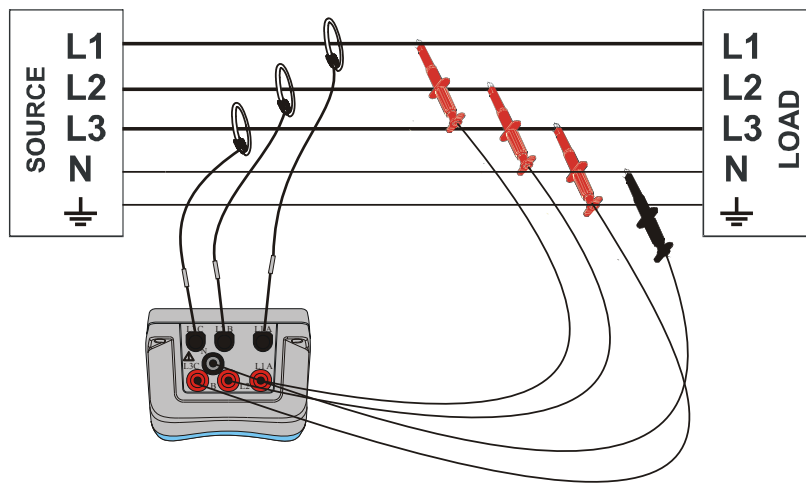


Figure 4.4: 3-phase 4-wire system

**3-phase 3-wire system**

In order to select this connection scheme, choose following connection on the instrument:

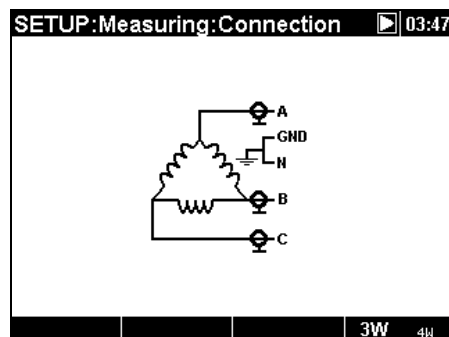


Figure 4.5: Choosing 3-phase 3-wire system on instrument

Instrument should be connected to the network according to figure below.

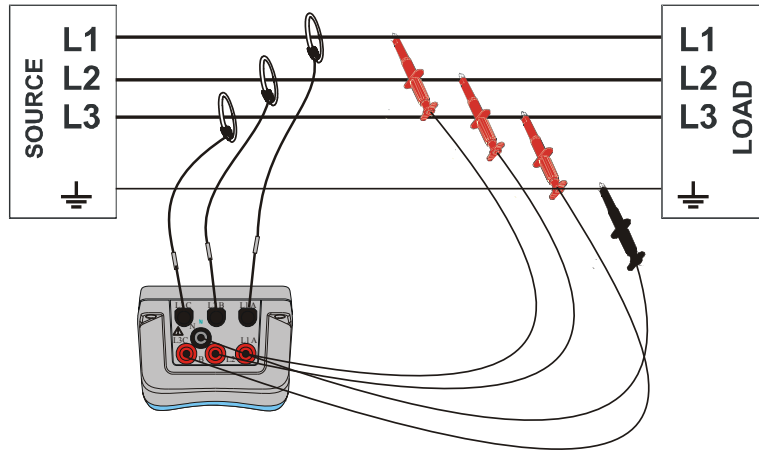


Figure 4.6: 3-phase 3-wire system

**Open delta 3-wire system**

In order to select this connection scheme, choose following connection on the instrument:

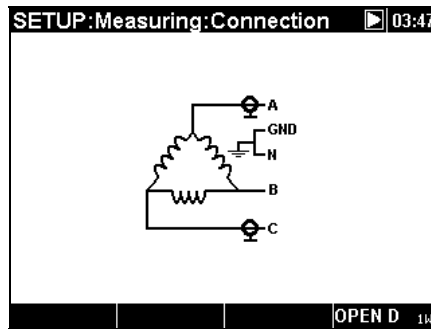


Figure 4.7: Choosing open delta 3-wire system on instrument

Instrument should be connected to the network according to figure bellow.

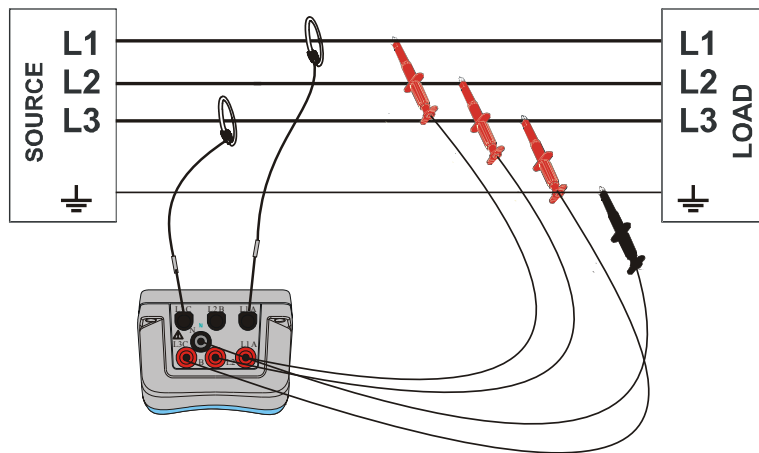


Figure 4.8: Open delta 3-wire system

### 1-phase 3-wire system

In order to select this connection scheme, choose following connection on the instrument:

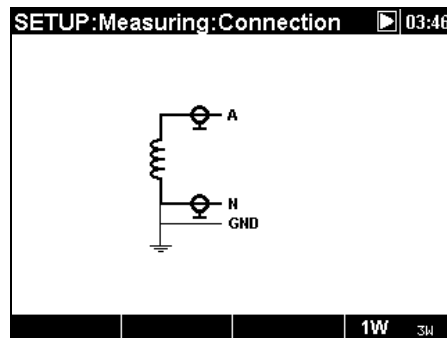


Figure 4.9: Choosing 1-phase 3-wire system on instrument

Instrument should be connected to the network according to figure bellow.

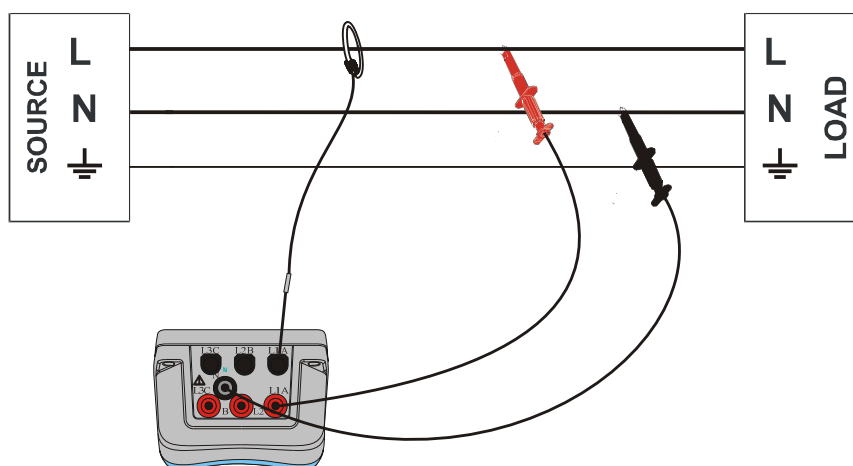


Figure 4.10: 1-phase 3-wire system

**Note:** In case of events capturing, it is recommended to connect unused voltage inputs to N voltage input.

### 4.2.2 Connection to the MV or HV Power System

In systems where voltage is measured at the secondary side of a voltage transformer (say 11 kV / 110 V), the instrument voltage range should be set to 50÷110 V and scaling factor of that voltage transformer ratio has to be entered in order to ensure correct measurement. In the next figure settings for this particular example is shown.

MEASURING SETUP	
Voltage range:	50 - 70 V L-N
Voltage ratio:	1:100
Ph. Curr. Clamps	Smart Clamps
N. Curr. Clamps	Smart Clamps
Connection	4W
Synchronization:	U1
Default Parameters	

Figure 4.11: Voltage ratio for 11kV/110kV transformer example

Instrument should be connected to the network according to figure bellow.

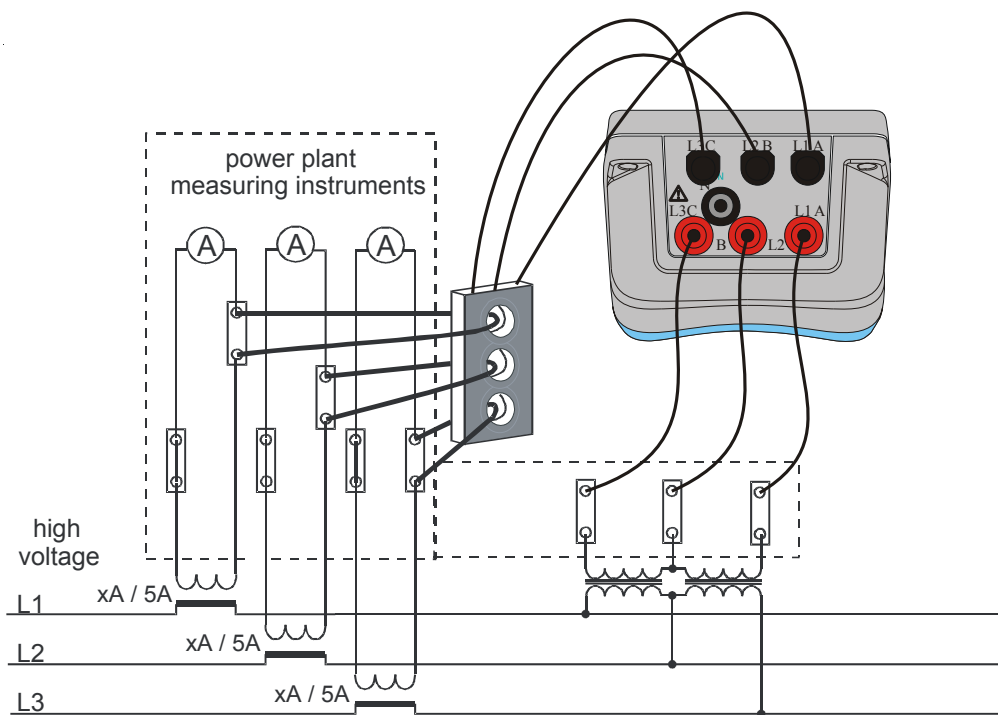


Figure 4.12: Connecting instrument to the existing current transformers in medium voltage system

### 4.2.3 Current clamp selection and transformation ratio setting

Clamp selection can be explained by two typical use cases: **direct current measurement** and **indirect current measurement**. In next section recommended practice for both cases is shown.

#### **Direct current measurement with clamp-on current transformer**

In this type of measurement load/generator current is measured directly with one of clap-on current transformer. Current to voltage conversion is *performed directly* by the clamps.

Direct current measurement can be *performed* by any clamp-on current transformer. We particularly recommend Smart clamps: flex clamps A 1227 and iron clamps A 1281.

Also older Metrel clamp models A 1033 (1000A), A1069 (100A), A1120 (3000A), A1099 (3000A), etc. can be used.

In the case of large loads there can be few parallel feeders which can't be embraced by single clamps. In this case we can measure current only through one feeder as shown on figure bellow.

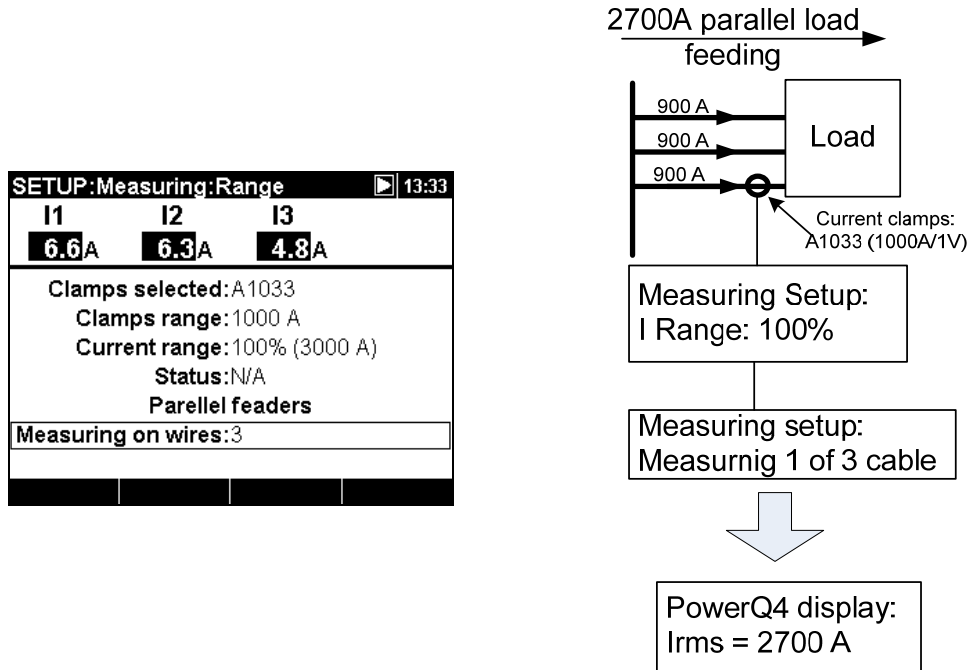


Figure 4.13: Parallel feeding of large load

**Example:** 2700 A current load is fed by 3 equal parallel cables. In order to measure current we can embrace only one cable with clamps, and select: Measuring on wires: 3 in clamp menu. Instrument will assume that we measure only third part of current.

**Note:** During setup current range can be observed by “Current range: 100% (3000 A)” row.

### Indirect current measurement

Indirect current measurement with primary current transducer is assumed if user selects 5A current clamps: A 1122 or A 1037. Load current is that case measured **indirectly** through additional primary current transformer.

In **example** if we have 100A of primary current flowing through primary transformer with ratio 600A:5A, settings are shown in following figure.

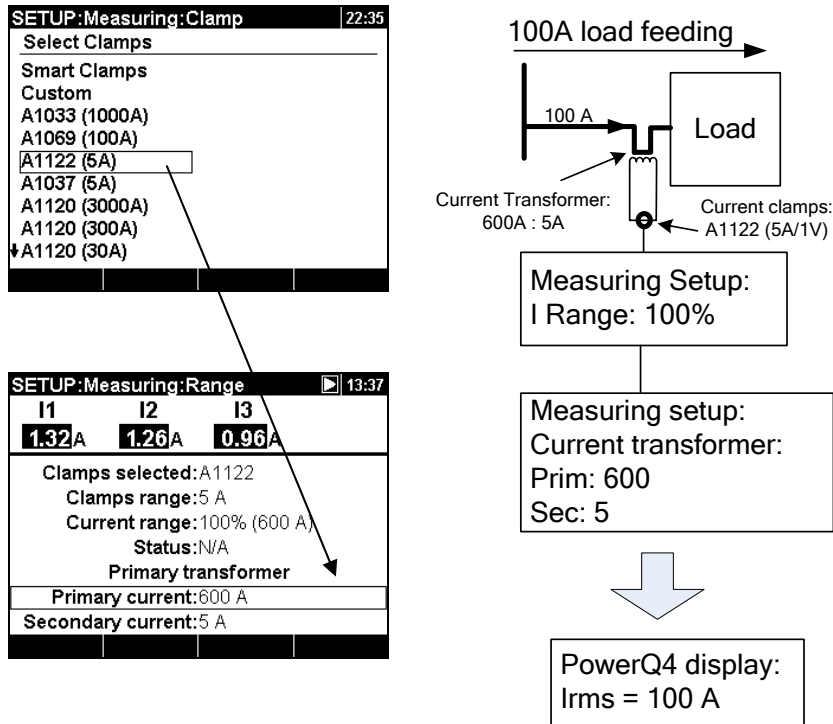


Figure 4.14: Current clamps selection for indirect current measurement

**Over-dimensioned current transformer**

Installed current transformers on the field are usually over-dimensioned for “possibility to add new loads in future”. In that case current in primary transformer can be less than 10% of rated transformer current. For such cases it is recommended to select 10% current range as shown on figure bellow.

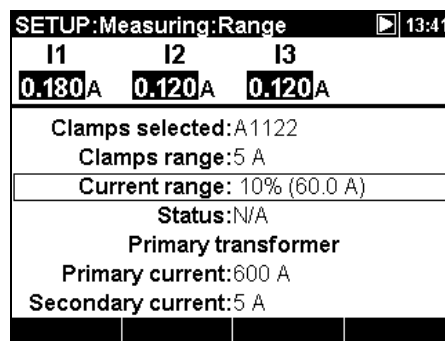


Figure 4.15: Selecting 10% of current clamps range

Note that if we want to perform direct current measure with 5 A clamps, primary transformer ratio should be set to 5 A : 5 A.

**⚠ WARNING !**

- The secondary winding of a current transformer must not be open when it is on a live circuit.
- An open secondary circuit can result in dangerously high voltage across the terminals.

**Automatic current clamps recognition**

Metrel developed Smart current clamps product family in order to simplify current clamps selection and settings. Smart clamps are multi-range switch-less current clamps automatically recognized by instrument. In order to activate smart clamp recognition, the following procedure should be followed for the first time:

1. Turn on instrument
2. Connect clamps (for example A 1227) into PowerQ / PowerQ Plus
3. Enter: Measurement Setup → Connection setup → Ph./N. Curr. Clamps menu
4. Select: Smart clamps
5. Clamps type will be automatically recognized by the instrument.
6. User should then select clamp range and confirm settings

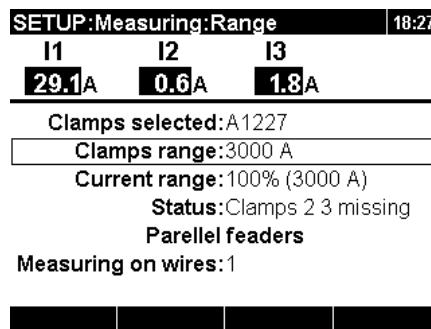


Figure 4.16: Automatically recognised clamps setup

Instrument will remember clamps setting for the next time. Therefore, user only need to:

1. Plug clamps into the instrument
2. Turn on the instrument

Instrument will recognize clamps automatically and set up ranges as was settled on measurement before. If clamps were disconnected following pop up will appear on the screen.

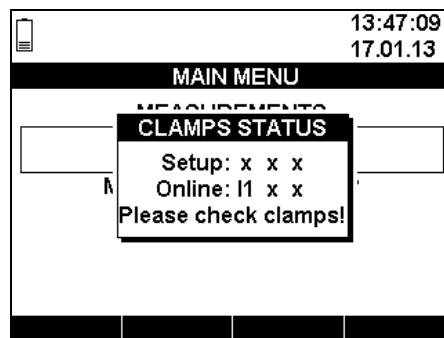


Figure 4.17: Automatically recognised clamps status

Clamps Status menu indicate that there is an inconsistency between current clamp defined in Clamps Setup menu and clamps present at the moment. For example, figure above show that in setup no clamp were defined (X), but at the moment there are clamps present on I1 current channel.

Table 4.1: Clamp status screen symbols and abbreviations

<b>Setup</b>	Show clamps, which were connected during clamp setup in Measurement setup → Connection Setup → Ph.. Curr. clamps <ul style="list-style-type: none"> <li>• <b>X</b>: clamps on present current channel are missing</li> <li>• <b>I1/I2/I3</b>: clamps were present and defined during setup</li> </ul>
<b>Online</b>	Show clamps which are connected to the instrument at the moment: <ul style="list-style-type: none"> <li>• <b>X</b>: clamps on present current channel are missing</li> <li>• <b>I1/I2/I3</b>: clamps are present at the moment</li> </ul>

**Note:** Do not disconnect smart clamps during recording or measurement. Clamps range will be reset if clamps are plugged out of the instrument.

### 4.3 Number of measured parameters and connection type relationship

Parameters which PowerQ / PowerQ Plus displays and measures, mainly depends on network type, defined in CONNECTION SETUP menu, **Connection** type. In example if user choose single phase connection system, only measurements relate to single phase system will be present. Table bellows show dependencies between measurement parameters and type of network.

Table 4.2: Quantities measured by instrument

Value		Connection type		
		1W	3W	4W
<b>U, I, f</b>	<b>RMS</b>	$U_{1rms}$	$U_{12rms} \quad U_{23rms}$ $U_{31rms}$	$U_{1rms} \quad U_{2rms} \quad U_{3rms}$ $U_{12rms} \quad U_{23rms} \quad U_{31rms}$
	<b>THD</b>	$THD_{U1}$	$THD_{U12} \quad THD_{U23}$ $THD_{U31}$	$THD_{U1} \quad THD_{U2} \quad THD_{U3}$ $THD_{U12} \quad THD_{U23} \quad THD_{U31}$
	<b>Cf</b>	$CfU_1$	$CfU_{12} \quad CfU_{23}$ $CfU_{31}$	$CfU_1 \quad CfU_2 \quad CfU_3$ $CfU_{12} \quad CfU_{23} \quad CfU_{31}$
	<b>RMS</b>	$I_{1rms}$	$I_{1rms} \quad I_{2rms} \quad I_{3rms}$	$I_{1rms} \quad I_{2rms} \quad I_{3rms}$
	<b>THD</b>	$THD_{I1}$	$THD_{I1} \quad THD_{I2}$ $THD_{I3}$	$THD_{I1} \quad THD_{I2} \quad THD_{I3}$
	<b>Cf</b>	$CfI_1$	$CfI_1 \quad CfI_2 \quad CfI_3$	$CfI_1 \quad CfI_2 \quad CfI_3$
	<b>freq</b>	$freqU_1$ $freqI_1$	$freqU_{12}$ $freqI_1$	$freqU_1$ $freqI_1$
<b>Power &amp; Energy</b>	<b>P</b>	$\pm P_1$	$\pm P_{tot}$	$\pm P_1 \quad \pm P_2 \quad \pm P_3 \quad \pm P_{tot}$
	<b>Q</b>	$\pm Q_1$	$\pm Q_{tot}$	$\pm Q_1 \quad \pm Q_2 \quad \pm Q_3 \quad \pm Q_{tot}$
	<b>S</b>	$S_1$	$S_{tot}$	$S_1 \quad S_2 \quad S_3 \quad S_{tot}$
	<b>PF</b>	$\pm PF_1$	$\pm PF_{tot}$	$\pm PF_1 \quad \pm PF_2 \quad \pm PF_3 \quad \pm PF_{tot}$
	<b>DPF</b>	$\pm DPF_1$		$\pm DPF_1 \quad \pm DPF_2 \quad \pm DPF_3 \quad \pm DPF_{tot}$



Unbalance	%	-	$\bar{u} \bar{i}$	$u^0 i^0 \bar{u} \bar{i}$
	RMS		$U^+ U^-$ $I^+ I^-$	$U^+ U^- U^0$ $I^+ I^- I^0$
Harmonics	$Uh_{1:50}$	$U_1 h_{1:50}$	$U_{12} h_{1:50} \quad U_{23} h_{1:50}$ $U_{31} h_{1:50}$	$U_1 h_{1:50} \quad U_2 h_{1:50} \quad U_3 h_{1:50}$
	$Ih_{1:50}$	$I_1 h_{1:50}$	$I_1 h_{1:50} \quad I_2 h_{1:50}$ $I_3 h_{1:50}$	$I_1 h_{1:50} \quad I_2 h_{1:50} \quad I_3 h_{1:50}$

**Note:** Frequency measurement depends on synchronization (reference) channel, which can be voltage or current.

In the same manner recording quantities are related to connection type too. When user selects **Signals** in RECORDER menu, channels selected for recording are chosen according to the **Connection** type, according to the next table.

Table 4.3: Quantities recorder by instrument

		Value	1-phase	3W	4W
<b>U, I, f</b>	<b>Voltage</b>	<b>RMS</b>	$U_{1Rms}$	$U_{12Rms} U_{23Rms} U_{31Rms}$	$U_{1Rms} U_{2Rms} U_{3Rms} U_{12Rms} U_{23Rms} U_{31Rms}$
		<b>THD</b>	$THD_{U1}$	$THD_{U12} THD_{U23} THD_{U31}$	$THD_{U1} THD_{U2} THD_{U3} THD_{U12} THD_{U23} THD_{U31}$
		<b>CF</b>	$CfU_1$	$CfU_{12} CfU_{23} CfU_{31}$	$CfU_1 CfU_2 CfU_3 CfU_{12} CfU_{23} CfU_{31}$
	<b>Current</b>	<b>RMS</b>	$I_{1rms}$	$I_{1rms} I_{2rms} I_{3rms}$	$I_{1rms} I_{2rms} I_{3rms}$
		<b>THD</b>	$THD_{I1}$	$THD_{I1} THD_{I2} THD_{I3}$	$THD_{I1} THD_{I2} THD_{I3}$
		<b>CF</b>	$CfI_1$	$CfI_1 CfI_2 CfI_3$	$CfI_1 CfI_2 CfI_3$
<b>Frequency</b>	<b>f</b>	$freqU_1   freqI_1$	$freqU_{12}   freqI_1$	$freqU_1   freqI_1$	
<b>Power &amp; Energy</b>	<b>Power</b>	<b>P</b>	$P_1^+ P_1^-$	$P_{tot}^+ P_{tot}^-$	$P_1^+ P_1^- P_2^+ P_2^- P_3^+ P_3^- P_{tot}^+ P_{tot}^-$
		<b>Q</b>	$Q_1^{i+} Q_1^{c+} Q_1^{i-} Q_1^{c-}$	$Q_{tot}^{i+} Q_{tot}^{c+} Q_{tot}^{i-} Q_{tot}^{c-}$	$Q_1^{i+} Q_1^{c+} Q_1^{i-} Q_1^{c-} Q_2^{i+} Q_2^{c+} Q_2^{i-} Q_2^{c-} Q_3^{i+} Q_3^{c+} Q_3^{i-} Q_3^{c-} Q_{tot}^{i+} Q_{tot}^{c+} Q_{tot}^{i-} Q_{tot}^{c-}$
		<b>S</b>	$S_1^+ S_1^-$	$S_{tot}^+ S_{tot}^-$	$S_1^+ S_1^- S_2^+ S_2^- S_3^+ S_3^- S_{tot}^+ S_{tot}^-$
	<b>Energy</b>	<b>eP</b>	$eP_1^+ eP_1^-$	$eP_{tot}^+ eP_{tot}^-$	$eP_1^+ eP_1^- eP_2^+ eP_2^- eP_3^+ eP_3^- eP_{tot}^+ eP_{tot}^-$
		<b>eQ</b>	$eQ_1^{i+} eQ_1^{c+}$ $eQ_1^{i-} eQ_1^{c-}$	$eQ_{tot}^{i+} eQ_{tot}^{c+}$ $eQ_{tot}^{i-} eQ_{tot}^{c-}$	$eQ_1^{i+} eQ_1^{c+} eQ_2^{i+} eQ_2^{c+} eQ_3^{i+} eQ_3^{c+} eQ_{tot}^{i+} eQ_{tot}^{c+}$ $eQ_1^{i-} eQ_1^{c-} eQ_2^{i-} eQ_2^{c-} eQ_3^{i-} eQ_3^{c-} eQ_{tot}^{i-} eQ_{tot}^{c-}$
		<b>eS</b>	$eS_1^+ eS_1^-$	$eS_{tot}^+ eS_{tot}^-$	$eS_1^+ eS_1^- eS_2^+ eS_2^- eS_3^+ eS_3^- eS_{tot}^+ eS_{tot}^-$
	<b>Power factor</b>	<b>Pf</b>	$PF_1^{i+} PF_1^{c+}$ $PF_1^{i-} PF_1^{c-}$	$PF_{tot}^{i+} PF_{tot}^{c+} PF_{tot}^{i-} PF_{tot}^{c-}$	$PF_1^{i+} PF_1^{c+} PF_2^{i+} PF_2^{c+} PF_3^{i+} PF_3^{c+} PF_{tot}^{i+} PF_{tot}^{c+}$ $PF_1^{i-} PF_1^{c-} PF_2^{i-} PF_2^{c-} PF_3^{i-} PF_3^{c-} PF_{tot}^{i-} PF_{tot}^{c-}$
		<b>DPF</b>	$DPF_1^{i+} DPF_1^{c+}$ $DPF_1^{i-} DPF_1^{c-}$	-	$DPF_1^{i+} DPF_1^{c+} DPF_2^{i+} DPF_2^{c+} DPF_3^{i+} DPF_3^{c+}$ $DPF_1^{i-} DPF_1^{c-} DPF_2^{i-} DPF_2^{c-} DPF_3^{i-} DPF_3^{c-}$
	<b>Unbalance</b>	<b>%</b>	-	$u \bar{i}$	$u^0 i^0 u \bar{i}$
	<b>Harmonics</b>	<b>Uh<sub>1÷50</sub></b>	$U_{1h_{1÷50}}$	$U_{12h_{1÷50}} U_{23h_{1÷50}} U_{31h_{1÷50}}$	$U_{1h_{1÷50}} U_{2h_{1÷50}} U_{3h_{1÷50}}$
<b>Ih<sub>1÷50</sub></b>		$I_{1h_{1÷50}}$	$I_{1h_{1÷50}} I_{2h_{1÷50}} I_{3h_{1÷50}}$	$I_{1h_{1÷50}} I_{2h_{1÷50}} I_{3h_{1÷50}}$	

## 5 Theory and internal operation

This section contains basic theory of measuring functions and technical information of the internal operation of the PowerQ / PowerQ Plus instrument, including descriptions of measuring methods and logging principles.

### 5.1 Measurement methods

#### 5.1.1 Measurement aggregation over time intervals

*Standard compliance: IEC 61000-4-30 Class B (Section 4.4)*

The basic measurement time interval for:

- Voltage
- Current
- Active, reactive and apparent power
- Harmonics
- Unbalance

is a 10-cycle time interval. The 10-cycle measurement is resynchronized on each **Interval** tick according to the IEC 61000-4-30 Class B. Measurement methods are based on the digital sampling of the input signals, synchronised to the fundamental frequency. Each input (3 voltages and 3 currents) is simultaneously sampled 1024 times in 10 cycles.

#### 5.1.2 Voltage measurement (magnitude of supply voltage)

*Standard compliance: IEC 61000-4-30 Class B (Section 5.2)*

All voltage measurements represent RMS values of 1024 samples of the voltage magnitude over a 10-cycle time interval. Every 10 interval is contiguous, and not overlapping with adjacent 10 intervals.

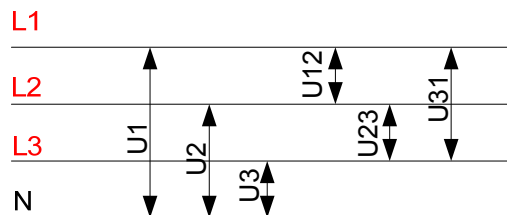


Figure 5.1: Phase and Phase-to-phase (line) voltage

Voltage values are measured according to the following equation:

Phase voltage: 
$$U_p = \sqrt{\frac{1}{1024} \sum_{j=1}^{1024} u_{p,j}^2} \quad [V], p: 1,2,3 \quad (1)$$

$$\text{Line voltage: } U_{pg} = \sqrt{\frac{1}{1024} \sum_{j=1}^{1024} (u_{pj} - u_{gj})^2} \text{ [V], pg: 12,23,31} \quad (2)$$

$$\text{Phase voltage crest factor: } Cf_{Up} = \frac{U_{pPk}}{U_p}, p: 1,2,3 \quad (3)$$

$$\text{Line voltage crest factor: } Cf_{U_{pg}} = \frac{U_{pgPk}}{U_{pg}}, pg: 12, 23, 31 \quad (4)$$

The instrument has internally 3 voltage measurement ranges. Middle voltage (MV) and high voltage (HV) systems can be measured on lowest voltage range with assistance of voltage transformers. Its voltage factor should be entered into Voltage ratio: 1:1 variable in CONNECTION SETUP menu.

### 5.1.3 Current measurement (magnitude of supply current)

*Standard compliance: Class B (Section A.6.3)*

All current measurements represent RMS values of the 1024 samples of current magnitude over a 10-cycle time interval. Each 10-cycle interval is contiguous and non-overlapping.

Current values are measured according to the following equation:

$$\text{Phase current: } I_p = \sqrt{\frac{1}{1024} \sum_{j=1}^{1024} I_{pj}^2} \text{ [A], } p: 1,2,3 \quad (5)$$

$$\text{Phase current crest factor: } Ip_{cr} = \frac{Ip_{max}}{Ip}, p: 1,2,3 \quad (6)$$

The instrument has internally two current ranges: 10% and 100% range of nominal transducer current. Additionally Smart current clamps models offer few measuring ranges and automatic detection.

### 5.1.4 Frequency measurement

*Standard compliance: IEC 61000-4-30 Class B (Section 5.1)*

During RECORDING with aggregation time Interval: ≥10 sec frequency reading is obtained every 10 s. As power frequency may not be exactly 50 Hz within the 10 s time clock interval, the number of cycles may not be an integer number. The fundamental frequency output is the ratio of the number of integral cycles counted during the 10 s time clock interval, divided by the cumulative duration of the integer cycles. Harmonics are attenuated with 2-pole low pass filter in order to minimize the effects of multiple zero crossings.

The measurement time intervals are non-overlapping. Individual cycles that overlap the 10 s time clock are discarded. Each 10 s interval begin on an absolute 10 s time clock.

For RECORDING with aggregation time Interval: <10 sec and on-line measurements, frequency reading is obtained from 10 cycles, in order to decrease instrument response time. The frequency is ratio of 10 cycles, divided by the duration of the integer cycles.

Frequency measurement is *performed* on chosen Synchronization channel, in CONNECTION SETUP menu.

### 5.1.5 Phase power measurements

*Standard compliance:* IEEE STD 1459-2000 (Section 3.2.2.1; 3.2.2.2)  
IEC 61557-12 (Annex A)

All active power measurements represent RMS values of the 1024 samples of instantaneous power over a 10-cycle time interval. Each 10-cycle interval is contiguous and non-overlapping.

Phase active power:

$$P_p = \frac{1}{1024} \sum_{j=1}^{1024} P_{pj} = \frac{1}{1024} \sum_{j=1}^{1024} U_{pj} * I_{pj} \quad [\text{W}], p: 1,2,3 \quad (7)$$

Apparent and reactive power, power factor and displacement power factor ( $\text{Cos } \varphi$ ) are calculated according to the following equations:

$$\text{Phase apparent power: } S_p = U_p * I_p \quad [\text{VA}], p: 1,2,3 \quad (8)$$

$$\text{Phase reactive power: } Q_p = \text{Sign}(Q_p) \cdot \sqrt{S_p^2 - P_p^2} \quad [\text{VAr}], p: 1,2,3 \quad (9)$$

$$\text{Sign of reactive power: } \text{Sign}(Q_p) = \begin{cases} +1, \varphi_p \in [0^\circ - 180^\circ] \\ -1, \varphi_p \in [0^\circ - 180^\circ] \end{cases} \quad p: 1,2,3 \quad (10)$$

$$\text{Phase power factor: } PF_p = \frac{P_p}{S_p}, p: 1,2,3 \quad (11)$$

$$\text{Cos } \varphi \text{ (DPF): } \text{Cos } \varphi_p = \text{Cos } \varphi_{u_p} - \text{Cos } \varphi_{i_p}, p: 1,2,3 \quad (12)$$

### 5.1.6 Total power measurements

*Standard compliance:* IEEE STD 1459-2000 (Section 3.2.2.2; 3.2.2.6)  
IEC 61557-12 (Annex A)

Total active, reactive and apparent power and total power factor are calculated according to the following equation:

$$\text{Total active power: } Pt = P1 + P2 + P3 \quad [\text{W}], \quad (13)$$

$$\text{Total reactive power (vector): } Qt = Q1 + Q2 + Q3 \quad [\text{VAr}], \quad (14)$$

$$\text{Total apparent power (vector): } St = \sqrt{(Pt^2 + Qt^2)} \quad [\text{VA}], \quad (15)$$

Total power factor (vector):  $PF_{tot} = \frac{Pt}{St}$ . (16)

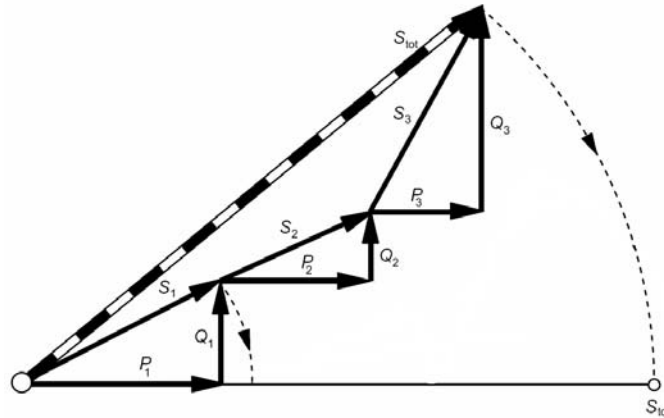


Figure 5.2: Vector representation of total power calculus

### 5.1.7 Energy

Standard compliance: IEC 61557-12 (Annex A)

Energy counters are linked to RECORDER functionality. Energy counters measure energy only when RECORDER is active. After power off/on procedure and before start of recording, all counters are cleared.

Instrument use 4-quadrant measurement technique which use two active energy counters (eP<sup>+</sup>, eP<sup>-</sup>) and two reactive (eQ<sup>+</sup>, eQ<sup>-</sup>), as shown on bellow.

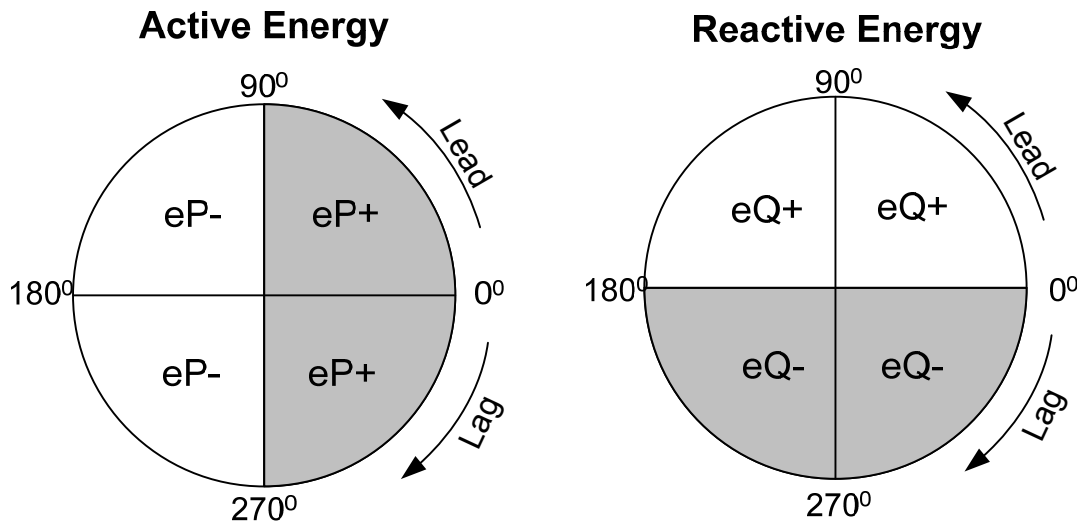


Figure 5.3: Energy counters and quadrant relationship

Instrument has 3 different counters sets:

1. Total counters **TOT.EN** are intended for measuring energy over a complete recording. When recorder starts it sums the energy to existent state of the counters.
2. Last integration period **LST.IP** counter measures energy during recording over last interval. It is calculated at end of each interval.

3. Current integration period **CUR.IP** counter measures energy during recording over current time interval.

### 5.1.8 Harmonics

Standard compliance: IEC 61000-4-30 Class B (Section 5.7)

Calculation called fast Fourier transformation (FFT) is used to translate AD converted input signal to sinusoidal components. The following equation describes relation between input signal and its frequency presentation.

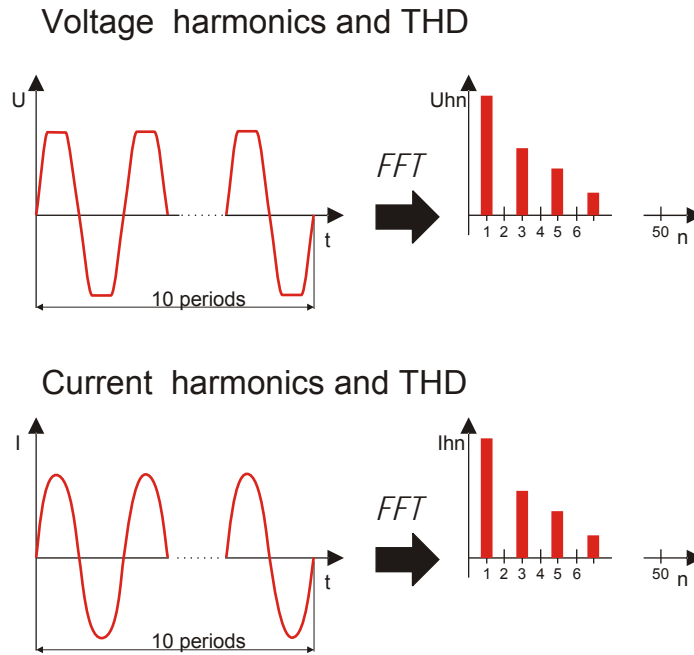


Figure 5.4: Current and voltage harmonics

$$u(t) = c_0 + \sum_{k=1}^{512} c_k \sin\left(\frac{k}{10} \cdot 2\pi f_1 t + \varphi_k\right) \quad (17)$$

$f_1$  – frequency of signal fundamental (in example: 50 Hz)

$c_0$  – DC component

$k$  – ordinal number (order of the spectral line) related to the frequency basis  $f_{c1} = \frac{1}{T_N}$

$T_N$  – is the width (or duration) of the time window ( $T_N = N \cdot T_1$ ;  $T_1 = 1/f_1$ ). Time window is that time span of a time function over which the Fourier transformation is performed.

$c_k$  – is the amplitude of the component with frequency  $f_{ck} = \frac{k}{10} f_1$

$\varphi_k$  – is the phase of the component  $c_k$

$U_{c,k}$  – is the RMS value of component  $c_k$

Phase voltage and current harmonics are calculated as RMS value of harmonic subgroup (sg): square root of the sum of the squares of the RMS value of a harmonic and the two spectral components immediately adjacent to it.

$$\text{n-th voltage harmonic: } U_p h_n = \sqrt{\sum_{k=-1}^1 U_{C,(10\cdot n)+k}^2} \quad p: 1,2,3 \quad (18)$$

$$\text{n-th current harmonic: } I_p h_n = \sqrt{\sum_{k=-1}^1 I_{C,(10\cdot n)+k}^2} \quad p: 1,2,3 \quad (19)$$

Total harmonic distortion is calculated as ratio of the RMS value of the harmonic subgroups to the RMS value of the subgroup associated with the fundamental:

$$\text{Total voltage harmonic distortion: } THD_{U_p} = \sqrt{\sum_{n=2}^{40} \left( \frac{U_p h_n}{U_p h_1} \right)^2}, \quad p: 1,2,3 \quad (20)$$

$$\text{Total current harmonic distortion: } THD_{I_p} = \sqrt{\sum_{n=2}^{40} \left( \frac{I_p h_n}{I_p h_1} \right)^2}, \quad p: 1,2,3 \quad (21)$$

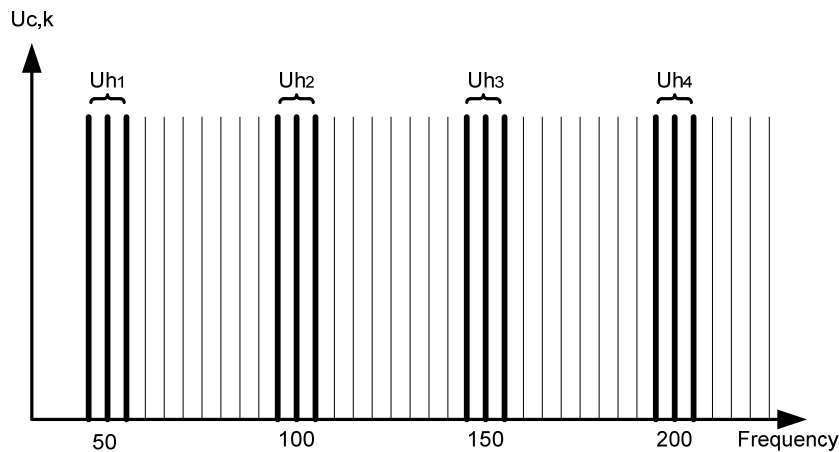


Figure 5.5: Illustration of harmonics subgroup for 50 Hz supply

### 5.1.9 Voltage and current unbalance

Standard compliance: IEC 61000-4-30 Class B (Section 5.7.1)

The supply voltage unbalance is evaluated using the method of symmetrical components. In addition to the positive sequence component  $U^+$ , under unbalanced conditions there also exists negative sequence component  $U^-$  and zero sequence component  $U_0$ . These quantities are calculated according to the following equations:

$$\begin{aligned} \vec{U}^+ &= \frac{1}{3}(\vec{U}_1 + a\vec{U}_2 + a^2\vec{U}_3) \\ \vec{U}_0 &= \frac{1}{3}(\vec{U}_1 + \vec{U}_2 + \vec{U}_3), \\ \vec{U}^- &= \frac{1}{3}(\vec{U}_1 + a^2\vec{U}_2 + a\vec{U}_3), \end{aligned} \quad (22)$$

where  $a = \frac{1}{2} + \frac{1}{2}j\sqrt{3} = 1e^{j120^\circ}$ .



For unbalance calculus, instrument use the fundamental component of the voltage input signals ( $U_1$ ,  $U_2$ ,  $U_3$ ), measured over a 10-cycle time interval.

The negative sequence ratio  $u^-$ , expressed as a percentage, is evaluated by:

$$u^- (\%) = \frac{U^-}{U^+} \times 100 \quad (23)$$

The zero sequence ratio  $u^0$ , expressed as a percentage, is evaluated by:

$$u^0 (\%) = \frac{U^0}{U^+} \times 100 \quad (24)$$

**Note:** In 3W systems zero sequence components  $U_0$  and  $I_0$  are by definition zero.

The supply current unbalance is evaluated in same fashion.

### 5.1.10 Voltage events

*Voltage dips ( $U_{Dip}$ ), swells ( $U_{Swell}$ ), minimum ( $U_{Rms(1/2)Min}$ ) and maximum ( $U_{Rms(1/2)Max}$ ) measurement method*

*Standard compliance: IEC 61000-4-30 Class B (Section 5.4.1)*

The basic measurement for event is  $U_{Rms(1/2)}$ .

$U_{Rms(1/2)}$  is value of the RMS voltage measured over 1 cycle, commencing at a fundamental zero crossing and refreshed each half-cycle.

The cycle duration for  $U_{Rms(1/2)}$  depends on the frequency, which is determined by the last 10-cycle frequency measurement. The  $U_{Rms(1/2)}$  value includes, by definition, harmonics, mains signalling voltage, etc.

#### **Voltage dip**

*Standard compliance: IEC 61000-4-30 Class B (Section 5.4.2)*

The dip threshold is a percentage of Nominal voltage defined in EVENT SETUP menu. The dip threshold can be set by the user according to the use. Instrument event evaluation depends on Connection type:

- On single-phase systems, a voltage dip begins when the  $U_{Rms(1/2)}$  voltage falls below the dip threshold, and ends when the  $U_{Rms(1/2)}$  voltage is equal to or above the dip threshold plus the 2% of hysteresis voltage (see Figure 5.6)
- On three-phase systems two different evaluation techniques can be used for evaluation simultaneously:
  - a dip begins when the  $U_{Rms(1/2)}$  voltage of one or more channels is below the dip threshold and ends when the  $U_{Rms(1/2)}$  voltage on all measured channels is equal to or above the dip threshold plus the 2% of hysteresis voltage.
  - a voltage dip begins when the  $U_{Rms(1/2)}$  voltage of one channel falls below the dip threshold, and ends when the  $U_{Rms(1/2)}$  voltage is equal to or above the dip threshold plus the 2% of hysteresis voltage, on the same phase.

A voltage dip is characterized by a pair of data: residual voltage  $U_{Dip}$  and dip duration:

- $U_{Dip}$  is the residual voltage, the lowest  $U_{Rms(1/2)}$  value measured on any channel during the dip.
- The start time of a dip is time stamped with the time of the start of the  $U_{Rms(1/2)}$  of the channel that initiated the event, and the end time of the dip is time stamped with the time of the end of the  $U_{Rms(1/2)}$  that ended the event, as defined by the threshold.

- The duration of a voltage dip is the time difference between the start time and the end time of the voltage dip.

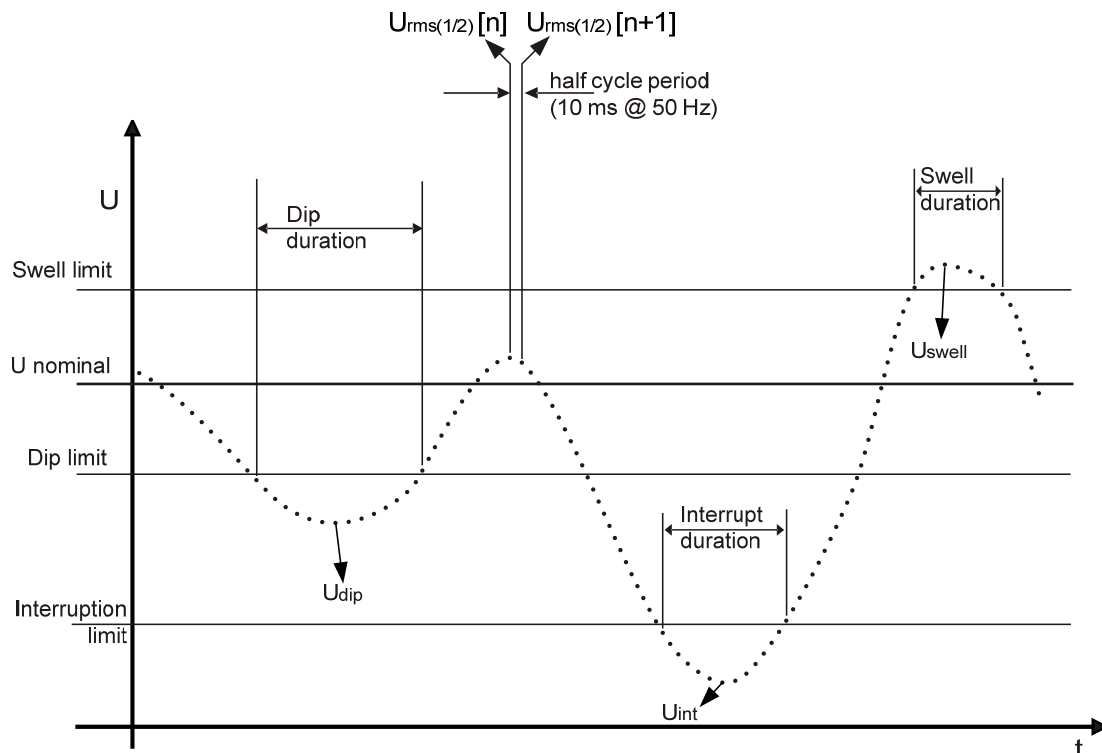


Figure 5.6 Voltage events definition

### Voltage swell

Standard compliance: IEC 61000-4-30 Class B (Section 5.4.3)

The swell threshold is a percentage of nominal voltage defined in Voltage events setup menu. The swell threshold can be set by the user according to the use. Instrument permits swell evaluation:

- on single-phase systems, a voltage swell begins when the  $U_{Rms(1/2)}$  voltage rises above the swell threshold, and ends when the  $U_{Rms}$  voltage is equal to or below the swell threshold plus the 2% of hysteresis voltage (see Figure 5.6),
- on three-phase systems two different evaluation techniques can be used for evaluation simultaneously:
  - A swell begins when the  $U_{Rms(1/2)}$  voltage of one or more channels is above the swell threshold and ends when the  $U_{Rms(1/2)}$  voltage on all measured channels is equal to or below the swell threshold plus the 2% of hysteresis voltage.
  - A swell begins when the  $U_{Rms(1/2)}$  voltage of one channel rises above the swell threshold, and ends when the  $U_{Rms(1/2)}$  voltage is equal to or below the swell threshold plus the 2% of hysteresis voltage, on the same phase.

A voltage swell is characterized by a pair of data: maximum swell voltage magnitude, and duration:

- $U_{Swell}$  – maximum swell magnitude voltage is the largest  $U_{Rms(1/2)}$  value measured on any channel during the swell.

- The start time of a swell is time stamped with the time of the start of the  $U_{Rms(1/2)}$  of the channel that initiated the event and the end time of the swell is time stamped with the time of the end of the  $U_{Rms(1/2)}$  that ended the event, as defined by the threshold.
- The duration of a voltage swell is the time difference between the beginning and the end of the swell.

### Voltage interrupt

Standard compliance: IEC 61000-4-30 Class B (Section 5.5)

Measuring method for voltage interruptions detection is same as for dips and swells, and is described in previous sections.

The interrupt threshold is a percentage of nominal voltage defined in Voltage events setup menu. The interrupt threshold can be set by the user according to the use. Instrument permits interrupt evaluation:

- On single-phase systems, a voltage interruption begins when the  $U_{Rms(1/2)}$  voltage falls below the voltage interruption threshold and ends when the  $U_{Rms(1/2)}$  value is equal to, or greater than, the voltage interruption threshold plus the hysteresis (see Figure 5.6),
- on polyphase systems two different evaluation techniques can be used for evaluation simultaneously:
  - a voltage interruption begins when the  $U_{Rms(1/2)}$  voltages of all channels fall below the voltage interruption threshold and ends when the  $U_{Rms(1/2)}$  voltage on any one channel is equal to, or greater than, the voltage interruption threshold plus the hysteresis.
  - a voltage interrupt begins when the  $U_{Rms(1/2)}$  voltage of one channel fall below the interrupt threshold, and ends when the  $U_{Rms(1/2)}$  voltage is equal to or above the interrupt threshold plus the 2% of hysteresis voltage, on the same phase.

A voltage interrupt is characterized by a pair of data: minimal interrupt voltage magnitude, and duration:

- $U_{Int}$  – minimum interrupt magnitude voltage is the lowest  $U_{Rms(1/2)}$  value measured on any channel during the interrupt.
- The start time of a interrupt is time stamped with the time of the start of the  $U_{Rms(1/2)}$  of the channel that initiated the event, and the end time of the interrupt is time stamped with the time of the end of the  $U_{Rms(1/2)}$  that ended the event, as defined by the threshold.
- The duration of a voltage dip is the time difference between the start time and the end time of the voltage dip.

### 5.1.11 Data aggregation in GENERAL RECORDING

Standard compliance: IEC 61000-4-30 Class B (Section 4.5.3)

Time aggregation period (IP) during recording is defined with parameter Interval: x min in RECORDER menu.

A new recording interval commence after previous interval run out, at the beginning of the next 10 cycle time interval. The data for the IP time interval are aggregated from 10-cycle time intervals, according to the figure bellow. The aggregated interval is tagged with the absolute time. The time tag is the time at the conclusion of the interval. There is no gap or overlap, during recording, as illustrated on figure below.

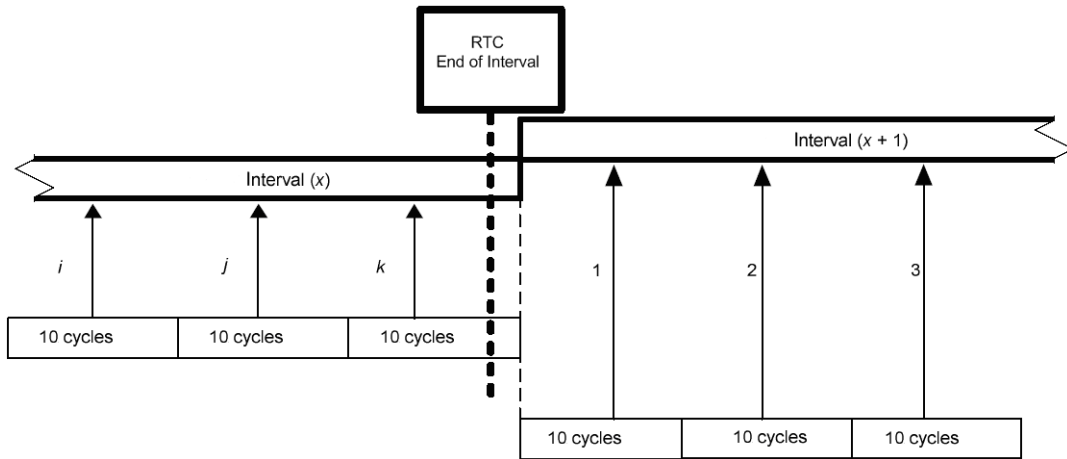


Figure 5.7: Synchronization and aggregation of 10 cycle intervals

For each aggregation interval instrument computes average value for measured quantity. Depending from the quantity, this can be RMS (root means square) or arithmetical average. Equations for both averages are shown below.

RMS average 
$$A_{RMS} = \sqrt{\frac{1}{N} \sum_{j=1}^N A_j^2}$$
 (25)

Where:

- $A_{RMS}$  – quantity average over given aggregation interval
- $A$  – 10-cycle quantity value
- $N$  – number of 10 cycles measurements per aggregation interval.

Arithmetic average: 
$$A_{avg} = \frac{1}{N} \sum_{j=1}^N A_j$$
 (26)

Where:

- $A_{avg}$  – quantity average over given aggregation interval
- $A$  – 10-cycle quantity value
- $N$  – number of 10 cycles measurements per aggregation interval.

In the next table averaging method for each quantity is specified:

Table 5.1: Data aggregation methods

Group	Value	Aggregation method
Voltage	$U_{Rms}$	RMS
	$THD_U$	RMS
	$U_{cf}$	Arithmetic
Current	$I_{Rms}$	RMS
	$THD_I$	RMS
	$I_{cf}$	Arithmetic
Frequency	$f$	Arithmetic
Power	$P$	Arithmetic

	Q	Arithmetic
	S	Arithmetic
	PF	Arithmetic
	DPF (cos φ)	Arithmetic
Symmetry	U <sup>+</sup>	RMS
	U <sup>-</sup>	RMS
	U <sup>0</sup>	RMS
	u-	RMS
	u0	RMS
	I <sup>+</sup>	RMS
	I <sup>-</sup>	RMS
	I <sup>0</sup>	RMS
	i-	RMS
	i0	RMS
Harmonics	Uh <sub>1+50</sub>	RMS
	Ih <sub>1+50</sub>	RMS

Parameter which will be recorded during recording session depends on **Connection** and **Synchronization** channel, as shown in

Table 4.3. For each parameter:

- minimum,
- average,
- maximum,
- active average,

value is recorded per time-interval.

**Note:** In EN 50160 recording only average values are stored. In order to perform EN50160 recording with minimum and maximum values, use general type of recording and later convert it into EN50160 type of record by using Powerview v2.0 software. An *active average* value is calculated upon the same principle (arithmetic or RMS) as average value, but taking in account just measurements with “active” attribute set:

$$\text{RMS active average} \quad A_{RMSact} = \sqrt{\frac{1}{M} \sum_{j=1}^M A_j^2}; M \leq N \quad (27)$$

Where:

$A_{RMSact}$  – quantity average over active part of given aggregation interval,

A – 10-cycle quantity value marked as “active”,

M – number of 10 cycles measurements with active value.

$$\text{Arithmetic active average:} \quad A_{avgact} = \frac{1}{M} \sum_{j=1}^M A_j; M \leq N \quad (28)$$

Where:

$A_{avgact}$  – quantity average over active part of given aggregation interval,

A – 10-cycle quantity value in “active” part of interval,

M – number of 10 cycles measurements with active value.

Active attribute for particular quantity is set if:

- Phase/line RMS value is greater than lower limit of a measuring range (details in technical specification): voltage and current effective value, harmonics and THD.
- Type of a load coincides with two- or four-quadrant area (details in *Power and energy recording*): active, reactive and apparent power, power factor and displacement power factor.

Frequency and unbalance measurement are always considered as active values for recording.

Table below show number of signals for each parameter group in RECORDER.

Table 5.2: Total number of recorded quantities

	1W	3W	4W
<b>U,I,f</b>	13 quantities 52 values per interval	20 quantities 80 values per interval.	35 quantities 140 values per interval.
<b>Power &amp; Energy</b>	16 quantities 64 values per interval	12 quantities 48 values per interval	60 quantities 240 values per interval
<b>Symmetry</b>	–	2 quantities 8 values per interval	4 quantities 16 values per interval
<b>Harmonics</b>	202 quantities 800	303 quantities 1212 values per interval	416 quantities 1628 values per interval
<b>Total</b>	235	347	524

### **Power and energy recording**

Active power is divided into two parts: import (positive-motor) and export (negative-generator). Reactive power and power factor are divided into four parts: positive inductive (+i), positive capacitive (+c), negative inductive (-i) and negative capacitive (-c).

Motor/generator and inductive/capacitive phase/polarity diagram is shown on figure below:

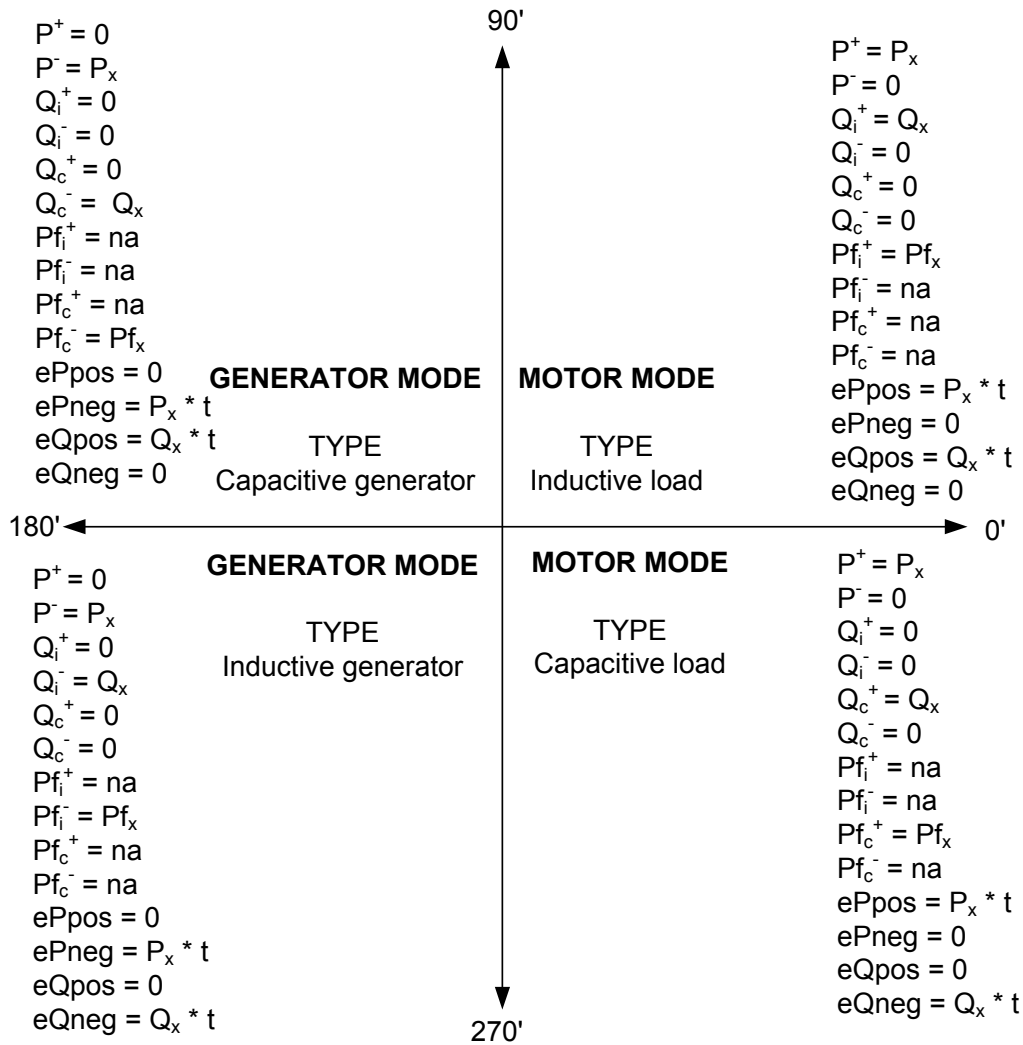


Figure 5.8: Motor/generator and inductive/capacitive phase/polarity diagram

### 5.1.12 Inrush/Fast recorder

Inrush/Fast recorder is intended for analysis of voltage and current fluctuations during start of motor or other high power consumers. For current  $I_{1/2Rms}$  value (half cycle period RMS current refreshed each half cycle) is measured, while for voltage  $U_{Rms(1/2)}$  values (one cycle RMS voltage refreshed each half cycle) is measured for each interval. If user choose 10ms interval in Inrush/Fast recorder menu, then this measured values for half cycle will be also stored in record. If user choose larger interval 20ms, 100ms or 200ms, instrument average 2, 10 or 20 measurements and use it for further actions (triggering, recording). Inrush/Fast recorder starts when the preset trigger occurs.


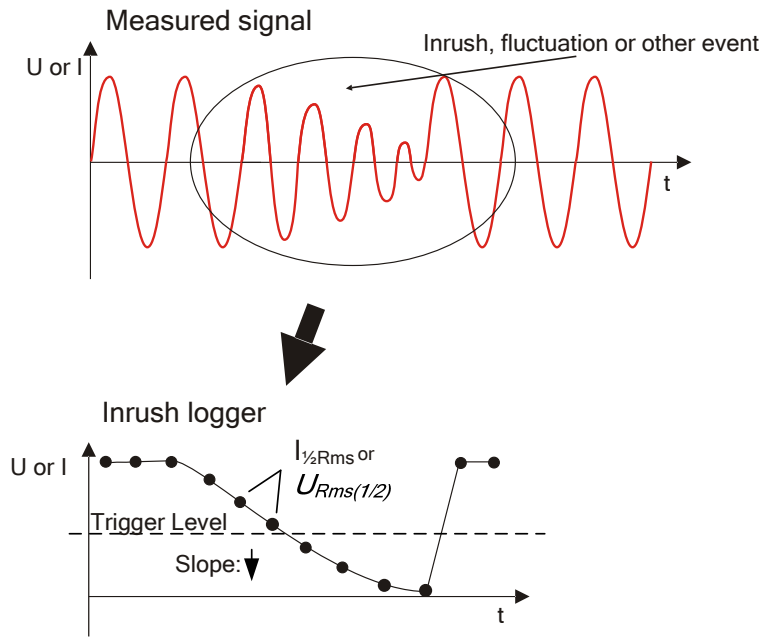


Figure 5.9: Inrush (waveform and RMS)


Storage buffer is divided into pre-buffer (measured values before trigger point) and post-buffer (measured values after trigger point).

Triggering

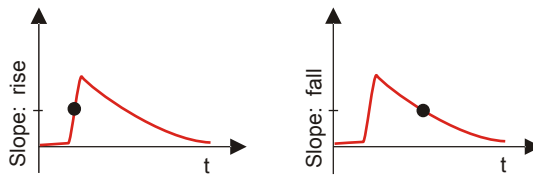

Input: I1, I2, I3, IN  
 U1, U2, U3, UN - trigger channels  
 Level: predefined TRMS value  
 Slope: rise / fall / both

Pre-buffer and post-buffer

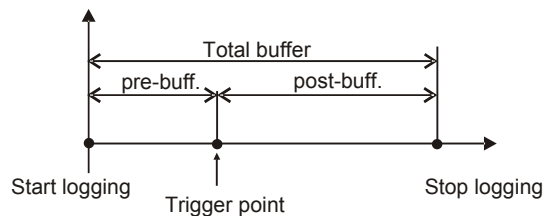

Pre-buffer: 0 to (Total buffer - 1)  
 Pre-buffer is treated as negative time

Figure 5.10: Inrush triggering



User can choose to perform single or continuous inrush loggings. If continuous inrush logging is performed, PowerQ / PowerQ Plus will automatically initialize next inrush logging upon completion of the previous one. Two *initial* consecutive inrush loggings can be performed without “dead time” in between. The third inrush logging will be initialized only when the first one is being completely saved to the instrument data memory. Dead time is proportional to record duration and number of selected recording signals, and usually takes few seconds.

**Note:** Interval and triggering threshold are dependent. If user select **Interval: 10ms**, then instrument will trigger if value crosses the threshold for half cycle. If user select **Interval: 200ms**, then at least 20 successive half-cycle measurements, should cross the trigger value prior triggering.

## 5.2 EN 50160 Standard Overview

EN 50160 standard define, describe and specify the main characteristics of the voltage at a network user’s supply terminals in public low voltage and medium voltage distribution networks under normal operating conditions. This standard describe the limits or values within which the voltage characteristics can be expected to remain over the whole of the public distribution network and do not describe the average situation usually experienced by an individual network user. An overview of EN 50160 limits are presented on table below.

Table 5.3: EN 50160 standard overview

Supply phenomenon	voltage	Acceptable limits	Meas. Interval	Monitoring Period	Acceptance Percentage
Power frequency		49.5 ÷ 50.5 Hz 47.0 ÷ 52.0 Hz	10 s	1 Week	99,5% 100%
Supply voltage variations, $U_{Nom}$		230V ± 10% 230V +10% -15%	10 min	1 Week	95% 100%
Flicker severity Plt		Plt ≤ 1	2 h	1 Week	95%
Voltage Dips (≤1min)		10 to 1000 times (under 85% of $U_{Nom}$ )	10 ms	1 Year	100%
Short Interruptions (≤ 3min)		10 ÷ 100 times (under 1% of $U_{Nom}$ )	10 ms	1 Year	100%
Accidental long interruptions (> 3min)		10 ÷ 50 times (under 1% of $U_{Nom}$ )	10 ms	1 Year	100%
Voltage unbalance u-		0 ÷ 2 %, occasionally 3%	10 min	1 Week	95%
Total harm. distortion, THD <sub>U</sub>		8%	10 min	1 Week	95%
Harmonic Voltages, $U_{h_n}$		See Table 5.4	10 min	1 Week	95%
Mains signalling		See Figure 5.12	2 s	1 Day	99%

### 5.2.1 Power frequency

The nominal frequency of the supply voltage shall be 50 Hz, for systems with synchronous connection to an interconnected system. Under normal operating conditions the mean value of the fundamental frequency measured over 10 s shall be within a range of:

50 Hz  $\pm$  1 % (49,5 Hz .. 50,5 Hz) during 99,5 % of a year;  
 50 Hz + 4 % / - 6 % (i.e. 47 Hz .. 52 Hz) during 100 % of the time.

### 5.2.2 Supply voltage variations

Under normal operating conditions, during each period of one week 95 % of the 10 min mean  $U_{Rms}$  values of the supply voltage shall be within the range of  $U_{Nom} \pm 10$  %, and all  $U_{Rms}$  values of the supply voltage shall be within the range of  $U_{Nom} + 10$  % / - 15 %.

### 5.2.3 Voltage dips (Indicative values)

Under normal operating conditions the expected number of voltage dips in a year may be from up to a few tens to up to one thousand. The majority of voltage dips have duration less than 1 s and a retained voltage greater than 40 %. However, voltage dips with greater depth and duration can occur infrequently. In some areas voltage dips with a retained voltage between 85 % and 90 % of  $U_{Nom}$  can occur very frequently as a result of the switching of loads in network users' installations.

### 5.2.4 Short interruptions of the supply voltage

Under normal operating conditions the annual occurrence of short interruptions of the supply voltage ranges from up to a few tens to up to several hundreds. The duration of approximately 70 % of the short interruptions may be less than one second.

### 5.2.5 Long interruptions of the supply voltage

Under normal operating conditions the annual frequency of accidental voltage interruptions longer than three minutes may be less than 10 or up to 50 depending on the area.

### 5.2.6 Supply voltage unbalance

Under normal operating conditions, during each period of one week, 95 % of the 10 min mean RMS values of the negative phase sequence component (fundamental) of the supply voltage shall be within the range 0 % to 2 % of the positive phase sequence component (fundamental). In some areas with partly single phase or two-phase connected network users' installations, unbalances up to about 3 % at three-phase supply terminals occur.

### 5.2.7 THD voltage and harmonics

Under normal operating conditions, during each period of one week, 95 % of the 10 min mean values of each individual harmonic voltage shall be less or equal to the value given in table below.

Moreover,  $THD_U$  values of the supply voltage (including all harmonics up to the order 40) shall be less than or equal to 8 %.

Table 5.4: Values of individual harmonic voltages at the supply

Odd harmonics				Even harmonics	
Not Multiples of 3		Multiples of 3		Order h	Relative voltage ( $U_N$ )
Order h	Relative voltage ( $U_N$ )	Order h	Relative voltage ( $U_N$ )		
5	6,0 %	3	5,0 %	2	2,0 %
7	5,0 %	9	1,5 %	4	1,0 %

11	3,5 %	15	0,5 %	6..24	0,5 %
13	3,0 %	21	0,5 %		
17	2,0 %				
19	1,5 %				
23	1,5 %				
25	1,5 %				

### 5.2.8 Interharmonic voltage

The level of interharmonics is increasing due to the development of frequency converters and similar control equipment. Levels are under consideration, pending more experience. In certain cases interharmonics, even at low levels, give rise to flicker (see 5.2.10), or cause interference in ripple control systems.

### 5.2.9 Mains signalling on the supply voltage

In some countries the public distribution networks may be used by the public supplier for the transmission of signals. Over 99 % of a day the 3 s mean of signal voltages shall be less than or equal to the values given in the following figure.

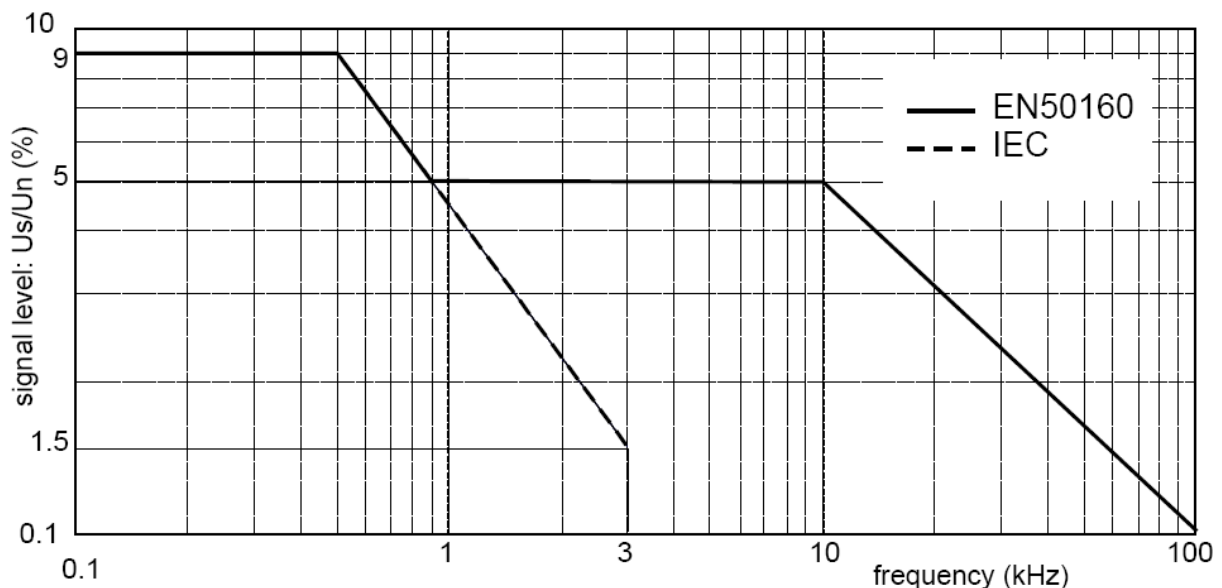


Figure 5.11: Mains Signalling voltage level limits according to EN50160

### 5.2.10 Flicker severity

Under normal operating conditions, in any period of one week the long term flicker severity caused by voltage fluctuation should be  $P_{f \leq 1} \leq 1$  for 95 % of the time.

### 5.2.11 PowerQ / PowerQ Plus recorder setting for EN 50160 survey

PowerQ / PowerQ Plus are able to perform EN 50160 surveys on all values described in previous sections. In order to simplify procedure, PowerQ / PowerQ Plus has predefined recorder configuration (EN50160) for it. By default all current parameters (RMS, THD, etc.) are also included in survey, which can provide additional survey informations. Additionally, during voltage quality survey user can simultaneously record other parameters too, such as power, energy and current harmonics.

In order to collect voltage events during recording, **Include voltage events** option in recorder should be enabled. See section 3.4.2 for voltage events settings.

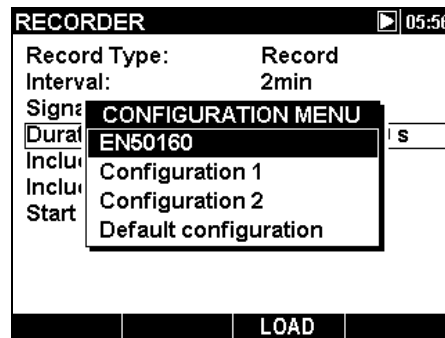


Figure 5.12: Predefined EN50160 recorder configuration

After recording is finished, EN 50160 survey is *performed* on PowerView v2.0 software. See PowerView v2.0 manual or details.

**Note:** In EN 50160 recording only average values are stored.

## 6 Technical specifications

### 6.1 Measuring system

Configuration	3-phase, 3xI, 3xU input		
Sampling rate	5120 Hz @ 50 Hz		
Basic calculation rates (METER, SCOPE, LOGGER mode)	U,I,f	200 ms,	no gaps
	Harmonics	200 ms,	no gaps
	Power	200 ms,	no gaps
	Energy	200 ms,	no gaps

### 6.2 Measurements

**NOTE:** Error of external voltage and current transducers is not considered in this specification!

#### 6.2.1 Voltage

Input voltage range: Lx-N 600  $V_{RMS}$  (single phase or 3 phase 4 wire)

Lx-Ly 1039  $V_{RMS}$

Input impedance: Lx-N 3 M $\Omega$ , Lx-Ly 3 M $\Omega$

TRMS, AC+DC, Lx-N, connection

Measuring (indication) range	Resolution	Accuracy	Crest factor
Range 1: 3.0 (0.0) $V_{RMS} \div 70.0 V_{RMS}$	0.1 V	$\pm(1 \% + 0.5 V)$	1.4 min
Range 2: 5.0 (0.0) $V_{RMS} \div 130.0 V_{RMS}$		$\pm(1 \% + 0.8 V)$	
Range 3: 10.0 (0.0) $V_{RMS} \div 300.0 V_{RMS}$		$\pm(1 \% + 1.5 V)$	
Range 4: 20.0 (0.0) $V_{RMS} \div 600.0 V_{RMS}$		$\pm(1 \% + 2.5 V)$	

TRMS, AC+DC, Lx-Ly connection

Measuring (indication) range	Resolution	Accuracy	Crest factor
Range 1: 5.2 (0.0) $V_{RMS} \div 121.0 V_{RMS}$	0.1 V	$\pm(2 \% + 1.0 V)$	1.4 min
Range 2: 8.6 (0.0) $V_{RMS} \div 225.0 V_{RMS}$		$\pm(2 \% + 1.6 V)$	
Range 3: 17.3 (0.0) $V_{RMS} \div 519.0 V_{RMS}$		$\pm(2 \% + 3.0 V)$	
Range 4: 34.6 (0.0) $V_{RMS} \div 1039 V_{RMS}$	0.1 / 1V	$\pm(2 \% + 5.0 V)$	

#### 6.2.2 Current

Input impedance: 1 M $\Omega$

TRMS, AC+DC

Measuring (indication) range	Resolution	Accuracy	Crest factor
Range 1: 4.0 (0.0) $mV_{RMS} \div 100 mV_{RMS}$ (4 $\div$ 100) A*	0.1 A	$\pm(2 \% + 0.3 A)$	2.3 min
Range 2: 0.04 (0.00) $V_{RMS} \div 1 V_{RMS}$ (40 $\div$ 1000) A*		$\pm(2 \% + 3 A)$	

- with current clamp A1033

### 6.2.3 Frequency

Measuring range	Resolution	Accuracy
45.00 Hz ÷ 66.00 Hz	10 mHz	±(0.5 % + 0.02 Hz)

### 6.2.4 Power (W, VA, VAR)

Product of Urange, Uinpk, Irange and Iinpk	Measuring range (W, VA, Var)	Resolution (W, VA, Var)	Accuracy*	Comment
7 ÷ 999	0.000 k ÷ 0.999 k	1	±(3 % + 3 dig)	Four quadrant results
1,000 ÷ 9,999	0.00 k ÷ 9.99 k	10		
10,000 ÷ 999,999	0.0 k ÷ 999.9 k	100		
1,000,000 ÷ 9,999,999	0.000 M ÷ 9.999 M	1 k		
10,000,000 ÷ 99,999,999	0.00 M ÷ 99.99 M	10 k		
100,000,000 ÷ 999,999,999	0.0 M ÷ 999.9 M	100 k		
1,000,000,000 ÷ 9,999,999,999	0.000 G ÷ 9.999 G	1 M		
10,000,000,000 ÷ 40,000,000,000	0.00 G ÷ 40.00 G	10 M		

\*Accuracy values are valid if  $\cos \varphi \geq 0.40$ ,  $PF \geq 0.40$ ,  $I \geq 10 \% I_N$  and  $U \geq 10 \% U_N$ , otherwise stated values should be multiplied by two.

### 6.2.5 Power factor

Measuring range	Resolution	Accuracy	Comment
0.00 ÷ 0.39	0.01	±0.06	Four quadrant results
0.40 ÷ 1.00	0.01	±0.03	Four quadrant results

### 6.2.6 Cosinus $\varphi$

Measuring range	Resolution	Accuracy	Comment
0.00 ÷ 0.39	0.01	±0.06	Four quadrant results
0.40 ÷ 1.00	0.01	±0.03	Four quadrant results

### 6.2.7 Energy (Wh, VAh, VARh)

Product of Urange, UinpK, Irange and IinpK	Measuring range (Wh, VAh, Varh)	Resolution (Wh, VAh, Varh)	Accuracy*	Comment
7 ÷ 999	0.000 k ÷ 40,000,000.000 k	1	±(3 % + 3 Wh)	Four quadrant results
1,000 ÷ 9,999			±(3 % + 30 Wh)	
10,000 ÷ 999,999			±(3 % + 300 Wh)	
1,000,000 ÷ 9,999,999			±(3 % + 3 kWh)	
10,000,000 ÷ 99,999,999	0.000 k ÷ 40,000,000.000 k	1	±(3 % + 30 kWh)	Four quadrant results
100,000,000 ÷ 999,999,999			±(3 % + 300 kWh)	
1,000,000,000 ÷ 9,999,999,999			±(3 % + 3 MWh)	
10,000,000,000 ÷ 40,000,000,000			±(3 % + 30 MWh)	

\* Accuracy values are valid if  $\cos \varphi \geq 0.40$ ,  $PF \geq 0.40$ ,  $I \geq 10 \% I_N$  and  $U \geq 10 \% U_N$ , otherwise stated values should be multiplied by two.

### 6.2.8 Voltage harmonics

Measuring range	Resolution	Accuracy
$U_M > 3 \% U_N$	0.1 %	5 % $U_M$ (3 % for DC)
$U_M < 3 \% U_N$	0.1 %	0.15 % $U_N$

$U_N$ : nominal voltage (TRMS)

$U_M$ : measured harmonic voltage  $h_M$ : 1<sup>st</sup> ÷ 50<sup>th</sup>

### 6.2.9 Current harmonics

Harmonics range	Resolution	Accuracy
$I_M > 3 \% I_N$	0.1 %	5 % $I_M$ (3 % for DC)
$I_M < 3 \% I_N$	0.1 %	0.15 % $I_N$

$I_N$ : nominal range (TRMS)

$I_M$ : harmonic current  $h_M$ : 1<sup>st</sup> ÷ 50<sup>th</sup>

## 6.2.10 Unbalance

		Unbalance range	Resolution	Accuracy
SymU	U <sub>+</sub> /U <sub>-</sub>	0.0 ÷ 5.0%	0.1 %	0.15%
SymI	I <sub>+</sub> /I <sub>-</sub>	0.0 ÷ 20%	0.1 %	1%

SymU: voltage unbalance (%)  
 SymI: current unbalance (%)  
 U<sub>+</sub>: positive sequence voltage  
 U<sub>-</sub>: negative sequence voltage  
 I<sub>+</sub>: positive sequence current  
 I<sub>-</sub>: negative sequence current

## 6.3 Recorders

### 6.3.1 General recorder

Sampling	5 readings per second, continuous sampling per channel. All channels are sampled simultaneously. Sampling frequency is continuously synchronized with main frequency.					
Recording time	From 30 min with 1 second display resolution up to 99 days with 1 hour display resolution.					
Recording quantities	1 ÷ 513 parameters can be recorded. For each parameter minimum, maximal average and active average value is stored.					
Rec. interval	1 s	3 s	5 s	10 s	1 min	2 min
Rec. duration (100 param.)	2:41 hr	8 hrs	13 hrs	1 day	6 days	13 days
Rec. duration (513 param.)	32 min	1:38 hrs	2:44 hrs	5 hrs	1 day	2 days
Rec. interval	5 min	10 min	15 min	30 min	60 min	
Duration (513 param.)	33 days	99days	56 days	99 days	99 days	
Rec. duration (513 param.)	6 days	13 days	20 days	41 days	82 days	
Events	Up to 1000 voltage events signatures can be stored into record					
Trigger	Start time or manual					

### 6.3.2 Inrush/fast recorder<sup>1</sup>

Sampling	1 reading per half-cycle ÷ 1 reading per 10-cycles (for 50 Hz mains frequency: 5 to 100 readings per second) All channels are sampled simultaneously. Sampling frequency is continuously synchronized with mains frequency.
Recording time	From 1 s ÷ 3 min
Recording type	Single – inrush recording ends after first trigger <b>Continuous</b> – consecutive inrush recording until user stops the measurement or instrument runs out of storage memory.

<sup>1</sup> PowerQ Plus only



Recording quantities	$U_{1Rms(1/2)}, U_{2Rms(1/2)}, U_{3Rms(1/2)}, (U_{12Rms(1/2)}, U_{23Rms(1/2)}, U_{31Rms(1/2)}), I_{1\frac{1}{2}Rms}, I_{2\frac{1}{2}Rms}, I_{3\frac{1}{2}Rms}$			
	For 50 Hz mains frequency			
No. of signals	1	2	4	8
Duration	686 s	514 s	343 s	205 s
Trigger	Percent of nominal voltage or current range (rise, fall or both edges)			

## 6.4 General specifications

Working temperature range:	-10 °C ÷ +50 °C
Storage temperature range:	-20 °C ÷ +70 °C
Max. humidity:	95 % RH (0 °C ÷ 40 °C), non-condensing
Pollution degree:	2
Protection classification:	double insulation
Over voltage category:	voltage inputs: CAT IV 600 V, (altitude: < 2000 m) CAT III 600 V, (altitude: 4500 m max.)
Protection degree:	IP 42
Dimensions:	(220 x 115 x 90) mm
Weight (without accessories):	0.65 kg
External DC supply:	12 V, 1 A
Maximum power consumption:	4.5 W

## 6.5 Communication

### 6.5.1 RS-232 serial interface

Baud rate:	2400 baud ÷ 115200 baud
Connector:	9 pin D-type

### 6.5.2 USB interface

Baud rate:	2400 baud ÷ 921600 baud
Connector:	Standard USB Type B

## 6.6 Display

Display: graphic liquid crystal display with backlight, 340 x 200 dots.

## 6.7 Non - Volatile memory

8 MB Flash

## 7 Maintenance

### 7.1 Inserting batteries into the instrument

1. Make sure that the power supply adapter/charger and measurement leads are disconnected and the instrument is switched off.
2. Insert batteries as shown in figure below (insert batteries correctly, otherwise the instrument will not operate and the batteries could be discharged or damaged).

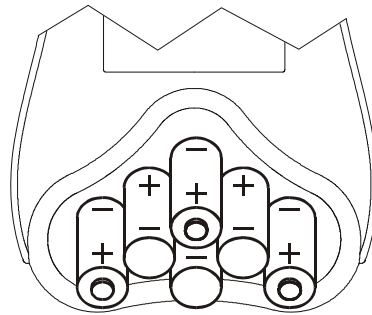


Figure 7.1: Battery placement

3. Turn the display side of the instrument lower than the battery holder (see figure below) and put the cover on the batteries.

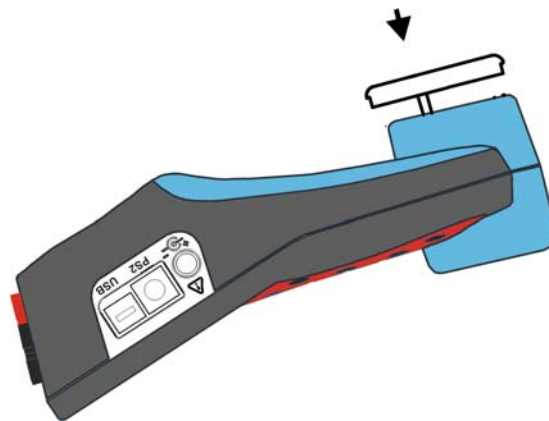


Figure 7.2: Closing the battery holder

4. Screw the cover on the instrument.  
If the instrument is not going to be used for a long period of time remove all batteries from the battery holder. The enclosed batteries can supply the instrument for approx. 15 hours.

#### Warnings!

- When battery cells have to be replaced, turn off the instrument before opening battery compartment cover.

- **Hazardous voltages exist inside the instrument. Disconnect all test leads and remove the power supply cable before removing battery compartment cover.**
- **Use only power supply adapter/charger delivered from manufacturer or distributor of the equipment to avoid possible fire or electric shock.**
- **Rechargeable NiMh batteries type HR 6 (size AA) are recommended. The charging time and the operating hours are given for batteries with a nominal capacity of 2500 mAh.**
- **Do not use standard batteries while power supply adapter/charger is connected, otherwise they may explode!**
- **Do not mix batteries of different types, brands, ages, or charge levels.**
- **When charging batteries for the first time, make sure to charge batteries for at least 24 hours before switching on the instrument.**

## 7.2 Batteries

Instrument contains rechargeable NiMh batteries. These batteries should only be replaced with the same type as defined on the battery placement label or in this manual. If it is necessary to replace batteries, all six have to be replaced. Ensure that the batteries are inserted with the correct polarity; incorrect polarity can damage the batteries and/or the instrument.

### ***Precautions on charging new batteries or batteries unused for a longer period***

Unpredictable chemical processes can occur during charging new batteries or batteries that were unused for a longer period of time (more than 3 months). NiMH and NiCd batteries are affected to a various degree (sometimes called as memory effect). As a result the instrument operation time can be significantly reduced at the initial charging/discharging cycles.

Therefore it is recommended:

- To completely charge the batteries
- To completely discharge the batteries (can be performed with normal working with the instrument).
- Repeating the charge/discharge cycle for at least two times (four cycles are recommended).

When using external intelligent battery chargers one complete discharging /charging cycle is performed automatically.

After performing this procedure a normal battery capacity is restored. The operation time of the instrument now meets the data in the technical specifications.

### **Notes**

The charger in the instrument is a pack cell charger. This means that the batteries are connected in series during the charging so all batteries have to be in similar state (similarly charged, same type and age).

Even one deteriorated battery (or just of another type) can cause an improper charging of the entire battery pack (heating of the battery pack, significantly decreased operation time).

If no improvement is achieved after performing several charging/discharging cycles the state of individual batteries should be determined (by comparing battery voltages,

checking them in a cell charger etc). It is very likely that only some of the batteries are deteriorated.

The effects described above should not be mixed with normal battery capacity decrease over time. All charging batteries lose some of their capacity when repeatedly charged/discharged. The actual decrease of capacity versus number of charging cycles depends on battery type and is provided in the technical specification of batteries provided by battery manufacturer.

## 7.3 Power supply considerations

### Warnings

- **Use only charger supplied by manufacturer.**
- **Disconnect power supply adapter if you use standard (non-rechargeable) batteries.**

When using the original power supply adapter/charger the instrument is fully operational immediately after switching it on. The batteries are charged at the same time, nominal charging time is 12 hours.

The batteries are charged whenever the power supply adapter/charger is connected to the instrument. Inbuilt protection circuit controls the charging procedure and assure maximal battery lifetime.

If the instrument is left without batteries and charger for more than 2 minutes, time and date settings are reset.

## 7.4 Cleaning

To clean the surface of the instrument use a soft cloth slightly moistened with soapy water or alcohol. Then leave the instrument to dry totally before use.

### Warnings

- **Do not use liquids based on petrol or hydrocarbons!**
- **Do not spill cleaning liquid over the instrument!**

## 7.5 Periodic calibration

To ensure correct measurement, it is essential that the instrument is regularly calibrated. If used continuously on a daily basis, a six-month calibration period is recommended, otherwise annual calibration is sufficient.

## 7.6 Service

For repairs under or out of warranty please contact your distributor for further information.

## 7.7 Troubleshooting

If *Esc* button is pressed when switching on the instrument, the instrument will not start. You have to remove batteries and put them back. After that the instrument starts normally.

**Manufacturer address:**

METREL d.d.  
Ljubljanska 77,  
SI-1354 Horjul,  
Slovenia

Tel: +(386) 1 75 58 200  
Fax: +(386) 1 75 49 095  
Email: [metrel@metrel.si](mailto:metrel@metrel.si)  
<http://www.metrel.si>