

CHAUVIN'

C.A 8331 C.A 8333 C.A 8336 C.A 8435

POWER AND

ENERGY QUALITY ANALYSERS

The experience of the Qualistar, ensuring high performance

1000 V CAT III 600 V CAT IV

IEC 61000-4-30

IEC 61010

Measure all the necessary voltage, current and power parameters for full diagnosis of an electrical installation.

EN 50160

Capture and record all the parameters, transients, alarms and wave forms simultaneously.

Proven simplicity of use.

True InRush



QUALI

101

?

5 voltage inputs & 4 current inputs

C.A 8336

3U 4V 4A L1 L2 L3 N

OLIALL

1 89.6 A 2 94.1 A 3 83.5 A N 42.22

 147
 ______A

 <1=5.0 ms</td>
 A1=+112.1
 A2=+21
 A3=-1015
 AN=+55.16

 RMS
 THD
 CF
 1
 IIIII
 Z.8

- 10-minute Inrush mode
- Calculation of distorting power
- IP67: all-terrain model available

Designed for inspection and maintenance teams in industrial or administrative buildings, the Qualistar can provide a snapshot of the main electrical network quality characteristics. Easy to handle and precise, these instruments also offer a large number of calculated values and several processing functions.



The whole range benefits from a set of inserts and rings for customizing the colour-coding in each country. Equipped with IP67 connections to ensure water-proofing, the C.A 8435 is also compatible with all the existing Qualistar measuring accessories.

Power and energy quality analysers

Functions



- Real-time display of wave forms (4 voltages and 4 currents)
- ▶ Half-period RMS measurements of voltages and currents
- Intuitive use
- Automatic recognition of the different types of current sensors
- Measurement on any type of installation: three-phase, Aron, etc.
- Integration of all the DC components
- Measurement, calculation and display of harmonics up to the 50th order,
- Display of phasor diagram
- Measurement of P, Q, S and D power values (total and per phase)
- Energy measurement (total and per phase)
- Calculation of the K Factor & FHL

- Calculation of distorting voltages and currents
- Calculation of the cos φ displacement power factor (DPF) and the power factor (PF)
- Inrush over up to 10 minutes
- Capture of hundreds of transients lasting several tens of μs
- Calculation of Pst & Plt flicker values
- Unbalance calculation (current and voltage)
- Monitoring of the electrical network with setting of alarms
- IEC 61000-4-30 Class B
- Back-up and recording of screenshots (image and data)
- Recording and export on PC
- Software for data recovery and real-time communication with a PC

Functions

Connections

The Qualistar models are ideal for applications on all types of electrical networks, from the simplest to the most complex:


- Single-phase, split-phase and three-phase with or without neutral
- All types of 2, 3, 4 and 5-wire electrical networks
- 2-wattmeters method
- ARON
- 2 1/2 elements...



Longer Inrush... over 10 minutes!

The Inrush current corresponds to the maximum input current drawn by an electrical device when it is powered up. This measurement helps to size the electrical installation correctly.





(01/13 18:36

The Inrush is measured over a period of 10 minutes. Once you have chosen the acquisition mode (RMS or peak), the Qualistar captures everything.



Short or long-term flicker

The flicker (as defined by the IEC/EN standard) characterizes voltage variations which cause lighting fluctuations, for example.

According to the applicable standards, the Flicker level is expressed by two parameters:

• Pst (short-term flicker)

Calculation of the Pst, which is used to assess the flicker level, is based on statistical processing of the voltage signal sampled. It is measured over a period of 10 minutes

• Plt (long-term flicker)

This is a multiple of the Pst. It is measured over a period of 2 hours.



MAX IPEAKI 🔕 76.6

84.3

Power and energy quality analysers

Energy values, including Tonnes Oil Equivalent

The Qualistar models measure energy. This mode displays all the values relating to power and energy.

- "Start" and "Stop" keys to activate and deactivate summing of the energy values.
- A new feature is the wide variety of units available: kW, Joule, nuclear toe, non-nuclear toe, BTU, etc

Calculation of K factor for transformers

			49.97Hz		01/13 18:00	-
	0			0		
RMS	220.1	¥≃		1.43	A≃	
0C	+0	v =		+1.43	A-	â
THD	4.3	Xſ		11.3	21	4V 4A
	4.3	$\chi_{\mathbf{r}}$		11.3	Xr	L1
CF	1.40			1.06		13
PST	0.27		FHL	1.13		
PLT	0.32		FK	1.00		
BM	S TH	ib I	CE	1		1.0

1.00	(2)	1.00	0	1.02		-
						1
1.02	200	5	1		ACCES	

The harmonic currents flowing in a network lead to increased losses in the windings. This results in heating of the transformer and reduces the life span of the instruments connected.


- compliance with the NF EN 50464-3 standard for calculating transformer derating.
- the FHL and European K factor parameters are recorded and measured simultaneously.



Harmonics

All the useful parameters are measured: global THD and per phase on U, I, V and VA, phase offset of harmonics. Some models offer a VA harmonics function and an "expert mode".



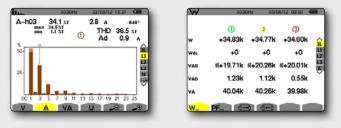

New: the harmonics measurement function is more comprehensive:

- calculation of the harmonics in %f and %r
- decomposition of the harmonics on the neutral conductor
- calculation of the distorting voltages and currents

Distorting power

New!

Breakdown of the reactive power values, with the concept of non-active power (N), distorting power (D) and reactive power $(Q \& Q_1)$.

- Breakdown of the reactive power to find the distorting power linked to the harmonics (VAD).
- Distorting power for sizing the harmonic filters.
- Reactive power (var) of the fundamental for sizing the battery of the power-correction capacitor.

Configuration

- Users enter the instrument's general parameters directly (date and time, display contrast, colour, etc.).
- The menus, help screens and pop-ups are translated into all the languages.
- They select the type of network to which the Qualistar is connected.
- They configure the measurement and recording parameters.








Ratios and sensors

When they are connected, the current sensors are recognized automatically by the Qualistar.

By configuring the ratios, it is possible to obtain **direct readings of the measurements** on the transformer primary.



Practical advantages

Accessible on the front panel of the Qualistar, screenshots can be produced simply by pressing a key. The Help function is available at every stage.

? Help

If you have any hesitations, the **Help** key clearly explains the functions applicable to the screen display.

W	(?) 13/02/13 16:57 💷
Ę	Inductive effect
÷	Capacitive effect
w	Active power (P)
₩dc	Direct power
VAR	Reactive power (Q)
VAD	Distortion power (D)
VA	Apparent power (S)
PF	Power factor
cusΦ	Fundamental power factor
tan P	Tangent
Φw	Angle of voltage referenced to current
(30	

Screenshot

When this key is pressed, the instrument takes a screenshot. The screen displayed is then saved automatically with time/date-stamping.



Display


Display


View the characteristics of a network instantaneously

OBSERVATION

Graphics 🕑 🕑 🕑

The Qualistar models allow you to view all the inputs simultaneously. The measurements are displayed as waveforms; values or Fresnel diagrams.






DIAGNOSTICS

Harmonics mode

Global THD and per phase on U, I, V and VA in % and RMS value, phase offset of harmonics. They offer the expert mode for the Harmonics function. These two instruments can be used to analyse the influence of the harmonics on heating of the neutral or on rotating machines.

GLOBAL THD 💌 💌

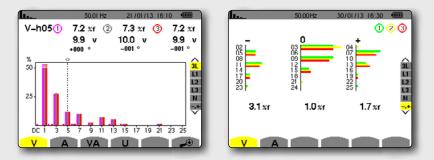


W Power/Energy mode

This mode displays all the values concerning power and energy. The "start" and "stop" keys can be used to activate and deactivate totalizing of the energies.

POWER MEASUREMENT

		50.01 Hz		22/05/12		
					(1)	<mark>2 ()</mark>
w	+510.1		PF	+0.771	1	3L
Wdc	+0.7		cos¢	+0.772	2	3L L1 L2 L3 Σ
VAR	€419.8				-	L3 Σ
VAD	1.2		tan¢	+0.825	5	Ŷ
VA	661.9					
		Wh				-

INTEGRATION OF POWER / ENERGY OVER A PERIOD OF TIME ()



THD PHASE BY PHASE



vthing,

Configuration (

Recording mode • More than 450 recordable values with all the required parameters and graphic display. RECORDING SCHEDULE 101, TREND MODE • Programmable recording period and storage rate. oUrms oUdc ⊙Upk+ ⊙Upk- ⊙Ucf ♦ Uthdf <> Uthdr Set-up 10L Vrms ◆Vdc ◇Vpk+ ◇Vpk- ◇Vcf ◆Vthdf ◆Vthdr Start 04/12/12 18:00 Armo Adc Apk Apk Apk Acf Athdf Athdr New! Quick start-up: Stop 06/12/12 18:00 ●Wdc ●VAB ●VAD ●VA w Immediate start of recording Period 10min •cos∳ •tan∳ • PF Automatic indication of Min/Max values Name T B F D 2 ●PLT ○FHL ●FK PST ♦ Vunb ♦ Aunb ♦ Hz Auto-completion of measurement campaign names 1/2 1/4 Þ Alarms mode 04/12/12 16:05 4/12/12 16:05 📲 △ ALARM MODE DETECTION SCHEDULE • Up to 40 alarms can be set simultaneously! 40.5 Hz 01 Hz 00 s 1 % Start 04/12/12 18:00 Threshold overruns to be monitored can be configured 2 Vrms 0200 V 1 % 06/12/12 18:00 during set-up. 0000 A Stop 4 judej nean v Name T B F O 2 • For each alarm threshold overrun, a time/date-stamped • 5 VAD 0300 va recording of the event is made with the duration and the extreme values. िाि Ξ • Possibility of modifying the end dates for programmed alarms.


Monitor ever



٠

Transients mode

- Capture of events on the voltage and current with triggering according to thresholds.
- Capture of hundreds of transients. ٠
- Display of events as short as a few tens of μ s.






(-

Inrush & TrueInrush

- Monitoring of the Inrush current for a load when it is powered up.
- Records the currents, voltages and frequency.
- For correct sizing of electrical installations. •
- To view source switching faults.

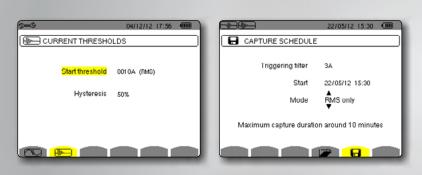

with more parameters

Acquisition in progress 🕥

During acquisition:

Operation of several

modes in parallel,

Possibility of viewing

the data during

a campaign.

Users can view

all the parameters,

so they can be checked at any time.

 (\blacktriangleright)

 $(\blacktriangleright$

Analysis 🕥 17/01/13 12:49 🔲 IIrm 1370.3 v (2361.3 v (3366.0 v 414.4 /12/12 12:04 ∧ 3L 11 12 13 26:53 Wh 10/10/12 11:57:0 -59.10 wh 368.I V RECORDING PARAMETERS Name ADEGY01 321.0V 12 18 ü 12 18 6 6 Start 10/12/12 11:2 T Stop 10/12/12 11:57 63.50k s> Period 15 [5] 1/47 Ude Upk+ Upk- Uthdf 🕞 14/01/13 16:04 DETECTION LIST TRYO1 TRF02 20/04/12 15:43 04/12/12 18:00 >03/05/12 09.53 × 11 12 13 Ν Σ >06/12/12 18:00 13/01/13 13:26 >13/01/13 14:11 ADEG

04/12/12	16.43	L1	Vthd	23.1%	23
	16:49	12	Vrms	0V	2\$36
		L3	Vrms	215V	36min4
	18.30	L2	Vrms	0V	43 4 5
		-13	Vrms	216V	536 1 +9
	18:43	L1	Arms	1A	1:5465
	18:50	L3	Vrms	218V	2d13h
05/04/12	05:49	-12	Vrms	213V	12h5m

6/12 10:48:06

>t=-T< >t=0<

147


	ALTA INT
CHAUVIN'	C.A 8335
O 230.3 v @ 231	2 v 3 229.2 v 8 29.3 v
3307	
o K	
-330 <1=125 ms V1 = RMS THD	-231 V2=314 V3=84 VN=.45




TRY01 053 20/04/12 15:46:47 507 V2 US4 20/04/12 15:46:51 159 V2 V2 V3 055 20/04/12 15:46:51 681 V2 V3 056 20/04/12 15:46:51 681 V2 V3 056 20/04/12 15:47:00 132 V2 V3 058 20/04/12 15:47:00 136 V2 V3 059 20/04/12 15:47:07 136 V2 V3 059 20/04/12 15:47:14 210 V2 V4 059 20/04/12 15:47:14 210 V2 V4 050 20/04/12 15:47:15 981 V1 1/20 11/20 15:47:16 981 V1	🗃 TRA	NSIENT	LIST				
055 20/04/12 15:46:51 681 V2 056 20/04/12 15:46:52 689 V2 057 20/04/12 15:47:00 153 V2 058 20/04/12 15:47:07 1.26 V2 059 20/04/12 15:47:14 210 V2 059 20/04/12 15:47:14 581 V1 1/20	TRY01	053	20/04/12	15:46:47	.507	V2	
056 20/04/12 15.46.52 889 V2 057 20/04/12 15.47:10 153 V2 058 20/04/12 15.47:01 153 V2 059 20/04/12 15.47:14 210 V2 059 20/04/12 15.47:14 210 V2 060 20/04/12 15.47:16 981 V1		054	20/04/12	15:46:51	159	V2	۷
057 20/04/12 15:47:00 153 V2 2 058 20/04/12 15:47:07 126 V2 3 059 20/04/12 15:47:14 210 V2 3 060 20/04/12 15:47:16 991 V1 1/20		055	20/04/12	15:46:51	.681	V2	47
058 20/04/12 15:47:00 1.26 V2 20 058 20/04/12 15:47:07 1.26 V2 20 059 20/04/12 15:47:14 210 V2 20 060 20/04/12 15:47:16 581 V1		056	20/04/12	15:46:52	.689	V2	48
059 20/04/12 15.47:14 210 V2 m 060 20/04/12 15:47:16 991 V1 1/20		057	20/04/12	15:47:00	153	V2	12
059 20/04/12 15.47:14 210 V2 m 060 20/04/12 15:47:16 991 V1 1/20		058	20/04/12	15:47:07	.126	V2	L3
1/20		059	20/04/12	15:47:14	.210	V2	
		060	20/04/12	15:47:16	.991	VI	
6 0 T 🛩 8 🐨	1/20						
	(F)	FÛ	T	📂 👘	H	8000	
	-						

 \triangleright

0





<1= -0.2ms V1= -76.6 V2= -49.3 V3=+126.6 VN=</p>

2 3 (N)

4A L1 L2 L3

-0.5

NEW

A rugged, waterproof C.A 8435,

the special Qualistar+ for all conditions and all seasons!



The rugged site case is ideal for industrial use in factories, production workshops, etc. It is so rugged that it can even withstand projections of solids or liquids.

Specific accessories for this model: mains lead, sets of voltage leads and Amp**FLEX**™ clamps.

Essailec accessory for all the Qualistar models

A cable with an ESSAILEC plug can be used for testing without disturbances or interruptions in the power supply circuit on meters and the protective relays installed in the secondary circuits of the current or voltage transformers. The main advantage is quick and simple measurement with maximum user safety




Accessories and software

ACCESS	ORIE:					6	6	R		R
Model	MN93	MN 93A	MA193-250	MA193-350	PAC93	A196-450 A193-450	A193-800	C193	E3N	J93
Measurement range	500 mA to 200 Aac	0.005 AAC to 100 AAC	100 mA to 10 kAac	100 mA to 10 kAac	1 A tp 1,000 Aac 1 A to 1,300 Adc	100 mA to 10 kAac	100 mA to 10 kAac	1 A to 1,000 Aac	50 mA to 10 Aac/dc 100 mA to 100 Aac/dc	50 A to 3,500 Aac 50 A to 5,000 Aac
Clamping Ø / length	20 mm	20 mm	Ø 70 mm / 250 mm	Ø 100 mm / 350 mm	1 x Ø 39 mm 2 x Ø 25 mm	Ø 140 mm / 450 mm	Ø 250 mm / 800 mm	52 mm	11.8 mm	72 mm
IEC 61010		cat III / Cat IV	1,000 V 600 V	cat III / Cat IV	600 V CAT III / 300 V CAT IV		cat III / Cat IV	600 V CAT IV	600 V CAT III / 300 V CAT IV	600 V CAT III / 1,000 V CAT IV

SOFTWARE

The measurements made with the Qualistar can be processed using two software products; POWER ANALYZER TRANSFER delivered as standard and **DataView**[®] available as an option.



Power Analyzer Transfer

- Configuration of the instrument: setup, recording, alarms
 Real-time display
- Processing of the recorded data and the alarms
- Transfer of screenshots and transients
- Data export into Excel spreadsheets
- ▶ Data export in graphic form in Windows[™]




DataView[®]

The simple-to-use **DataView** software automatically recognizes the instrument connected to the PC and opens the corresponding menu. Users have direct access to:

- database management
- EN 50160 report management

Data*View*[•] is compatible with other Chauvin Arnoux[®] products: Qualistar+ power analysers, C.A 8220 & C.A 8230 power analysers, F400 and F600 multimeter clamps, and other measuring instruments.

Minimum operating system requirements: Windows[®] 2000, Windows[®] XP, Windows[®] Vista, Windows[®] 7 and 8.

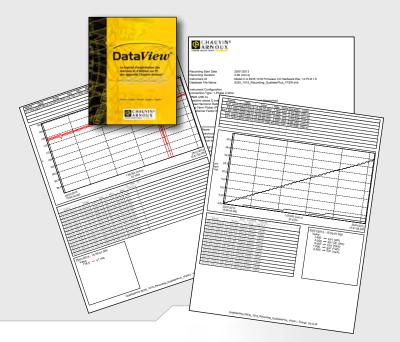

EN 50160

The EN 50160 European standard regulates the quality of the voltage distributed by electricity suppliers. To define the quality of the voltage, a measurement campaign must be carried out over a 7-day period with an IEC 61000-4-30 instrument. The measurements correspond to the different types of disturbances liable to affect the voltage:

voltage drops, outages, overvoltages, slow voltage variations, network frequency variations, voltage unbalance, harmonics, rapid voltage variations, flicker. Once these measurements have been taken, the recorded data are analysed.

The PAT software automatically configures the instrument in compliance with the standard.

The Dataview[®] software can be used to generate the report automatically in compliance with the EN50160 standard.

Technical specifications	C.A 8331	C.A 8333	C.A 8336	C.A 8435			
Number of channels	31	J / 4I	4U .	/ 4			
Number of inputs	4	/ / 31	5V .	/ 4			
Voltage (TRMS AC+DC)	2 V to 1,000 V						
Voltage ratio	up to 500 kV						
Current (TRMS AC+DC) MN clamps	MN93: 500 mA to 200 Aac ; MN93A: 0.005 Aac to 100 Aac						
C193 clamp		1 A to 1,	000 AAC				
AmpFLEX [™] or MA193 clamps	100 mA to 10,000 AAc 30 A to 6,500 AAc						
PAC93 clamp	1 A to 1,300 Aac/dc						
E3N clamp		50 mA to 1	00 Aac/dc				
Current ratio		up to	60 kA				
Frequency		40 Hz to	o 69 Hz				
Power values		W, VA, var, VAD, PF	, DPF, cos φ, tan φ				
Energy values		Wh, varh, \	/Ah, VADh				
Harmonics		ує	25				
THD		yes, orders 0	to 50, phase				
Expert mode	-		yes				
Transients	- 50 210						
Flicker (Pst & Plt)	yes						
Inrush mode	- yes on 4 periods yes > 10 minutes						
Unbalance yes		ye	25				
Recording Min/Max		уе	25				
of a selection of parameters at the max. sampling rate	4 hours to 2 weeks	A few days to several weeks	2 weeks to s	everal years			
Alarms	-	4,000 of 10 different types	10,000 of 40 c	lifferent types			
Peak	yes						
Vectorial representation	automatic						
Display	Colour ¼ VGA TFT screen, 320 x 240, diagonal 148 mm						
Capture of screens and curves		12	5	0			
Electrical safety		IEC 61010 1,000 V C	AT III / 600 V CAT IV				
Protection		IP53 / IK08		IP67			
Languages		more th	nan 27				
Communication interface		US	-				
Battery life		up to 13					
Power supply	S	9.6 V NiMH rechargeable batt	ery or external mains charg				
Dimensions		240 x 180 x 55 mm		270 x 250 x 180 mm			
Weight		1.9 kg		3.7 kg			

STATE AT DELIVERY FOR THE C.A 8336, C.A 8333 AND C.A 8331

Models without sensors

One Qualistar+ analyser delivered with a bag for accessories, 5 x 4 mm banana voltage leads 3 m long, 5 crocodile clips, a set of 12-colour inserts/rings for identifying the leads and inputs, a scratch-proof screen-protection film (mounted), a USB cable, a mains power cable, a mains power pack, a safety datasheet, a multi-language operating manual CD and a PC data retrieval software CD (Power Analyser Transfer).

STATE AT DELIVERY FOR THE C.A 8335

C.A 8435 AMP450: delivered with bag no. 22, USB cable, IP67 mains power cable, 4 AmpFLEX[™] 450 IP67 A196 current sensors, 5 x 3 m black IP67 BB196 banana leads, 5 lockable crocodile clips, 12-colour identification kit for the leads and inputs, scratchproof screen-protection film (mounted), safety datasheet, CD containing the multi-language operating manual and CD PC data retrieval software and CD containing PC data retrieval software (Power Analyzer Transfer).

References for ordering	Accessories	
C.A 8336 aloneP01160591	MN93 clamp P01120425B	Qualistar screen filmP01102059
C.A 8333 aloneP01160541	MN93A clamp P01120434B MiniFLEX™ MA193, 250 mm P01120580	Set of id. rings/insertsP01102080 Set of caps (C.A 8435)P01102117
C.A 8331 aloneP01160511	MiniFLEX™ MA193, 350 mm P01120567	Set of 5 x 3 m IP67 (BB196) banana leadsP01295479 Carrying bag no. 21P01298055
C.A 8435 alone	PAC93 clamp	Carrying bag no. 22
C.A 8435 AmpFLEX™ 450 mmP01160587	AmpFLEX [™] A193 800 mm clamp P01120531B	USB-A USB-B leadP01295293 5 A boxP01101959
	AmpFLEX™ A196 450 mm IP67 clamp P01120552 C193 clampP01120323B	Mains power pack (C.A 8331-33-35-36)P01102057 IP67 mains lead (C.A 8435)P01295477
	E3N clampP01120043A E3N AdapterP01102081	Dataview [®] SoftwareP01102095
	E3N mains power pack	Lockable crocodile clips (x 5)P01102099 Kit containing 5 banana leads, 5 crocodile clips and
	J93 clamp P01120110 Battery pack P01296024	1 set of coloured ringsP01295483 Kit containing 4 banana leads, 4 crocodile clips and
	ESSAILEC casing P01102131	1 set of coloured rings



FRANCE

Chauvin Arnoux 190, rue Championnet 75876 PARIS Cedex 18 Tel: +33 1 44 85 44 38 Fax: +33 1 46 27 95 59 export@chauvin-arnoux.fr www.chauvin-arnoux.com

UNITED KINGDOM

Chauvin Arnoux LTD Unit 1 Nelson Ct, Flagship Sq, Shaw Cross Business Pk Dewsbury, West Yorkshire - WF12 7TH Tel: +44 1924 460 494 Fax: +44 1924 455 328 info@chauvin-arnoux.co.uk www.chauvin-arnoux.com

MIDDLE EAST

Chauvin Arnoux Middle East P.O. BOX 60-154 1241 2020 JAL EL DIB - LEBANON Tel: +961 1 890 425 Fax: +961 1 890 424 camie@chauvin-arnoux.com www.chauvin-arnoux.com

For assistance and ordering

